ARROWSTREET

DEMYSTIFYING NET ZERO

VIRTUAL
27 MAY 2021


PREPARED FOR
MSBA


DEFINING NET ZERO

NET ZERO ENERGY




ARROWSTREET

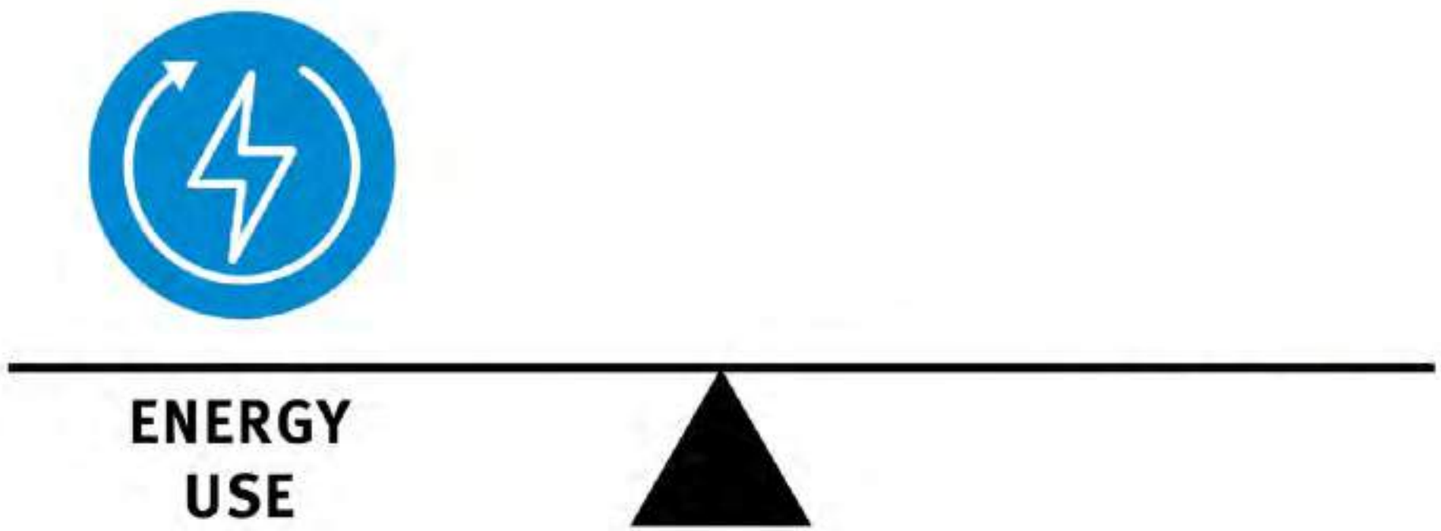
ENERGY
USE

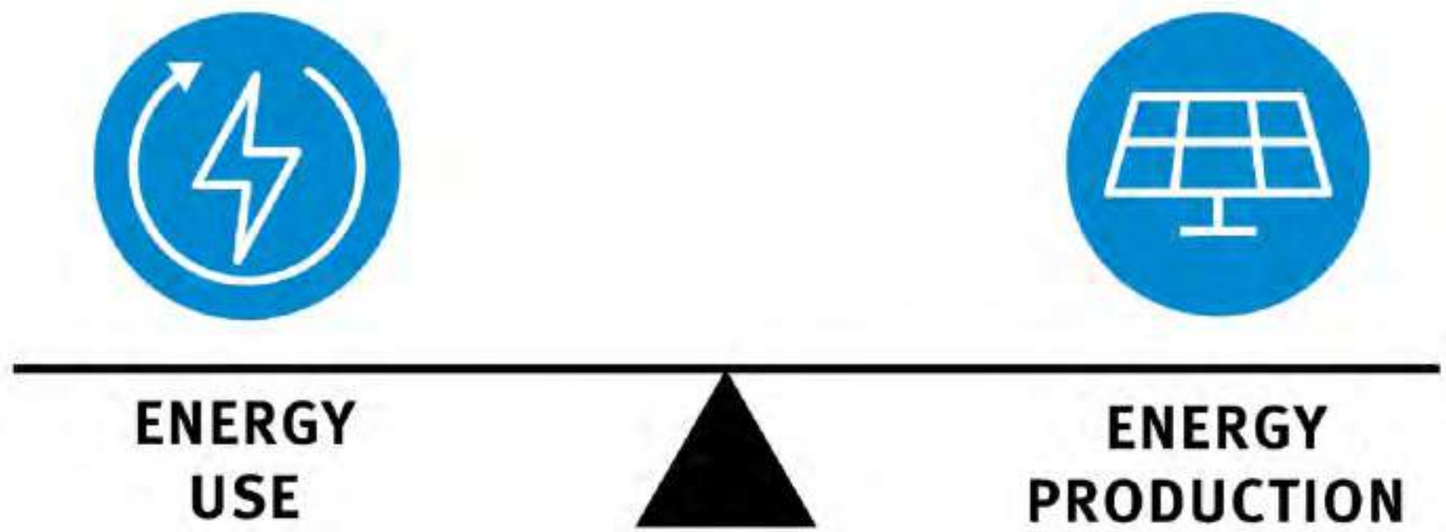

ENERGY
USE
ENERGY
PRODUCTION

NET ZERO ENERGY DEFINITION

A building, that has an ultra low EUI, whose annual energy use is equal or less than the amount of on-site or off-site new renewable energy.

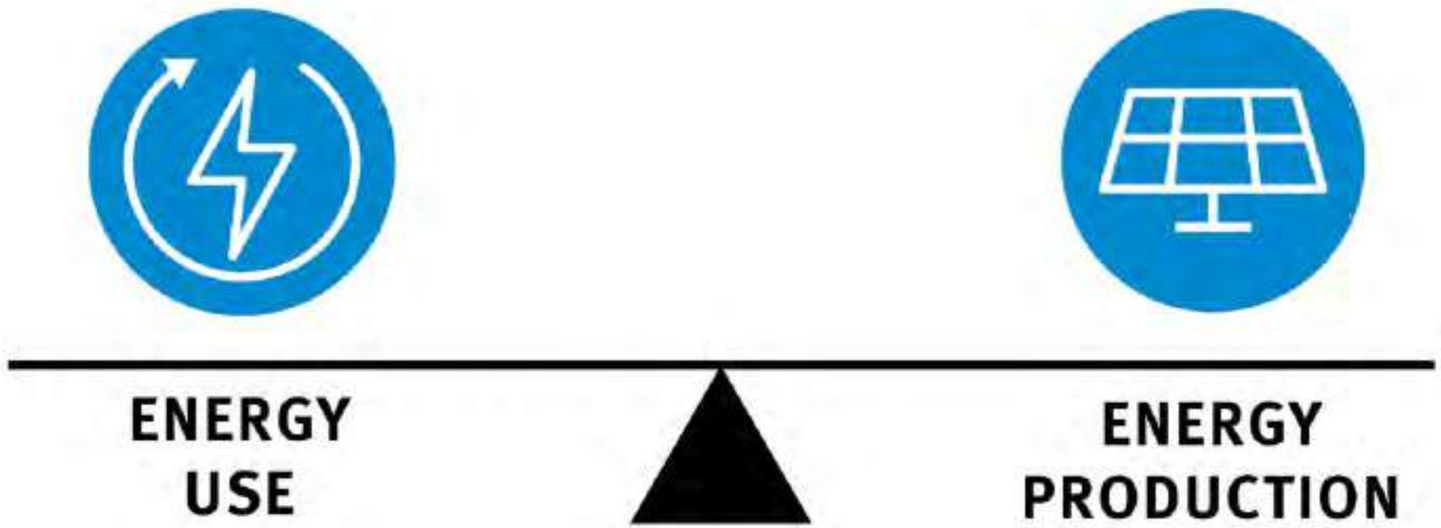


PATH TO NET ZERO ENERGY

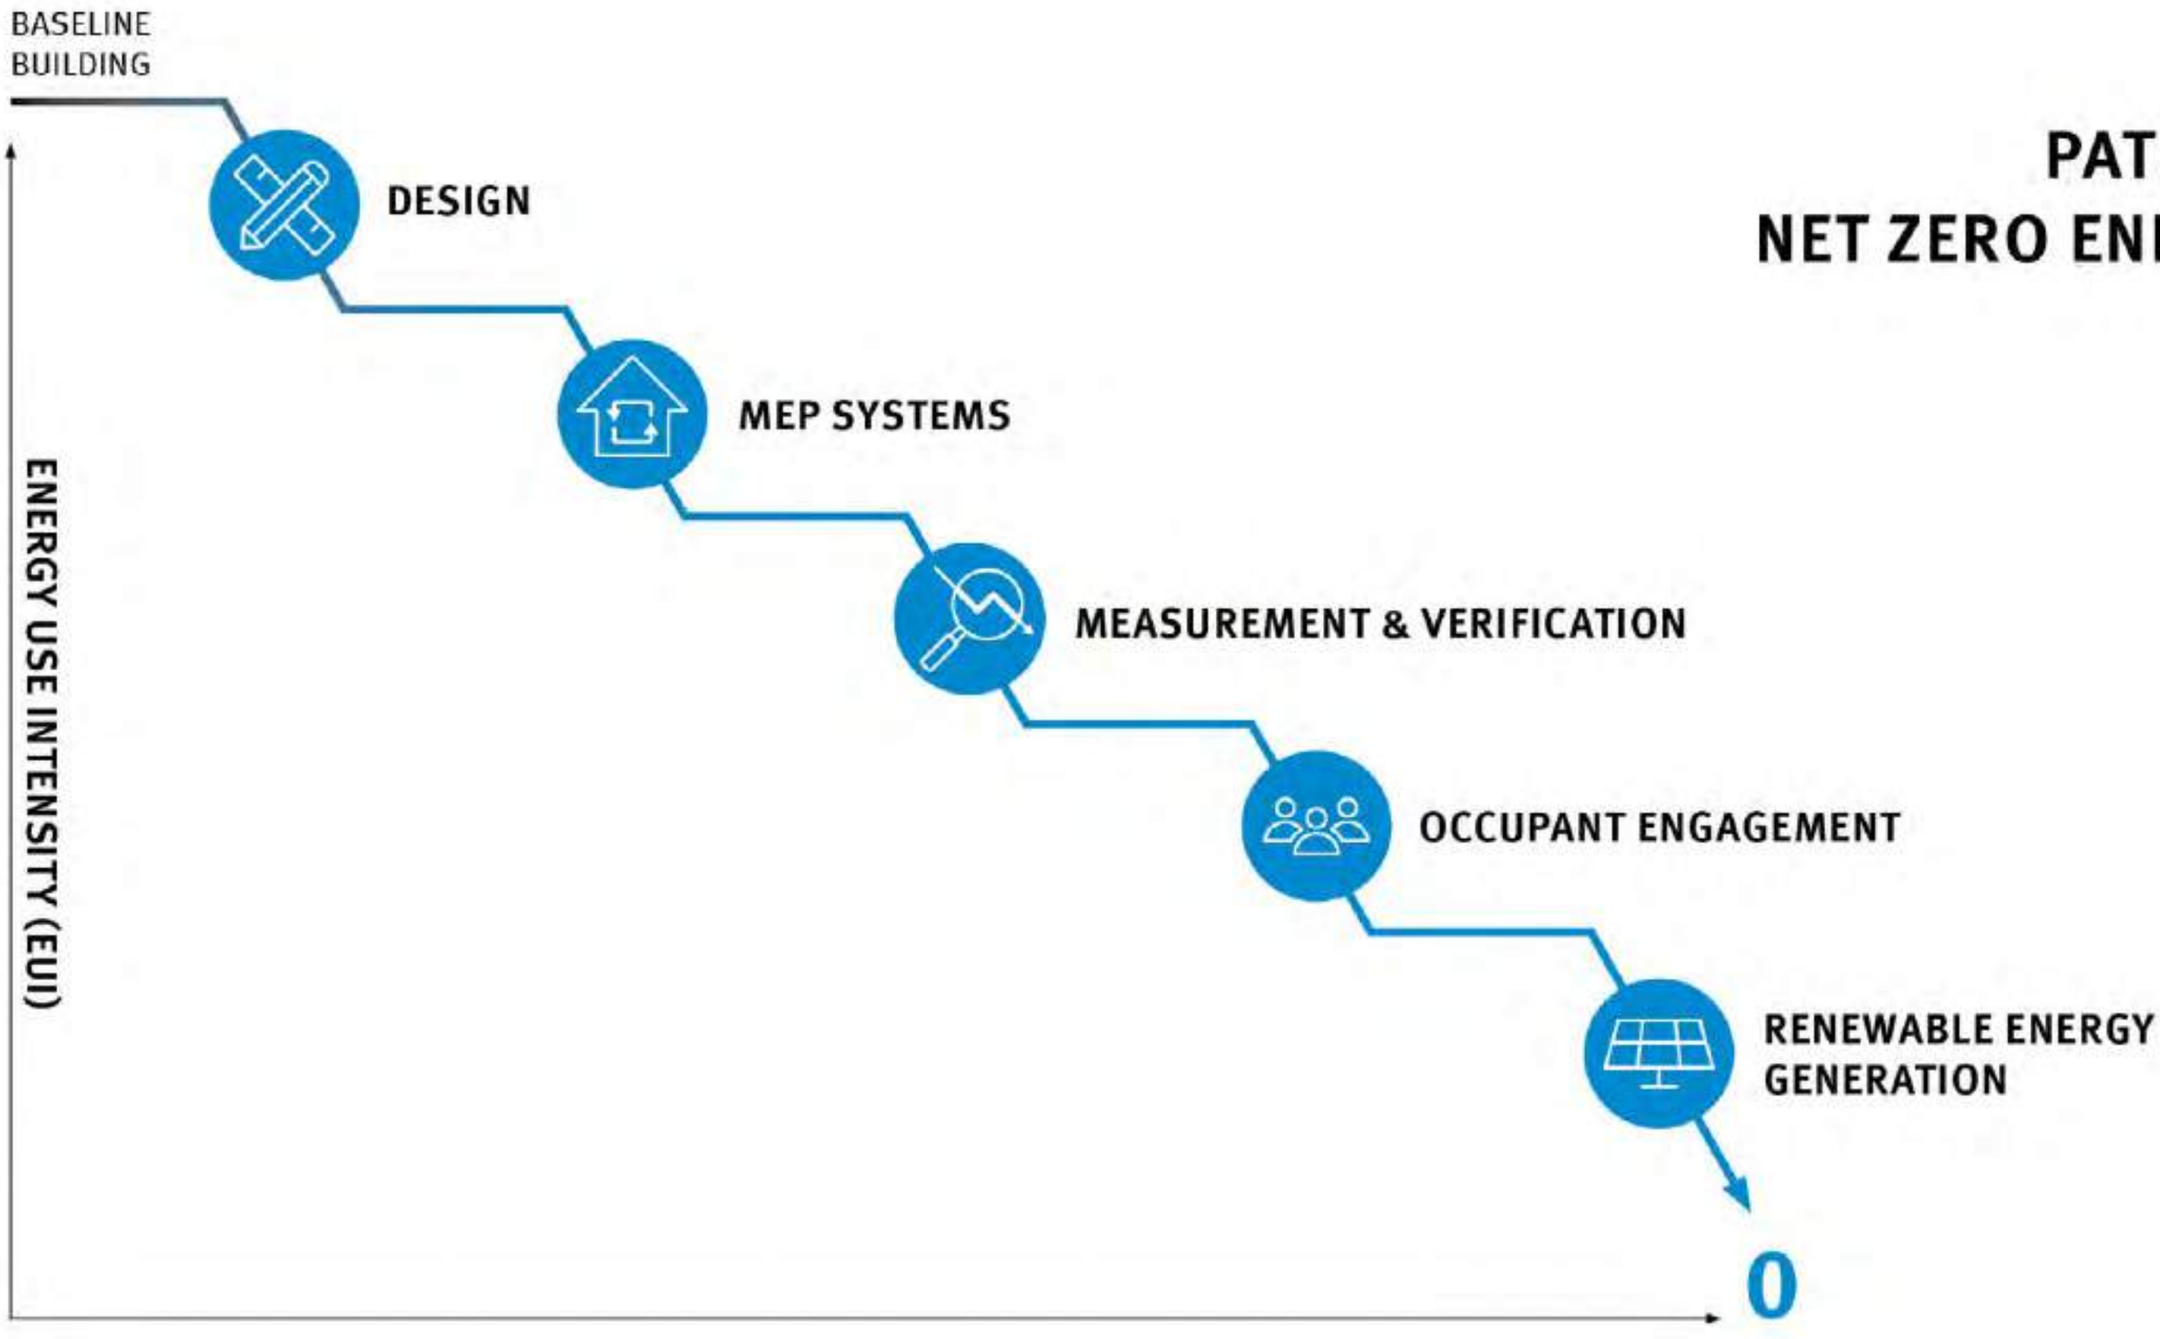


ARROWSTREET

PATH TO NET ZERO ENERGY

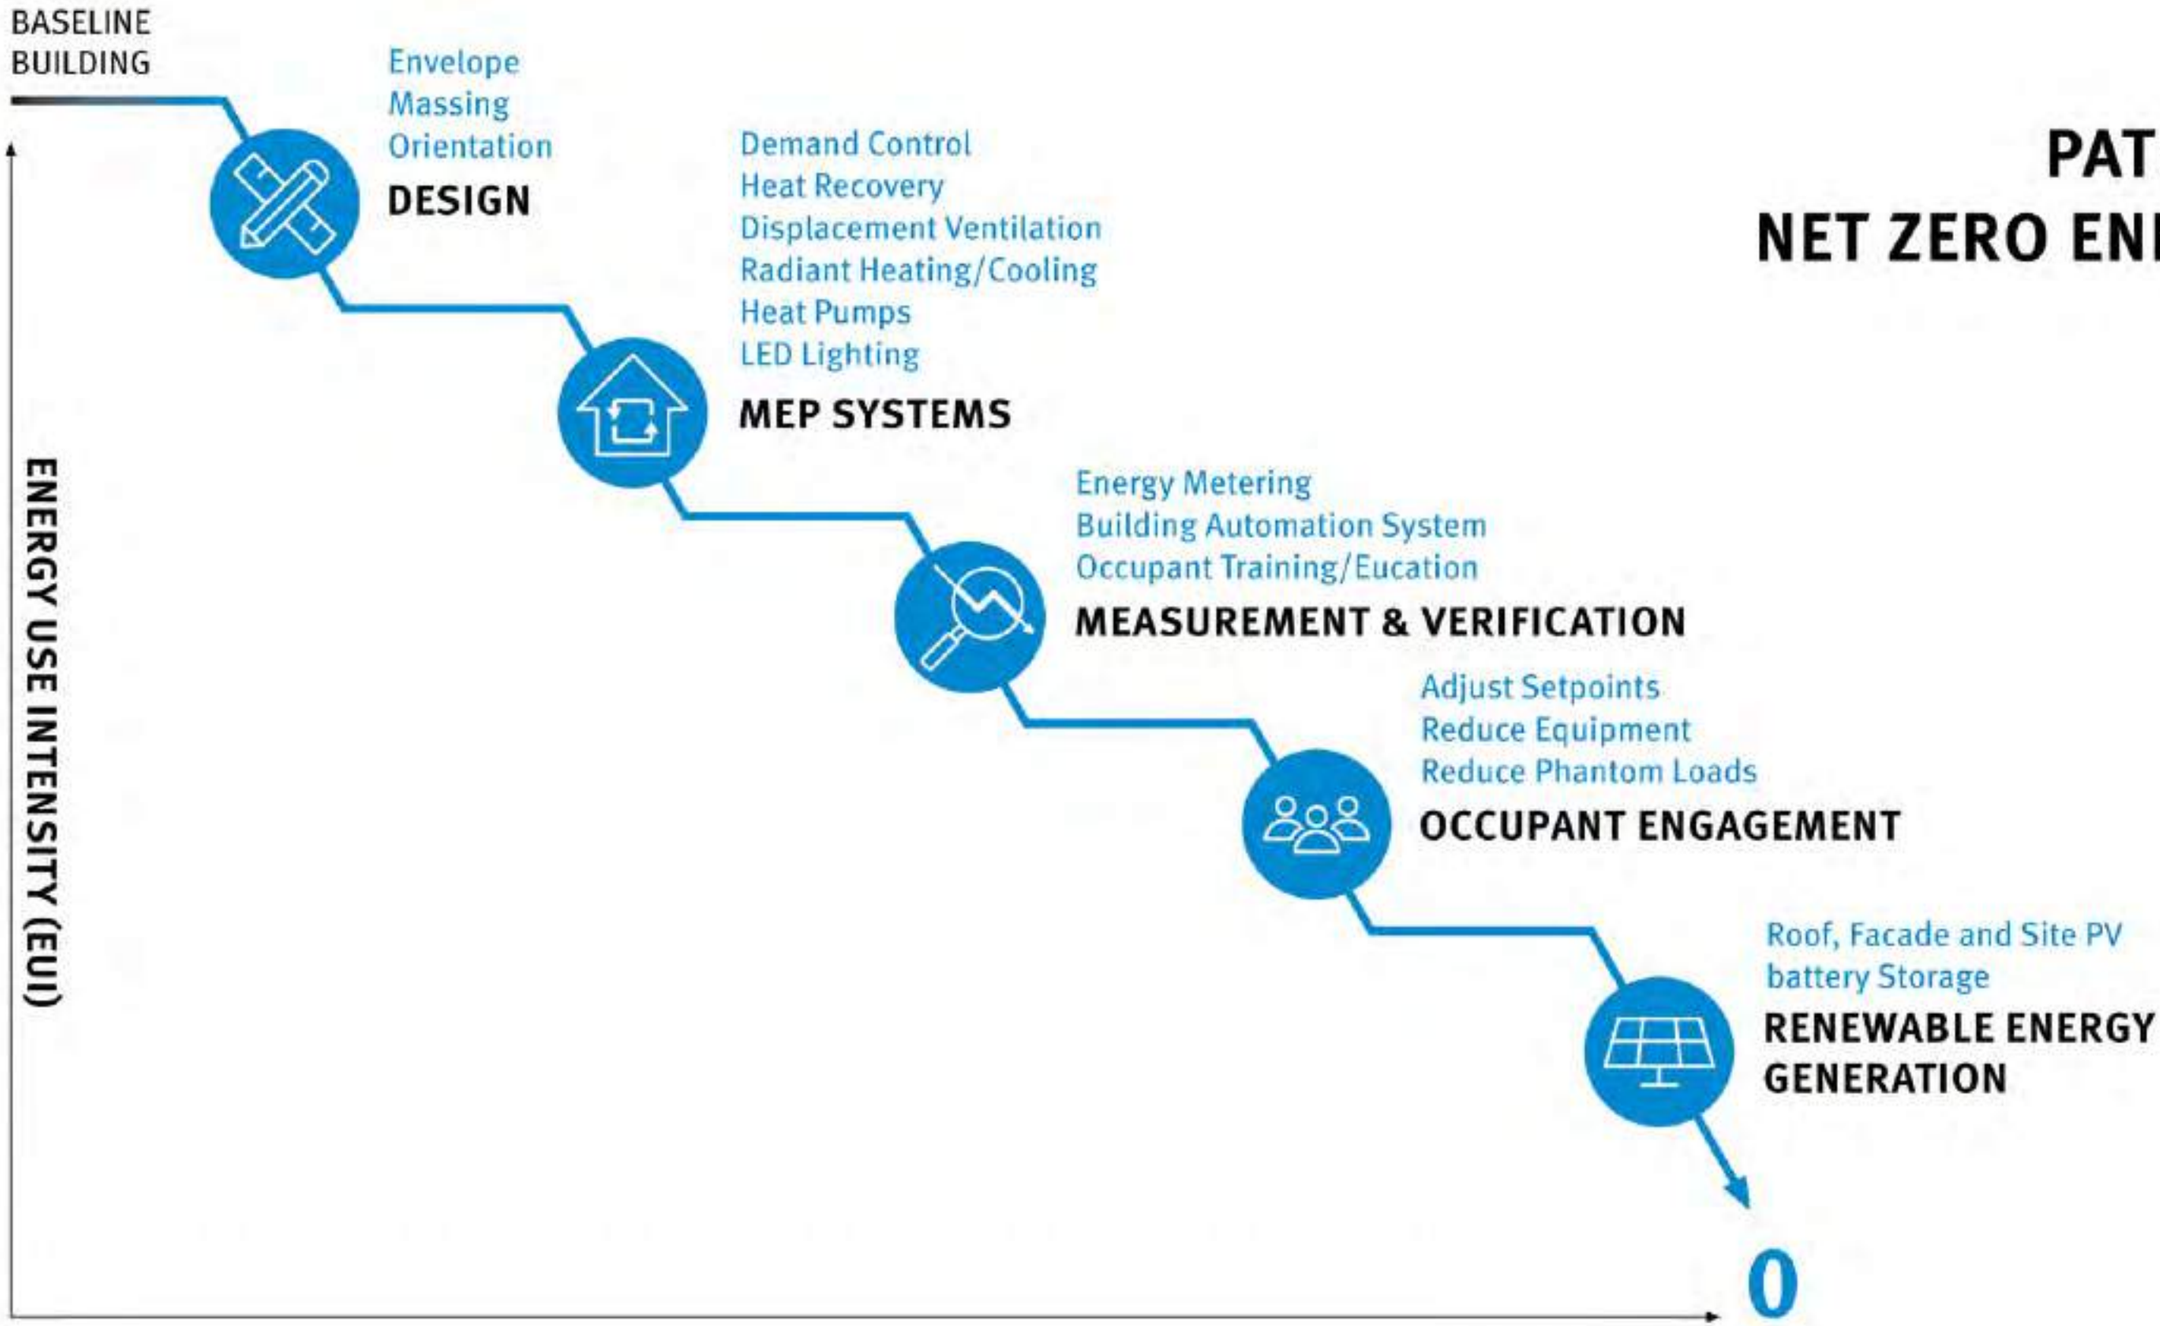

energy use intensity: EUI

kBtu* / SqFt / Year

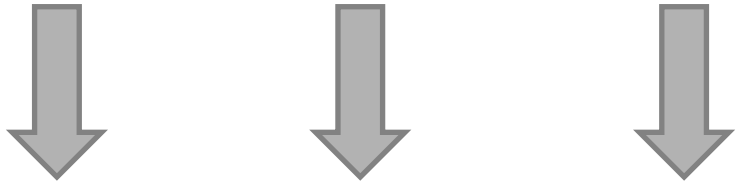

energy / area / time


*thousands British thermal units

DLR Group
Architecture Engineering Planning Interiors

energy use intensity: EUI

Lower is Better

- reduce energy used
  - design first
  - systems second
- building area kept warm & dry

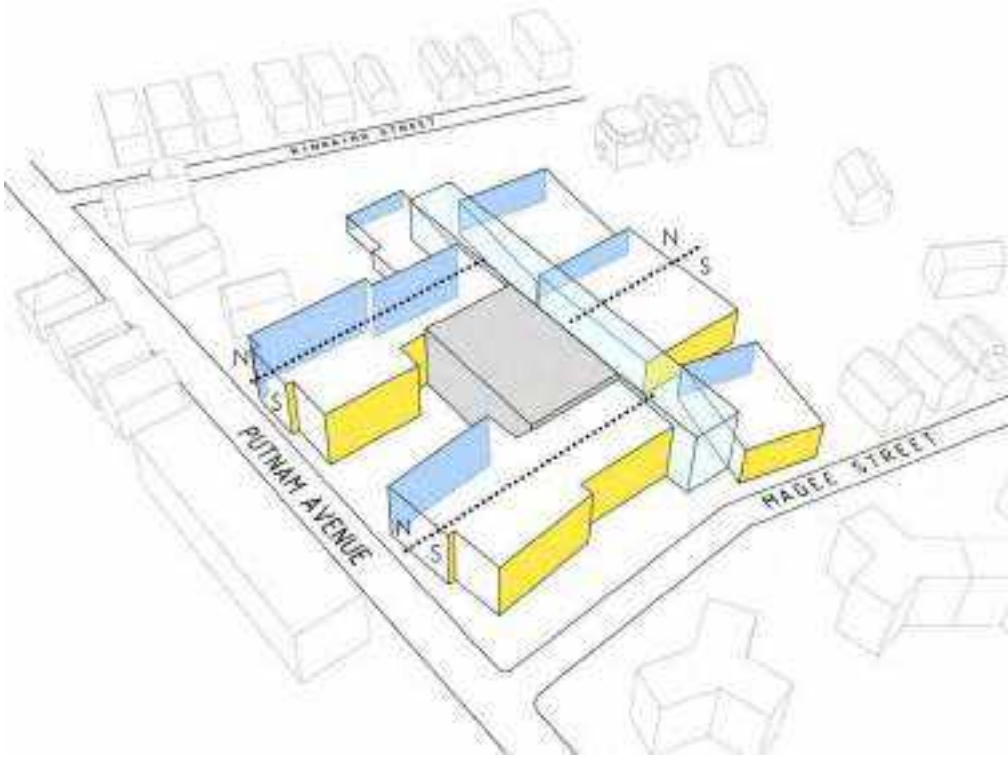


Graphics courtesy of Perkins Eastman

energy use intensity: EUI

Lower is Better

- reduce energy used
  - design first
  - systems second
- define building area kept warm & dry
- hours of operation

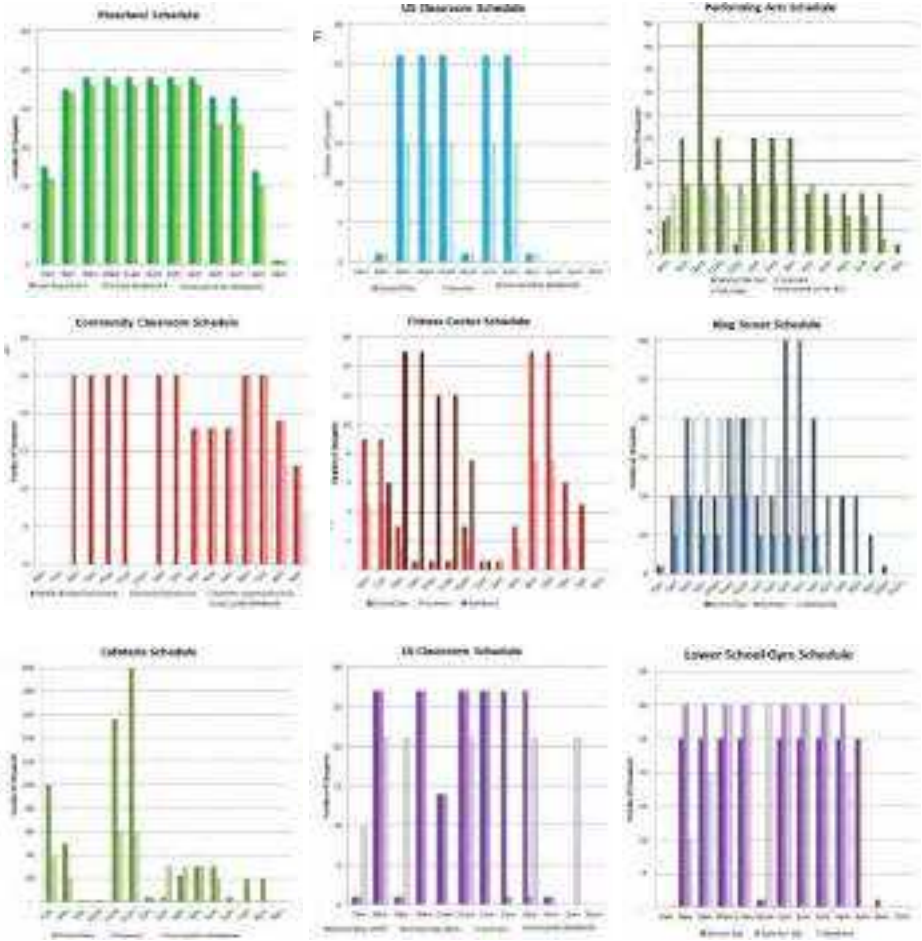


Graphics courtesy of AKF Engineers | In Posse

energy use intensity: EUI

Lower is Better

- reduce energy used
  - design first
  - systems second
- building area kept warm & dry
- hours of operation
- occupant behavior

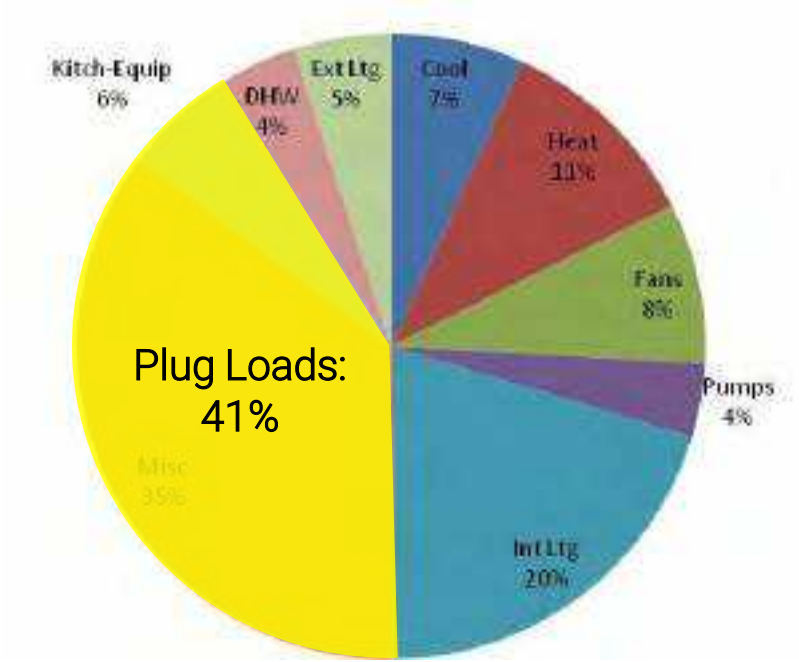

Graphics courtesy of AKF Engineers | In Posse

MSBA

Demystifying Net Zero Energy


Annie E. Fales Elementary School

Westborough, MA
May 20, 2020



HMFH ARCHITECTS


Rapidly Changing Technology

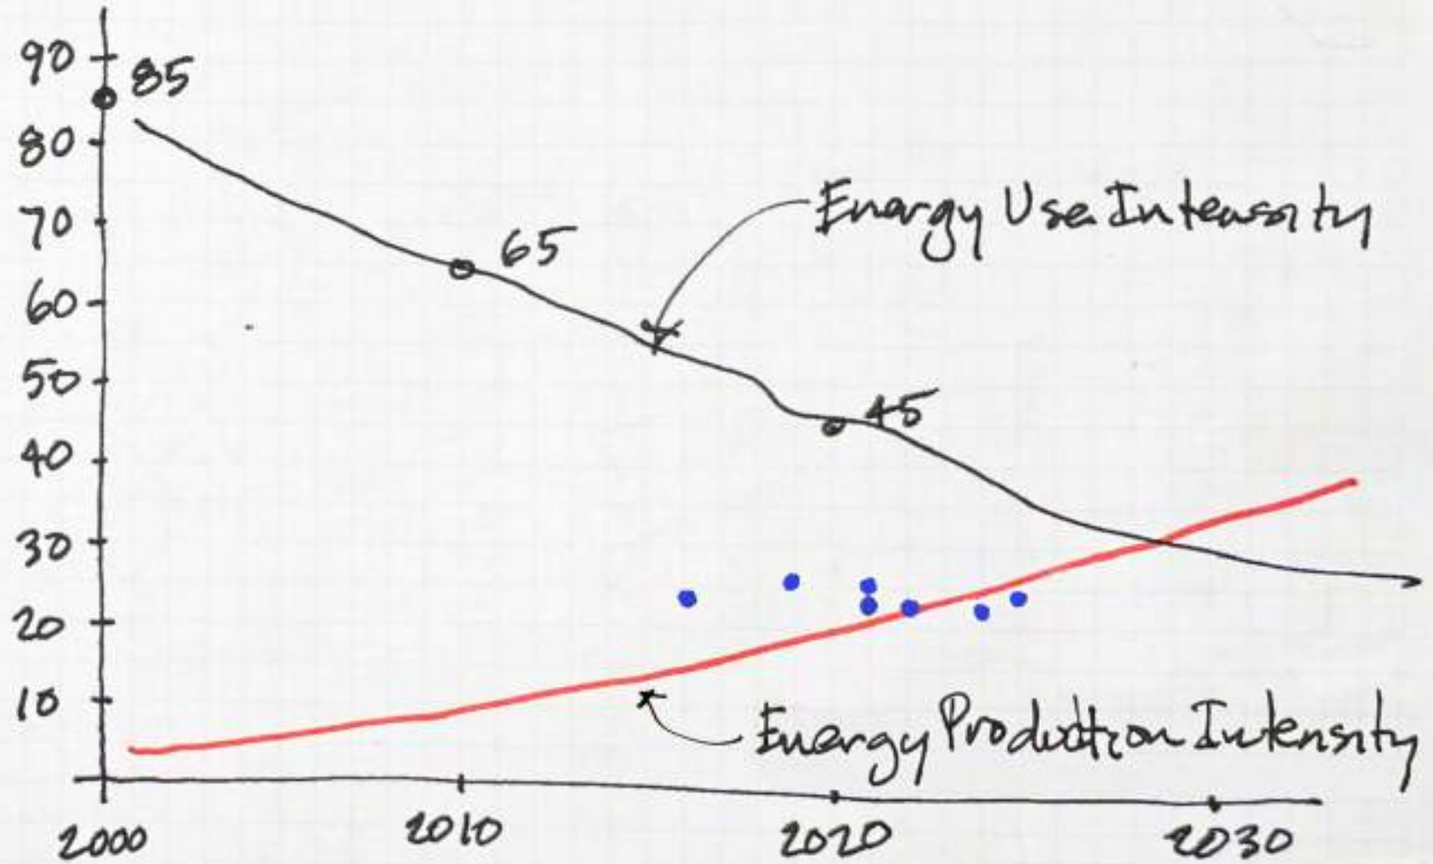

HM
FH


Changing Technology: Energy Production

2000

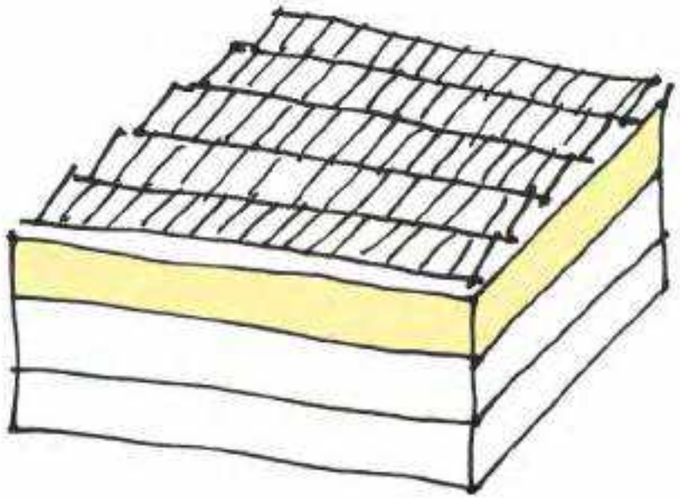


$12.50/watt
200 watts/panel

2010

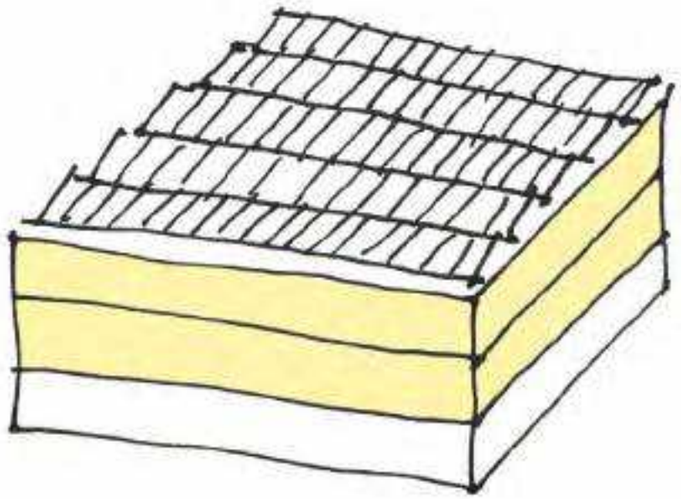

$7.50/watt
300 watts/panel

2020

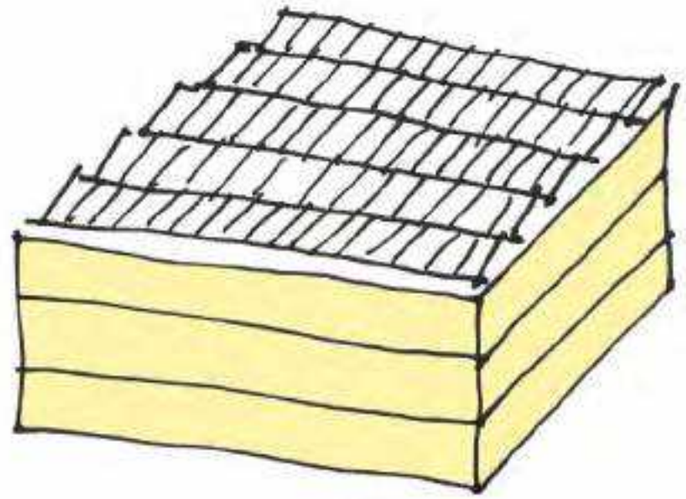

$2.50/watt
450 watts/panel


PV systems are more powerful and more affordable

H M
F H

Changing Technology: Energy Reduction



2000	2010	2020
Commercial LED *not available*	$40.00/bulb 60 watt equivalent	$2.00/bulb 60 watt equivalent

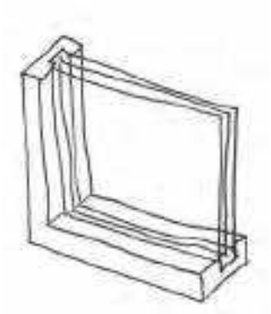

Triple glazed windows *not readily available*	**50%** more **$$** than double glazed windows	**20%** more **$$** than double glazed windows

Common practices now commonly used:

- lighting controls that adjust for occupancy and daylight
- heat recovery ventilation
- centralized energy monitoring and system controls

Energy reduction strategies are more available and more affordable

HMFH

GEOTHERMAL WATER-TO-WATER SOURCE SIMULTANEOUS HEATING/COOLING HEAT PUMP CHILLERS W/ HEAT RECOVERY PLANT



History of Chillers

50 + years: Water to Water Heat Pumps
30 years: Modular Chillers
About 20 years: Modular Chiller with Heat Recovery (Multistack)

Benefits

- High-efficiency
- Modular design provides level of redundancy & individual module control
- Heat recovery provides reheat during cooling season
- Durability & Reliability
- Service friendly w/ easy access to major components
- Fossil Fuel Free-Zero Combustion Design

Defining Variable Refrigerant Flow (VRF)

What is VRF?

- VRF is a modern Evolution of the Heat Pump Cycle
- The first practical heat pumps were invented in 1948
- VRF has been around since 1982

System Consists of:

- Roof or Ground Mounted Heat Pumps
- Ceiling Cassettes
- Concealed Fancoil Units
- Refrigeration Piping w/Branch Controllers
- Energy Recovery Units for Ventilation

System Provides:

- Simultaneous Heating & Cooling
- Individual Space Temperature Control
- Built-in Redundancy through the use of multiple compressors



Defining Environmental Justice

Senate Bill S.9: *An Act creating a next-generation roadmap for Massachusetts climate policy*

- Environmental Justice Population
- Environmental Justice Principles
- Environmental Burden
- Environmental Benefit



Building Architecture as New Technology

Hosmer

Exterior Rendering



View from the corner of Concord Road and Chauncey Street

Hosmer

Interior Rendering



View from the second floor overlook of the Lower Learning Commons

Cunniff

Exterior Rendering



View from Warren Street

Cunniff

Interior Rendering



View of the interior educational environment with collaborative corridors

Hosmer


Interior Rendering




View of typical classroom in Hosmer, with cloud ceilings & exposed beams

Resultant Energy Use Intensity (EUI)

Cunniff & Hosmer Elementary Schools • Watertown, MA

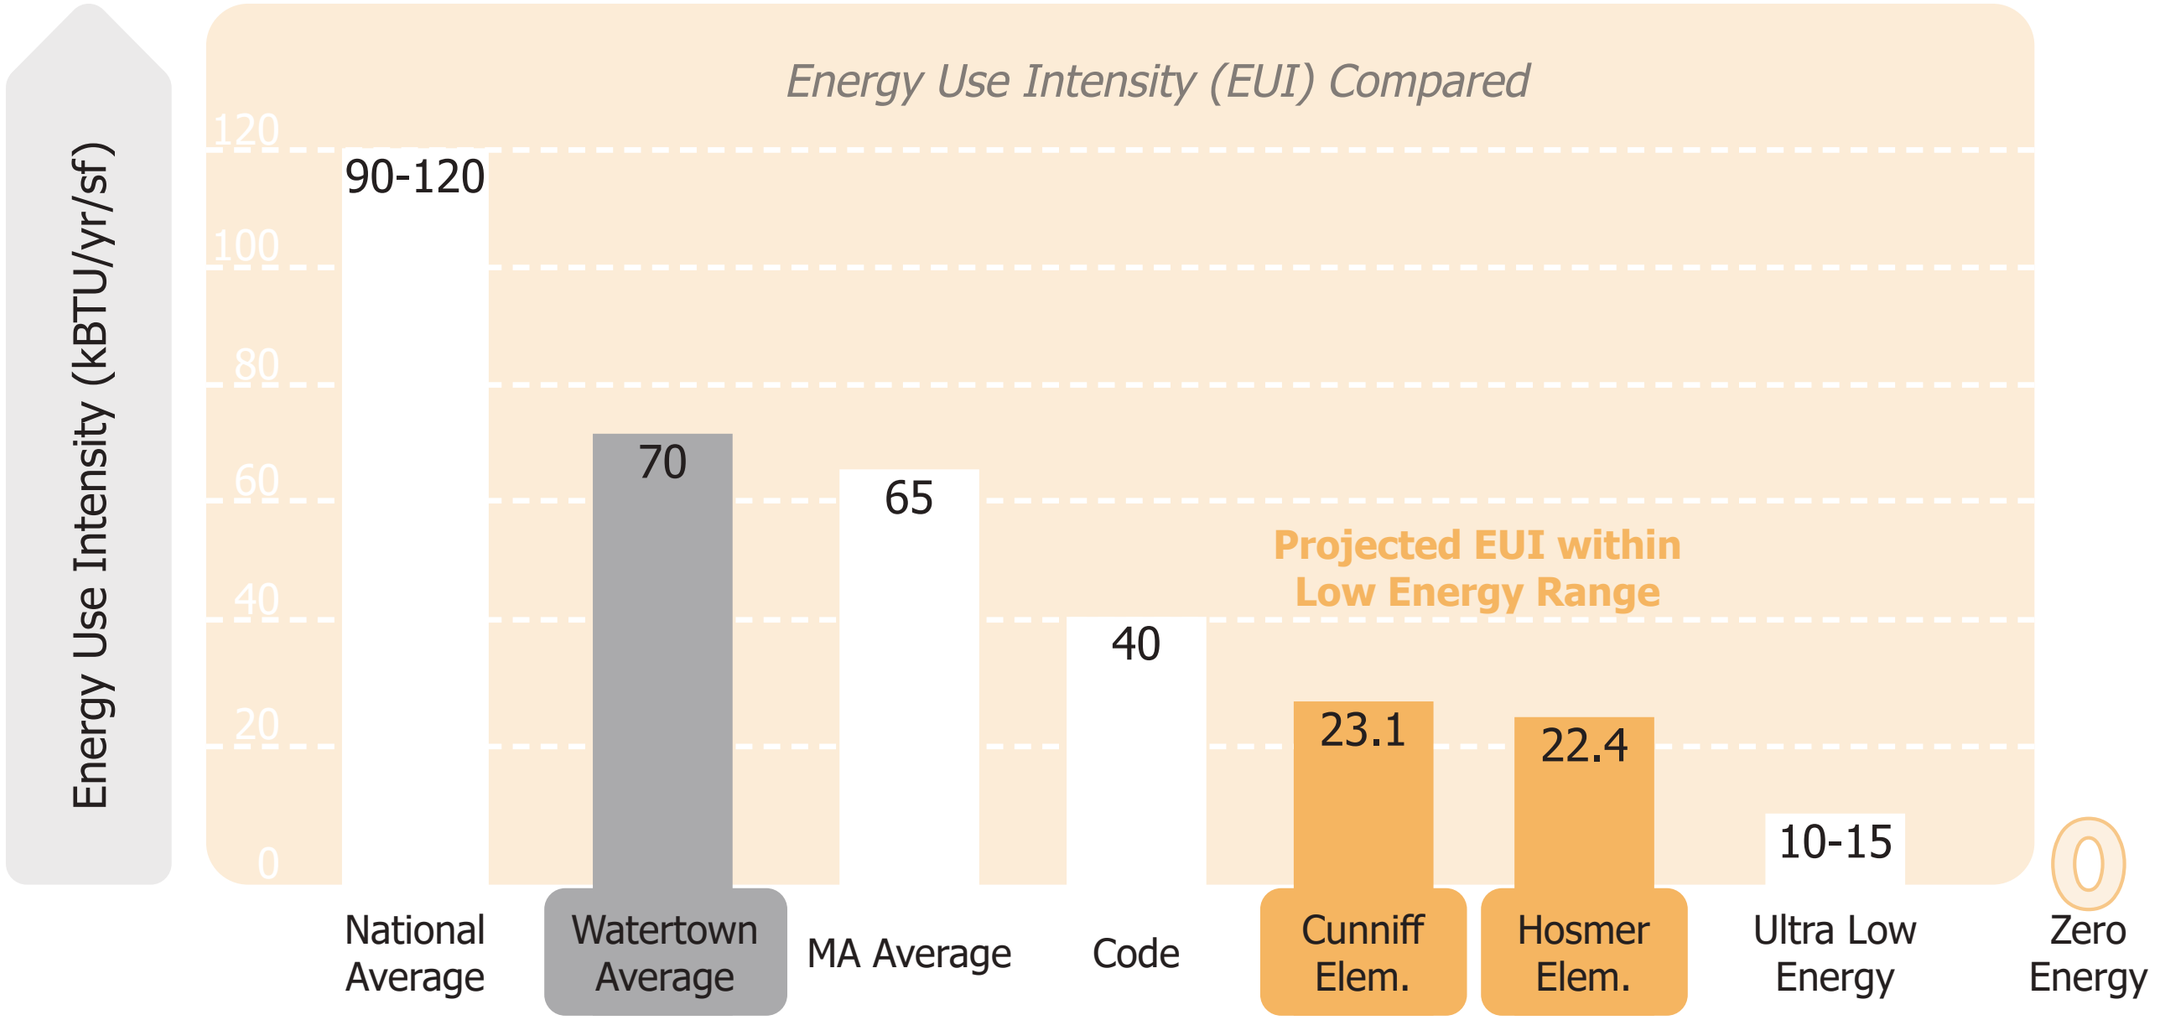

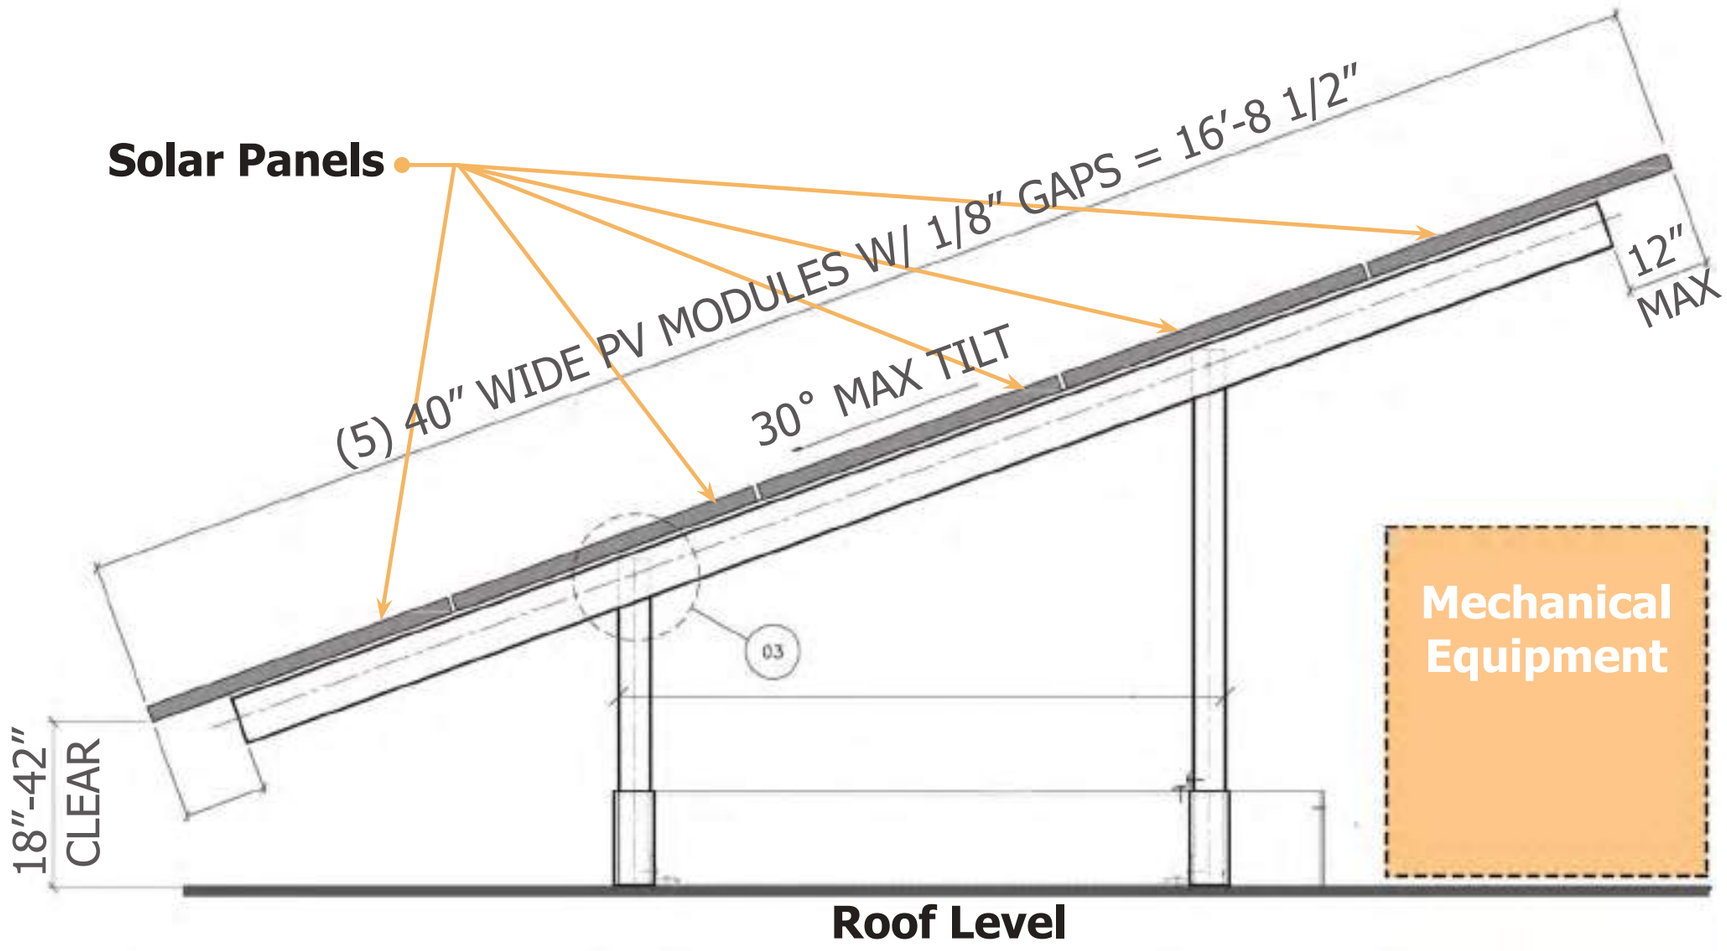

Elevated Solar Panel framing to reduce heat gain & clear equipment




VRF on Hosmer's roof

design FIRST

Optimize Building to Reduce Energy Use

- o orientation
- o window to wall ratio

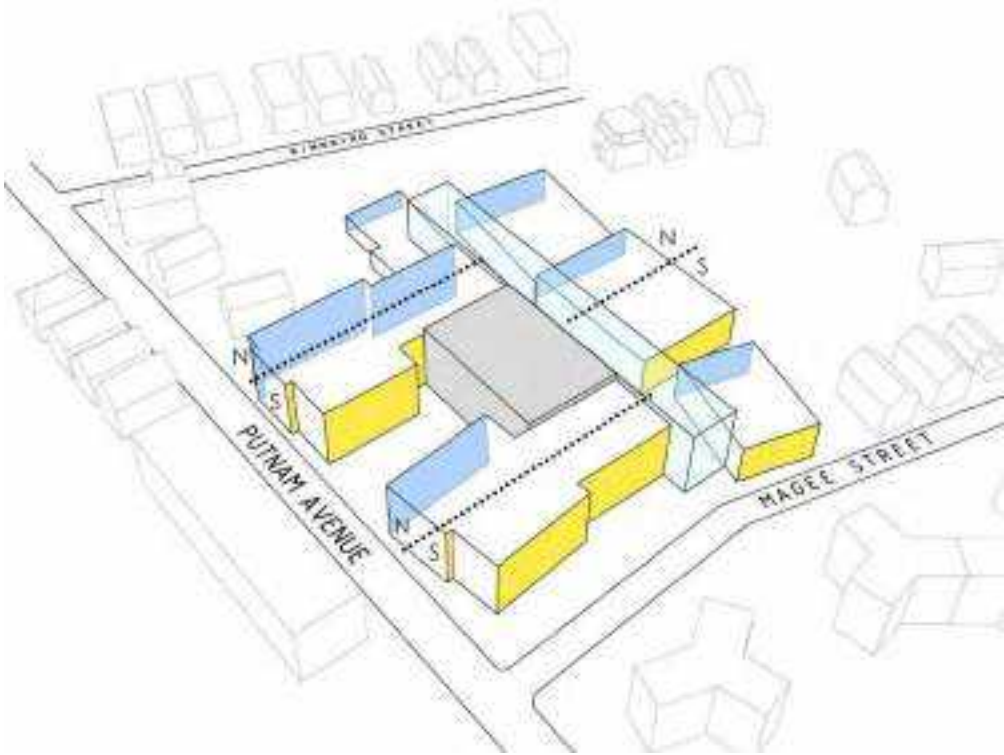


Graphics courtesy of Perkins Eastman

design FIRST

Optimize Building to Reduce Energy Use

- passive systems
  - insulation & weather barriers

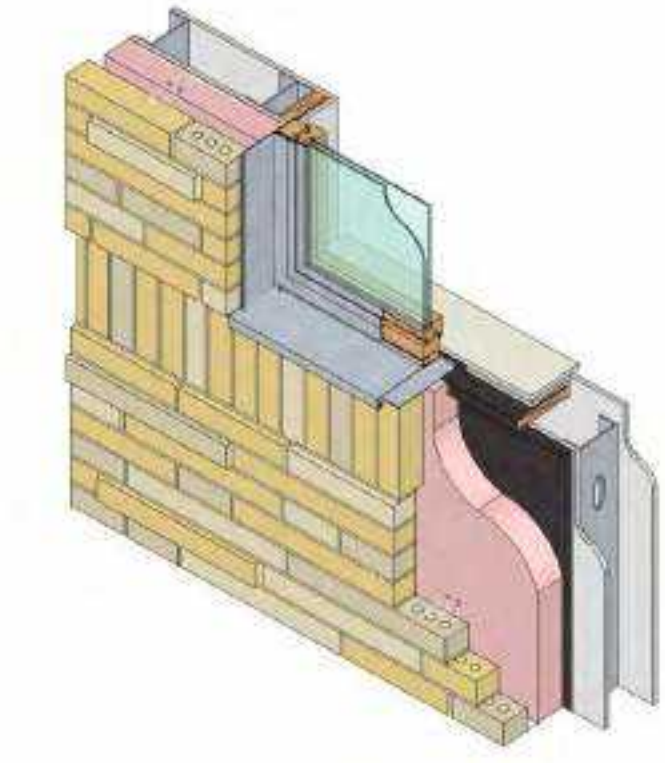


Graphics courtesy of Perkins Eastman

design FIRST

Optimize Building to Reduce Energy Use

- passive systems
  - insulation & weather barriers
  - sunshades & light shelves

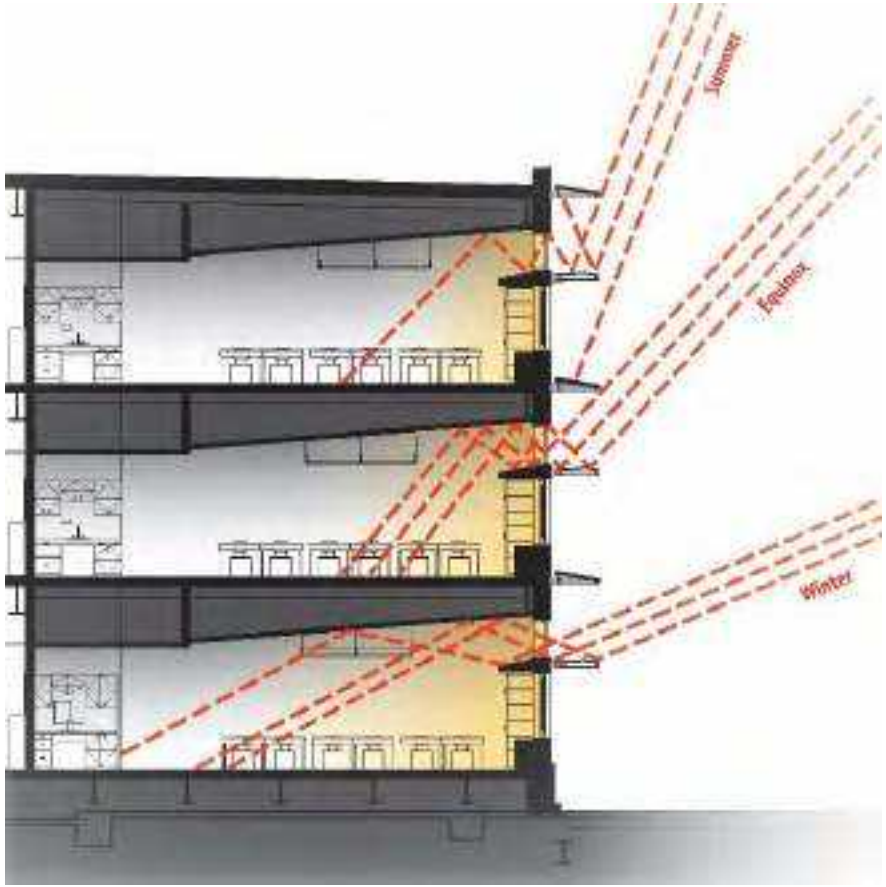


Graphics courtesy of Perkins Eastman

design FIRST

Optimize Building to Reduce Energy Use

- zone building by use

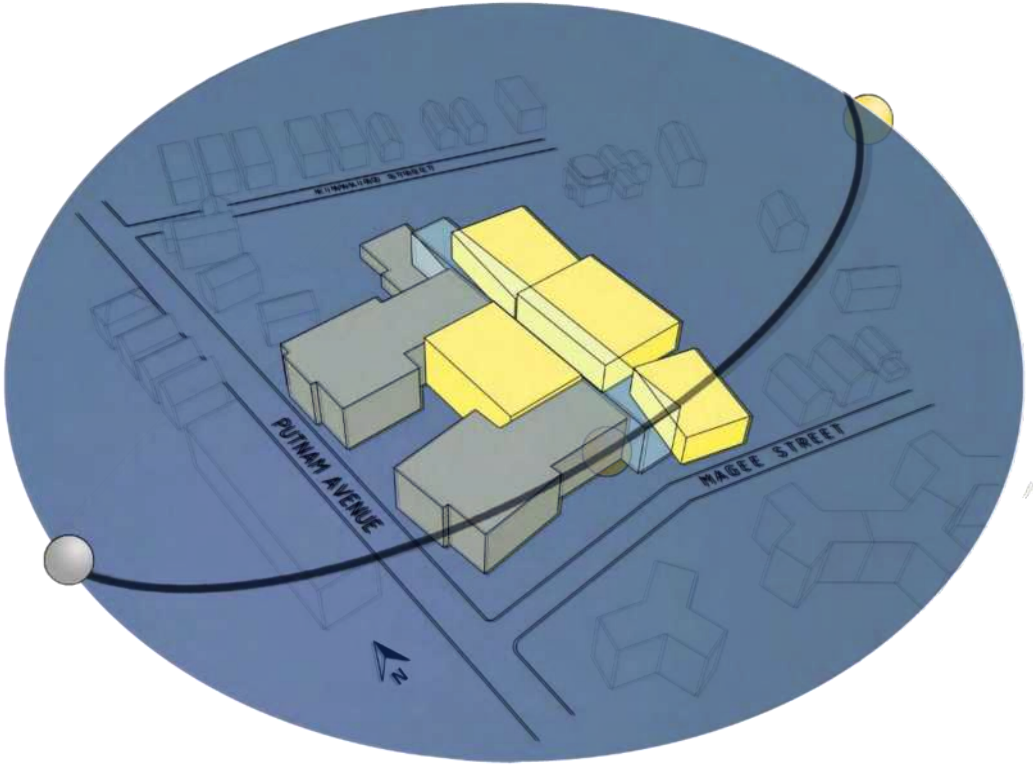


Graphics courtesy of Perkins Eastman

systems SECOND

Use Energy Efficiently

- o “right-sized” efficient systems
- o controls & sensors
- o schedules & “off”
- o commissioning & maintenance

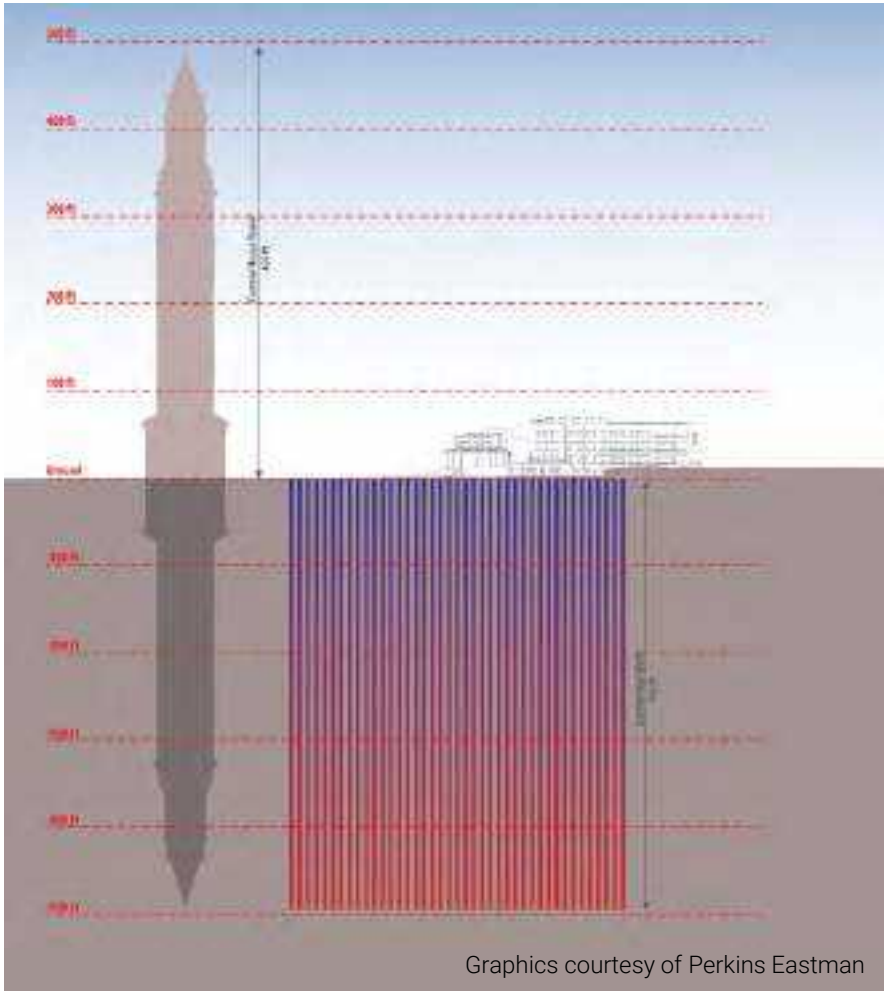

Graphics courtesy of Perkins Eastman


EXPERIENCE
DLR Group
Architecture Engineering Planning Interiors

Mayor Martin J. Walsh

BOSTON Public Schools

MSBA

Josiah Quincy Upper School

May 26, 2021

HMFH ARCHITECTS

JQUS Context Perspective



HMFH

View - Main Entrance at Washington Street



CLOSER LOOK AT SOLAR

KING OPEN
PV




KING OPEN
FACADE MOUNTED PV







DOUGLAS & GATES SCHOOL
SITE SYSTEMS

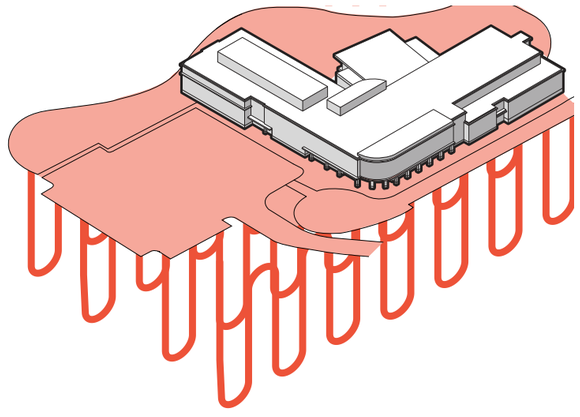


GEOTHERMAL HEATING & COOLING

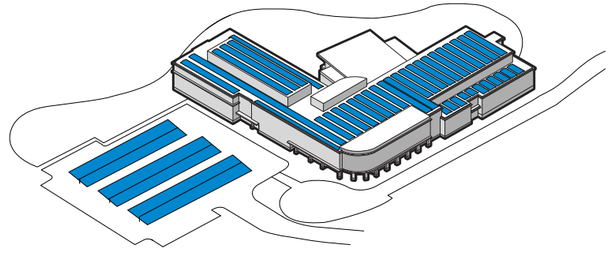

PV & BATTERY STORAGE

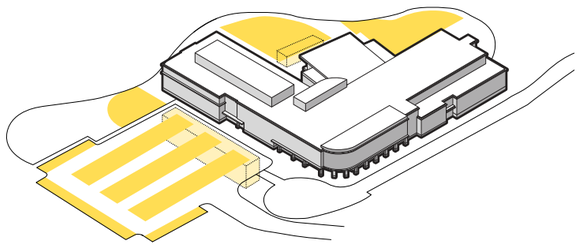

STORMWATER RETENTION & INFILTRATION

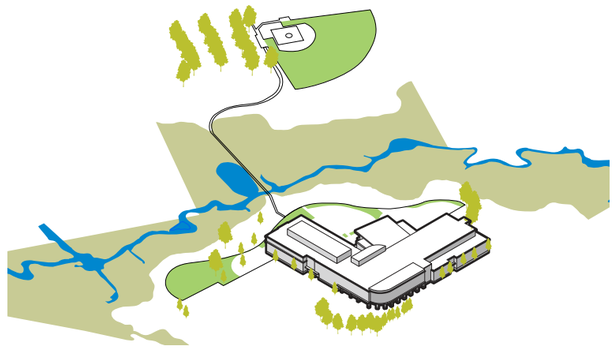

RAINWATER HARVESTING

ARROWSTREET

DOUGLAS & GATES SCHOOL
PV & BATTERY STORAGE



Arrowstreet











PHOTOVOLTAIC SOLAR ARRAY SYSTEM (PV)

- Roof Mounted System
- Actual Size: 1,324 kWdc
- Estimated kWH generated: 1,318,000
- Complete Roof coverage
- Mechanical equipment located in roof wells with PV above

Closer Look at Solar

Hosmer Building & Site PV



- Building Array = 42% of PV
- Site Array = 58% of PV
- Total # of PV panels = 1,920

N

Cunniff Building & Site PV




- Building Array = 44% of PV
- Site Array = 56% of PV
- Total # of PV panels = 1,169

N

Shelters cars, visitors, and reduces heat of pavement



Structural drawing of custom designed site solar canopy

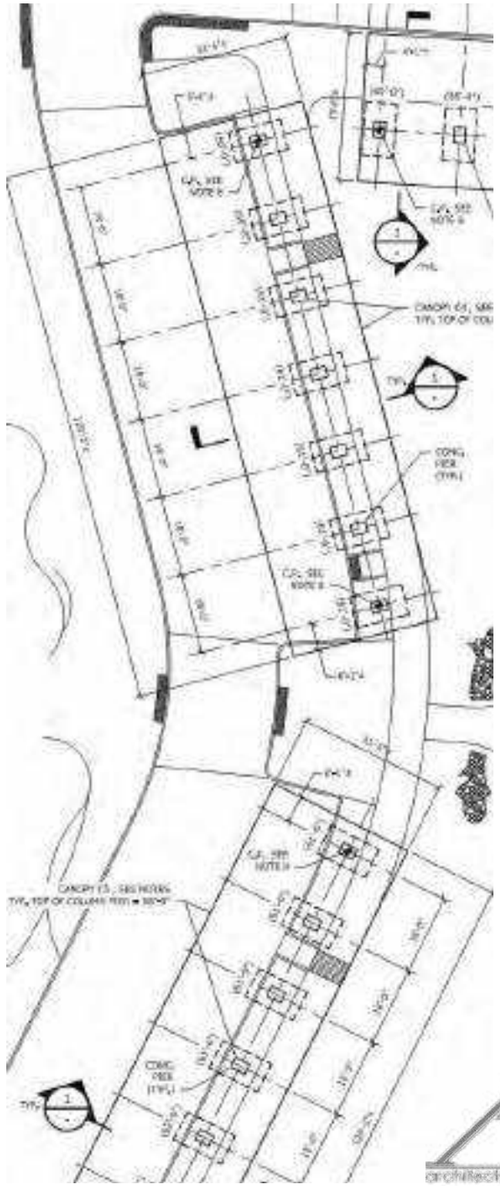

Solar canopies flanking parking

Cunniff

Solar Canopies




Installation of Cunniff solar canopy frames


Josiah Quincy Upper School

HMFH ARCHITECTS

PV Arrays at Roof

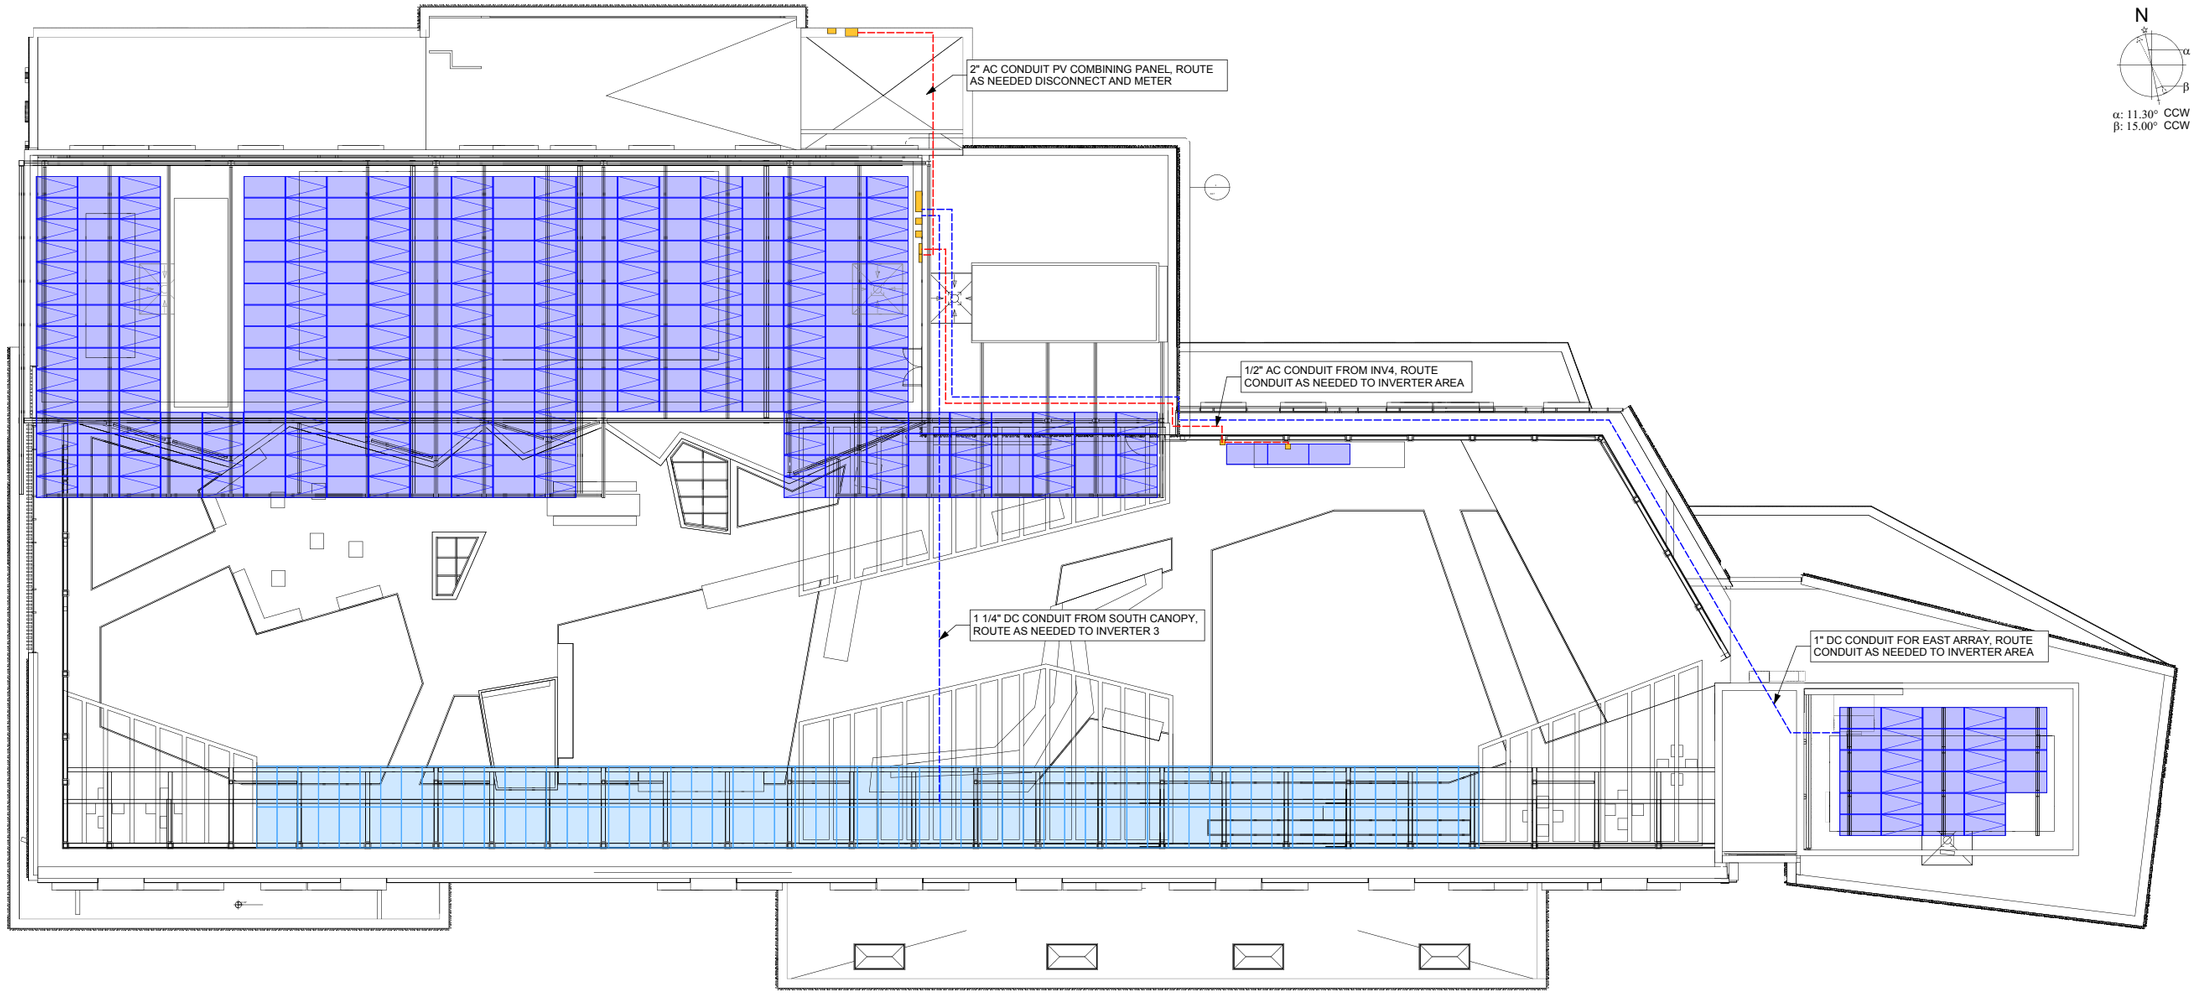

PV Arrays at Roof

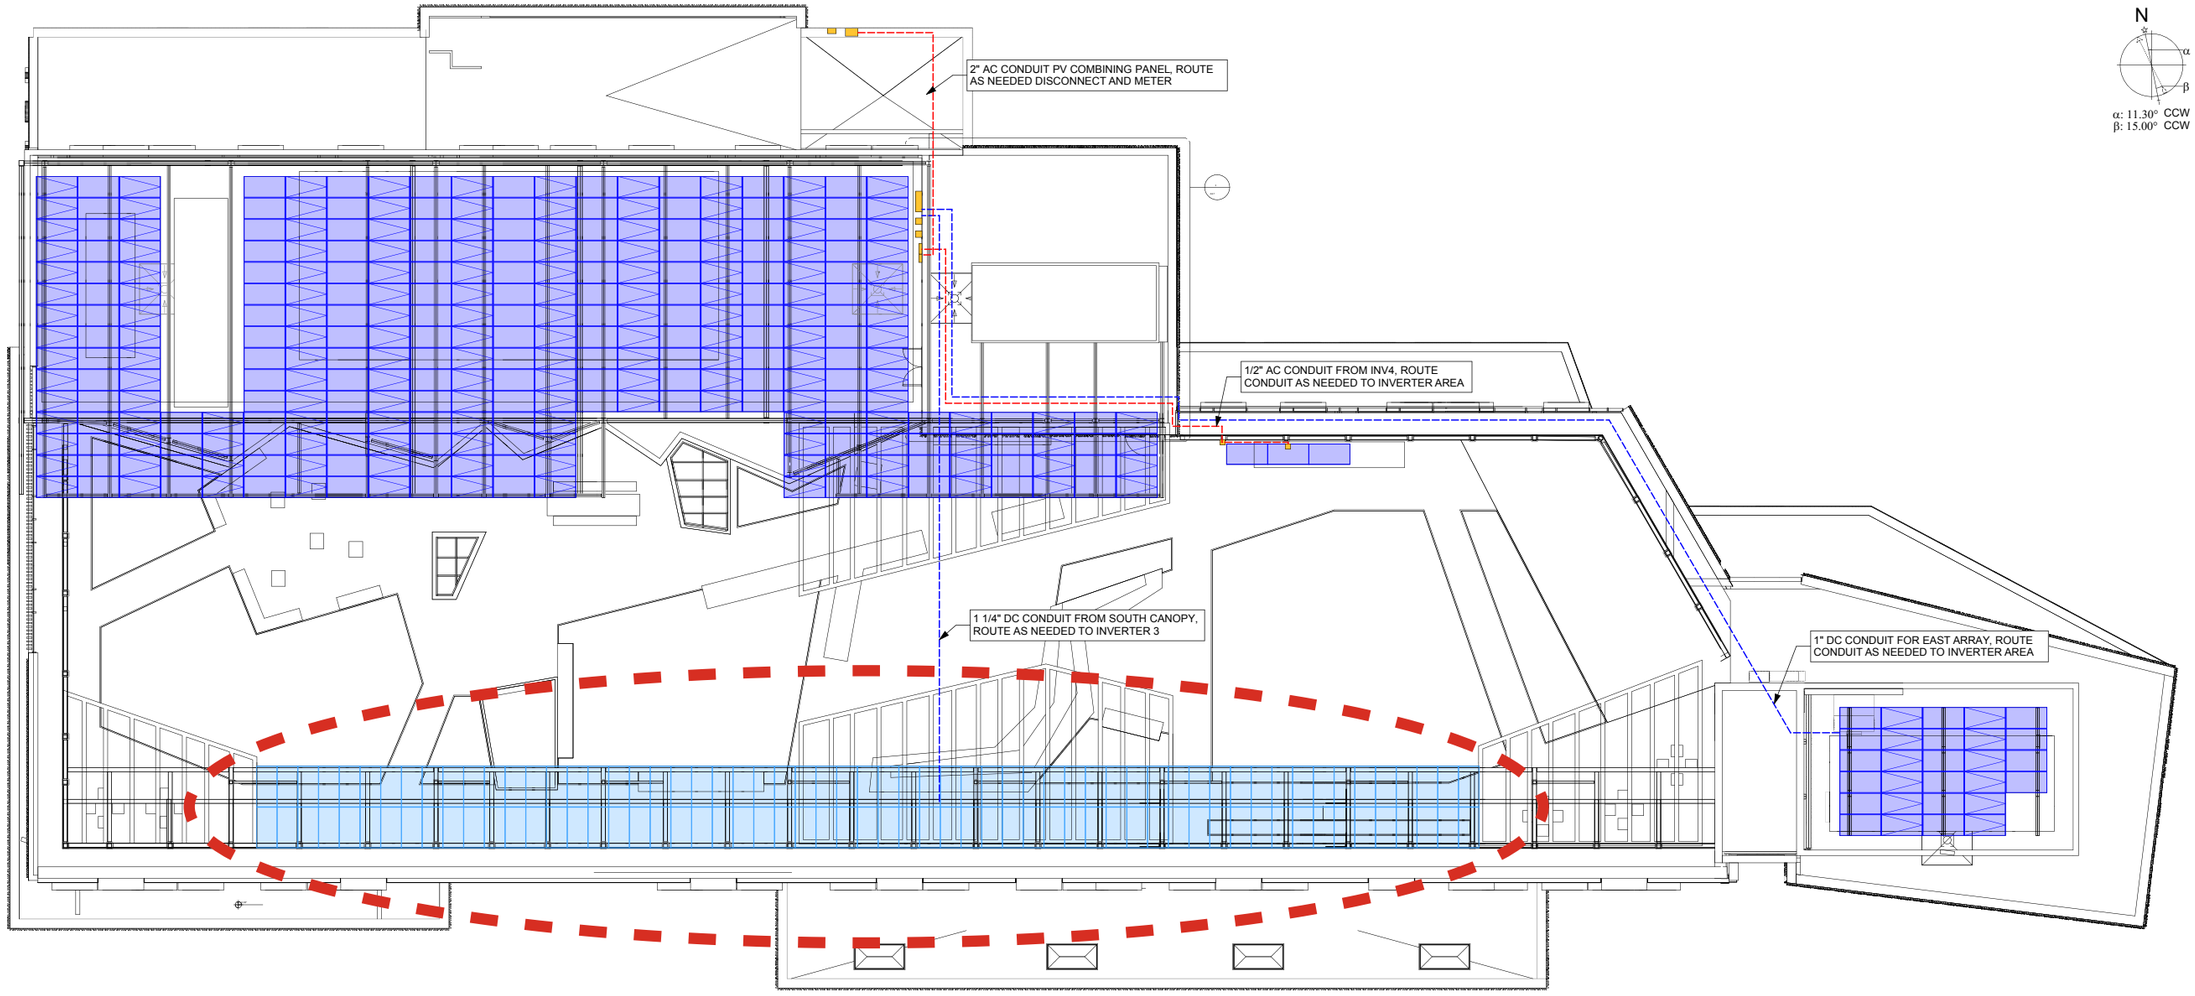

PV Array removed due to cost

JQUS Educational Rooftop









Outdoor Classroom



Outdoor Classroom





PV Arrays at Roof




Fales Elementary School

Building Area: **70,000 GSF**
Roof Area: **40,000 SF**
Solar Array: **25,000 SF**

EUI = **24.9**
EPI = **31.1**
Net EUI = **6.2** Excess Energy

- Positive Energy Production
- Credit for Excess Energy Applied to other District Schools



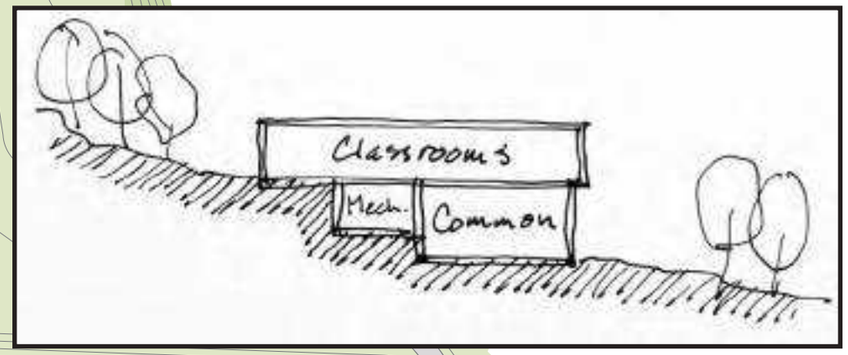

HMFH

Fales Elementary School




HMFH

Fales Elementary School




HMFH


HVAC SYSTEM OPTIONS

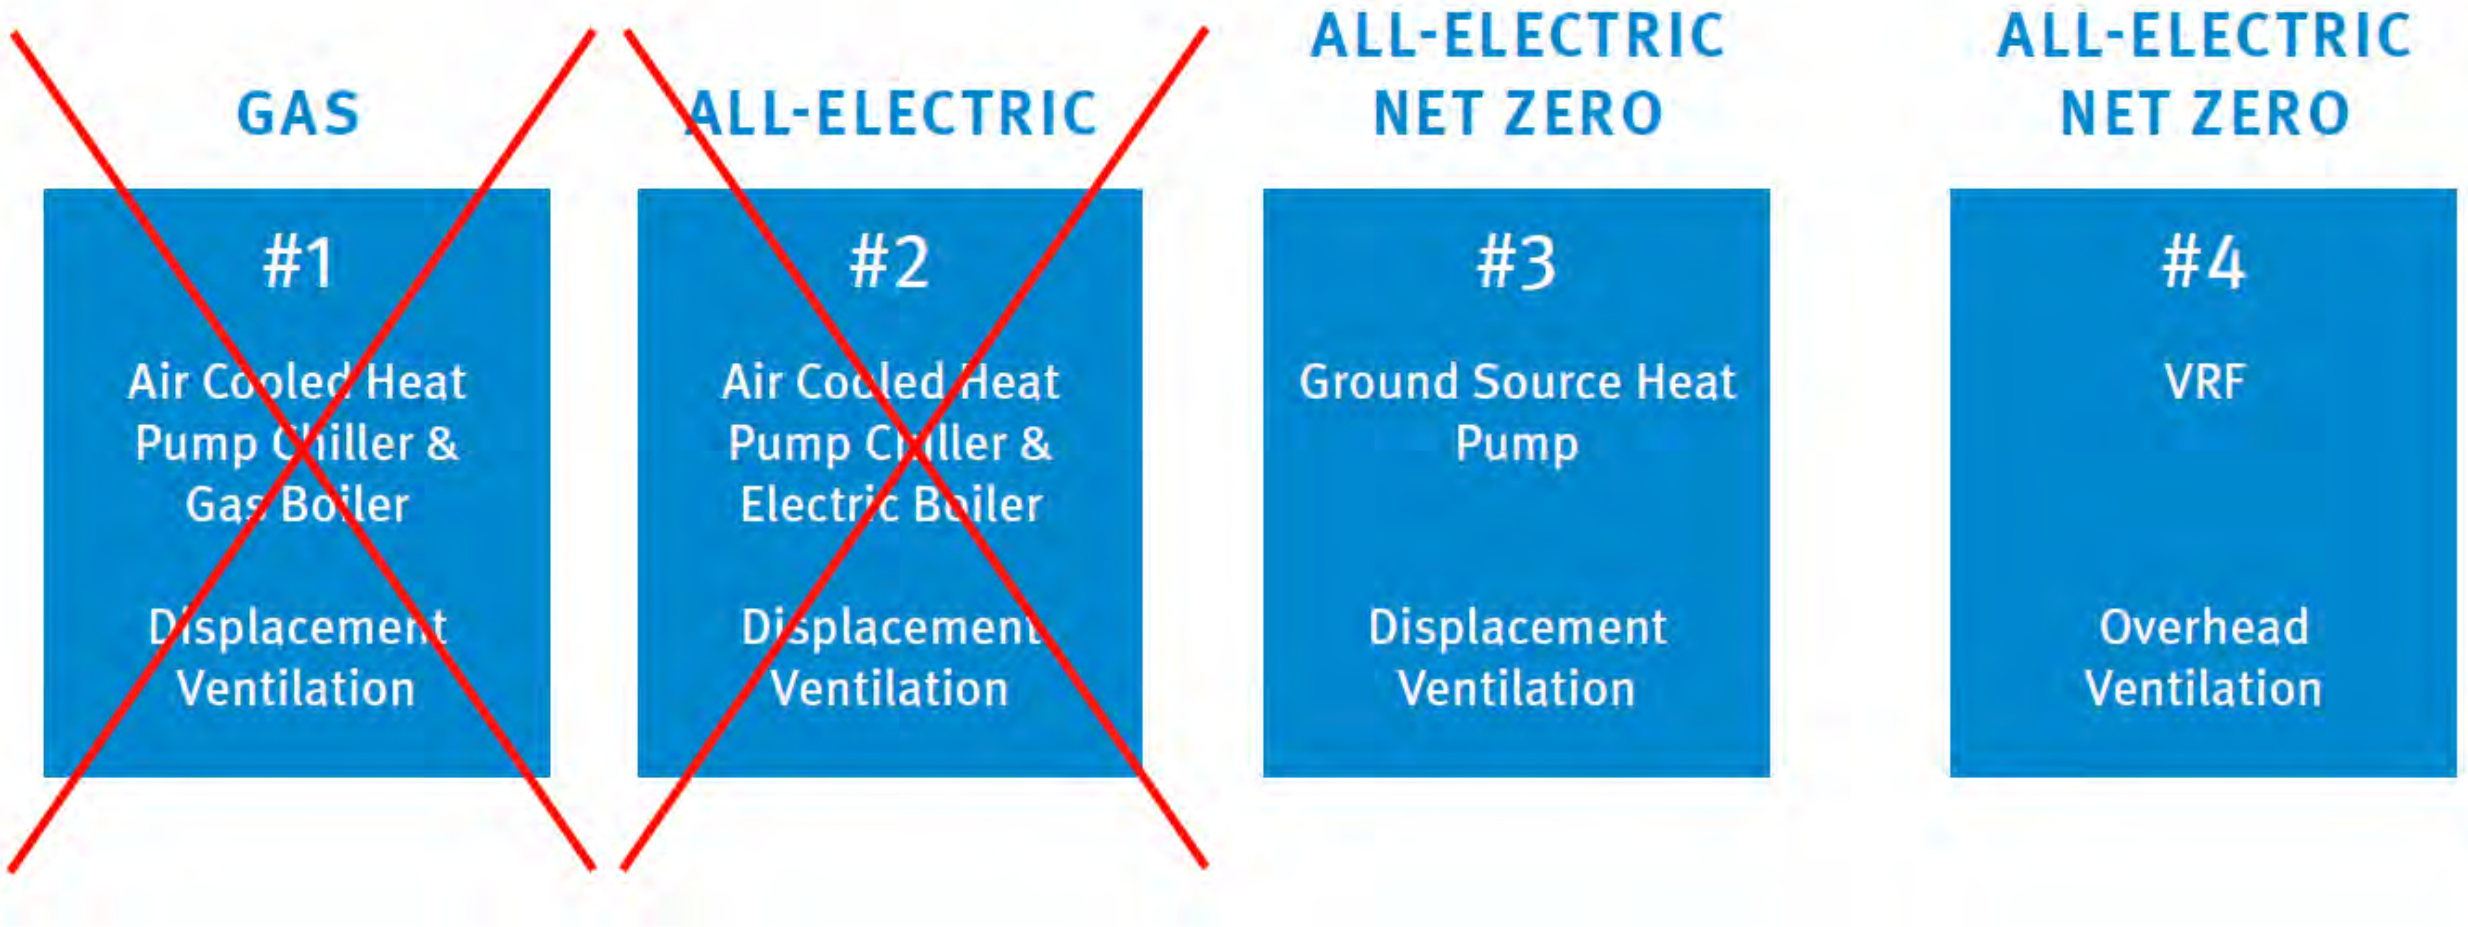

EFFICIENCY & SUSTAINABILITY ADVANTAGES with VRF

- No Fossil Fuels Consumed at School
- Designed for Net Zero Potential
- 40% - 50% efficiency improvement over standard rooftop units complying with ASHRAE 90.1
- Recent project has achieved an ***EUI of 22.4*** using VRF
- Simultaneous Heating & Cooling
- Multiple inverter driven compressors provide built in redundancy and match building loads more closely optimizing energy efficiency
- Excellent Flexibility
- Lower overall operation and maintenance cost w/smaller easier to maintain equipment
- No requirement for large mechanical rooms
- Smaller ductwork systems reduce ceiling, shaft and floor space requirements allowing more space for program needs
- No pumping systems to maintain
- No requirement for annual chemical treatment
- System aligned with the goals of the recently enacted Climate Bill
- Construction cost on par with conventional HVAC systems ***and lower*** than ground source/geothermal heat pump projects

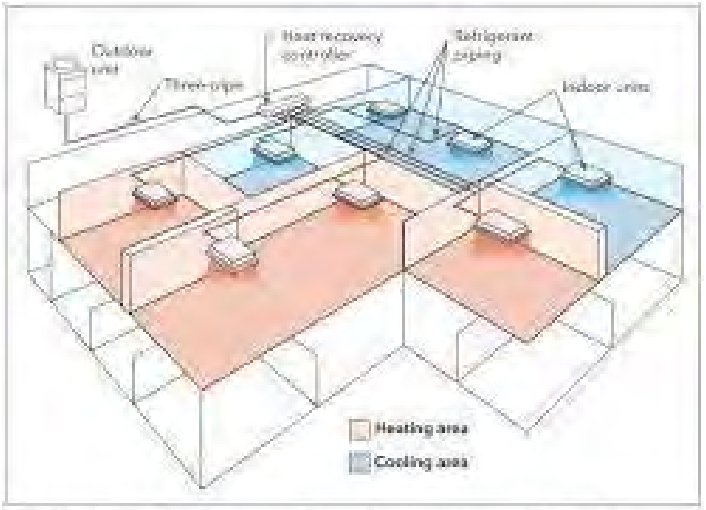


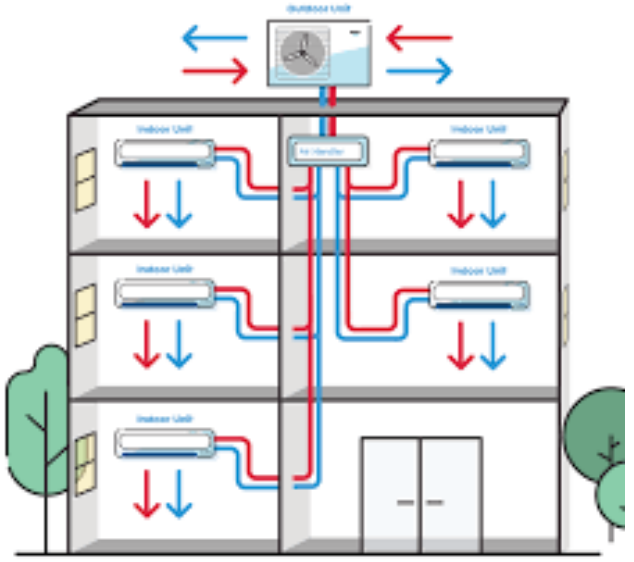

DEFINING GEOTHERMAL SYSTEM

Ground Source Closed-Loop Geothermal

Pulls energy from below the earth's surface and provides hot water to air-handling equipment.

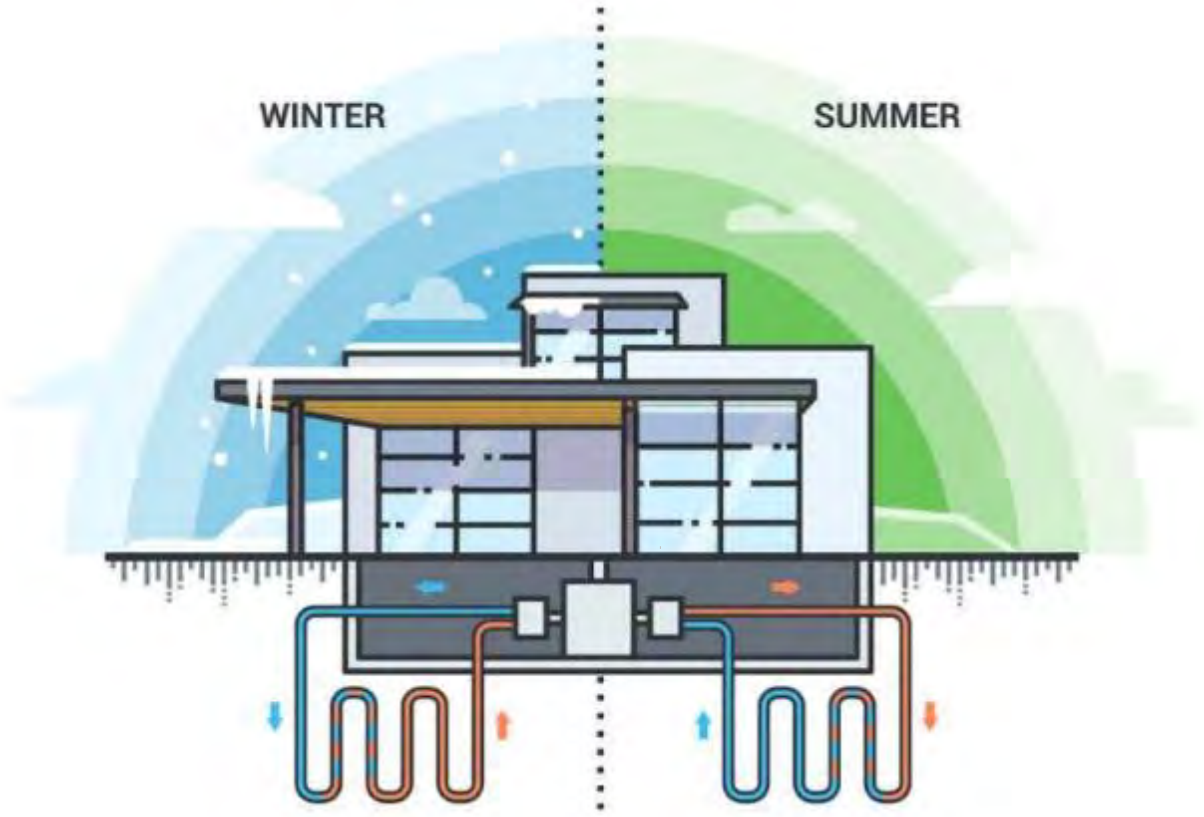

FOSSIL FUEL FREE

PROS AND CONS (VS. VRF)

PROS

Quiet Operation, no exterior equipment

Provides simultaneous heating and cooling

Longevity of equipment and ease of maintenance with indoor equipment

High efficiency in both heating and cooling modes

Built-in redundancy with modular Construction

Provides 130 degree hot water for domestic

CONS (VS. VRF)


Higher capital cost due to closed loop wells

Additional pumping required for source, heating and cooling loops

Compressor replacement every 15-20 years



Geothermal System - Quad Well U-bend

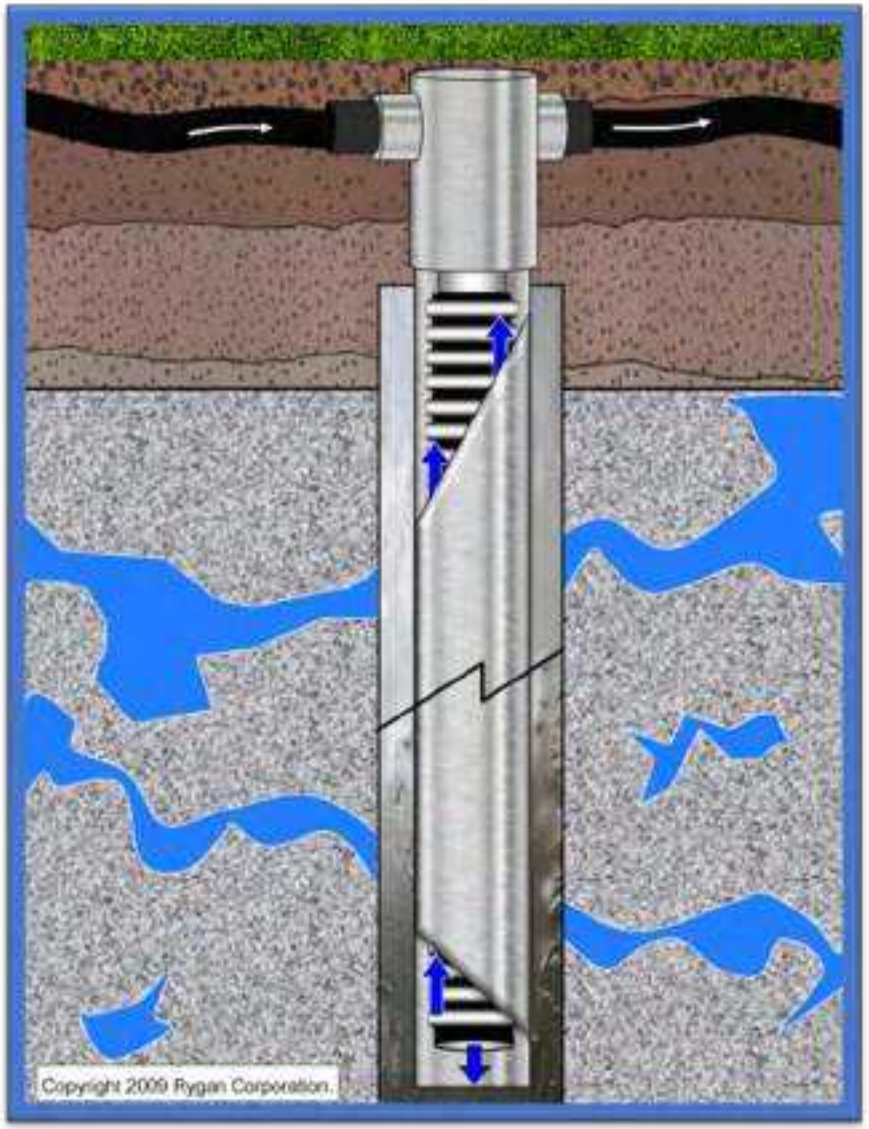


High Performance Geothermal Exchange (HPGX) - Rygan



TESLA MEGAPACK LIGHT

(14) BIDIRECTIONAL INVERTER 71.5kVA
1001kW, 480VAC
(12) BATTERY MODULES 84.3kW
1001kW/2023.2kWh STORAGE SYSTEM

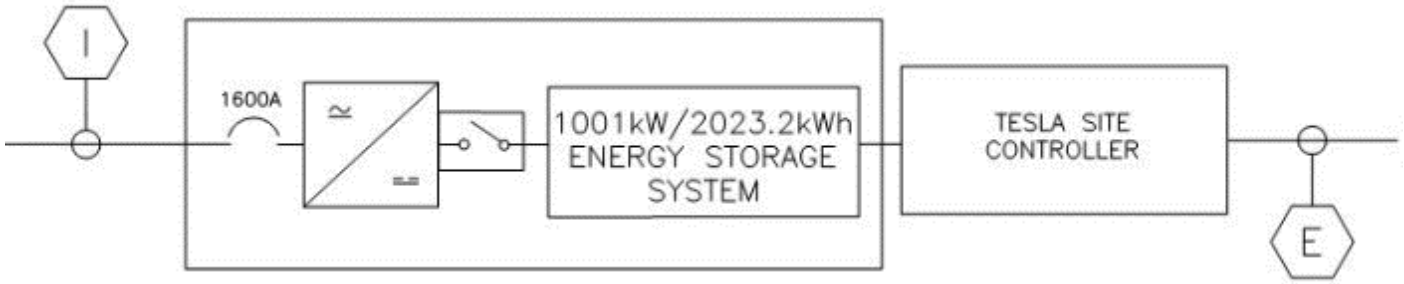

BATTERY ENERGY STORAGE SYSTEMS

- Energy produced is stored and used when required
- Does not emit any CO2 emissions
- Includes Lithium Ion
- Cost effective energy on demand
- Used for wind, solar, and electric vehicle charging infrastructure
- Generally sized for two-four hours at full load including building freeze protection

HVAC SYSTEM COMPARISONS

Code Compliant System:
- International Energy Conservation Code (2018 IECC)
- Classroom Unit Ventilators
- Gas Fired Boilers
- Packaged Rooftop Units
- Will not achieve LEED certification
- Cost: $37.00/sq.ft.



LEED Project:
- 2018 IECC
- ASHRAE 90.1 2013 (LEED v.4 requirement)
- Variable Air Volume System and/or Chilled Beams
- Rooftop Energy Recovery Units
- High Efficiency Gas Fired Condensing Boilers
- Large Ductwork Distribution System
- Cost: $38.00/sq.ft. (VAV) & $43.00 (Chilled Beam)



LEED Certified, Net Zero Project:
- Helps meet goal of exceeding 2018 IECC by 20%
- Variable Refrigerant Flow System (VRF)
- Energy Recovery Units for Ventilation
- Small ductwork distribution system for ventilation air
- Quiet, efficient, simple
- ***Can help schools achieve an EUI of 25 or below***
- Cost: $39.00/sq.ft.



PAYING OVER TIME

HVAC SYSTEM OPTIONS

GAS

#1

Air Cooled Heat Pump Chiller & Gas Boiler

Displacement Ventilation

ALL-ELECTRIC

#2

Air Cooled Heat Pump Chiller & Electric Boiler

Displacement Ventilation

ALL-ELECTRIC NET ZERO

#3

Ground Source Heat Pump

Displacement Ventilation

ALL-ELECTRIC NET ZERO


#4

VRF

Overhead Ventilation


ANNUAL SAVINGS vs. DEBT SERVICE

#3 GROUND SOURCE HEAT PUMP vs. #1 GAS BOILER

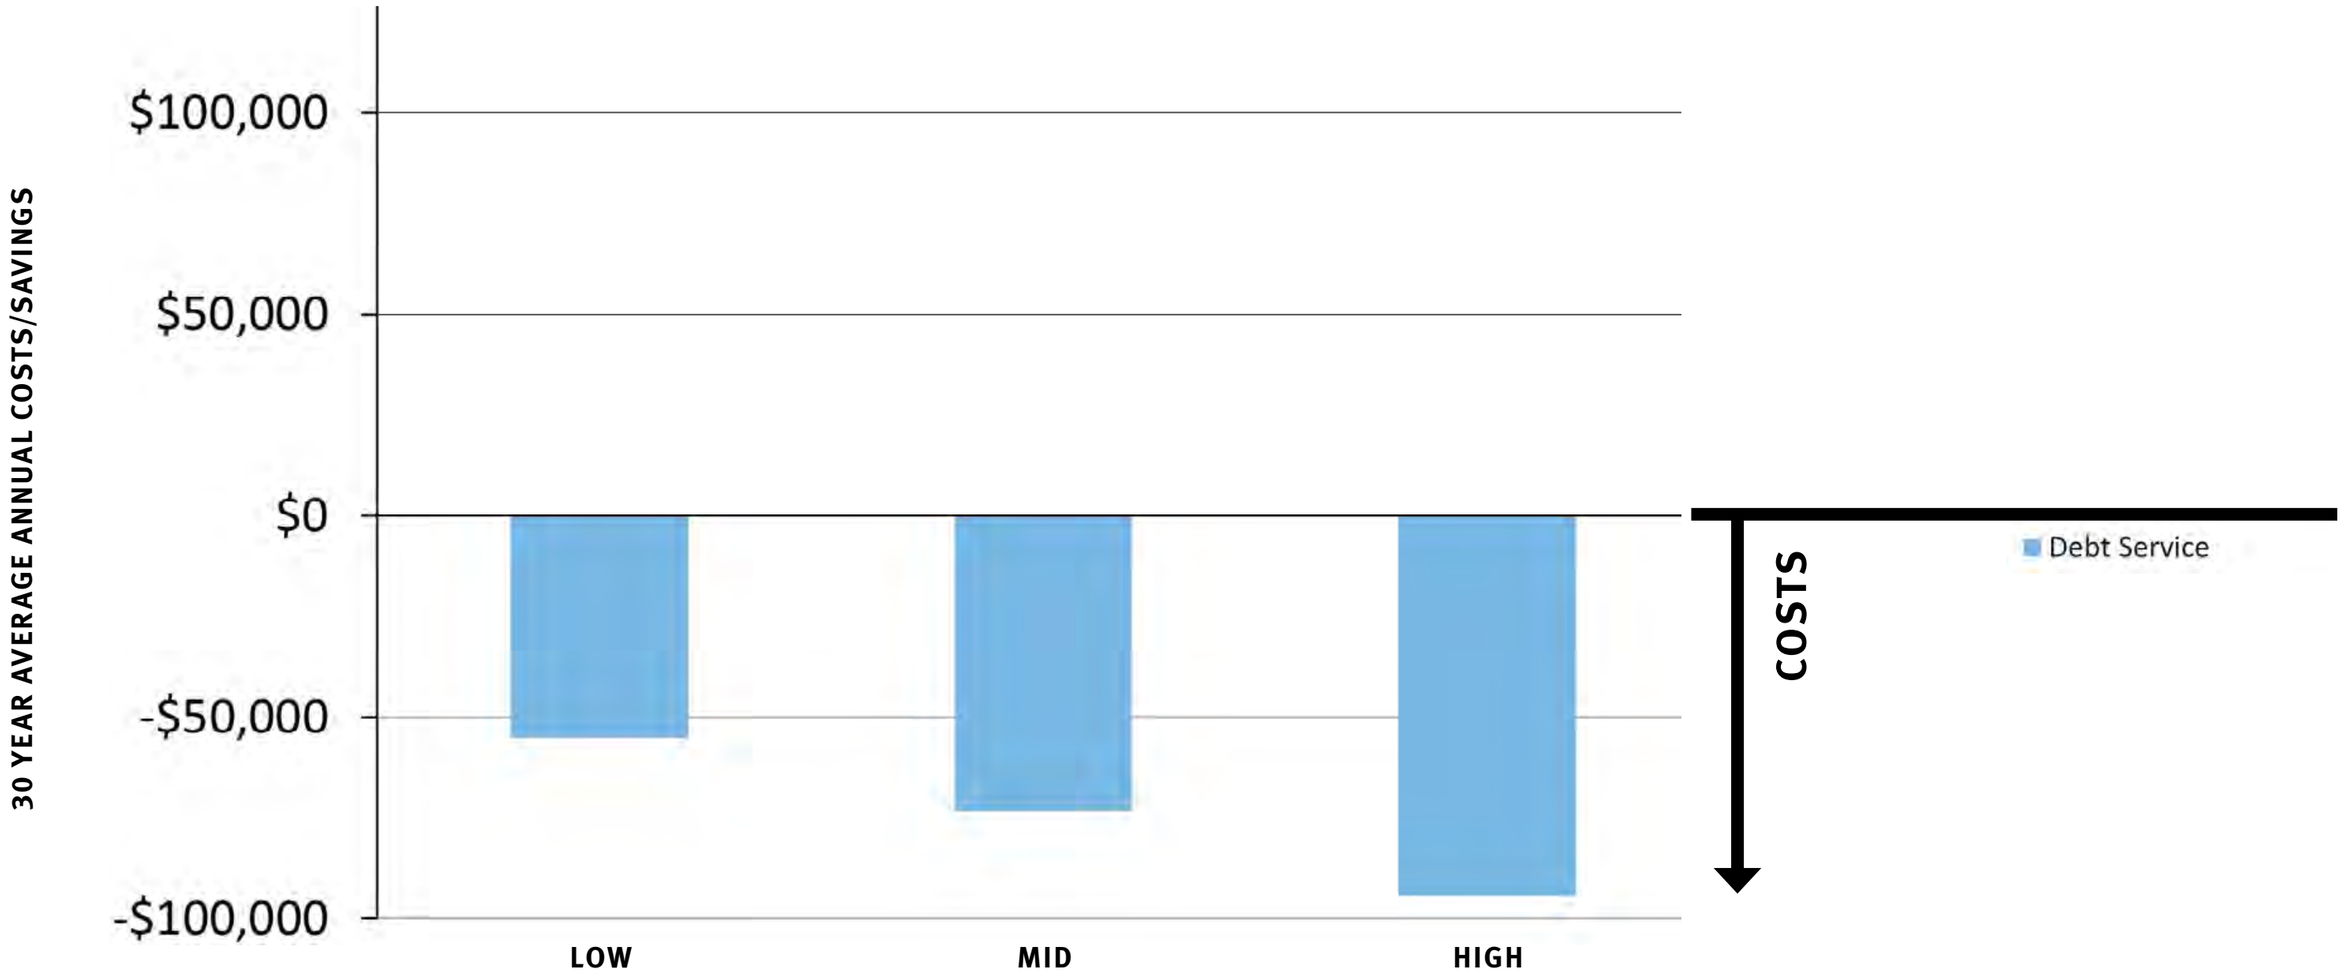


ANNUAL SAVINGS vs. DEBT SERVICE

#3 GROUND SOURCE HEAT PUMP vs. #1 GAS BOILER

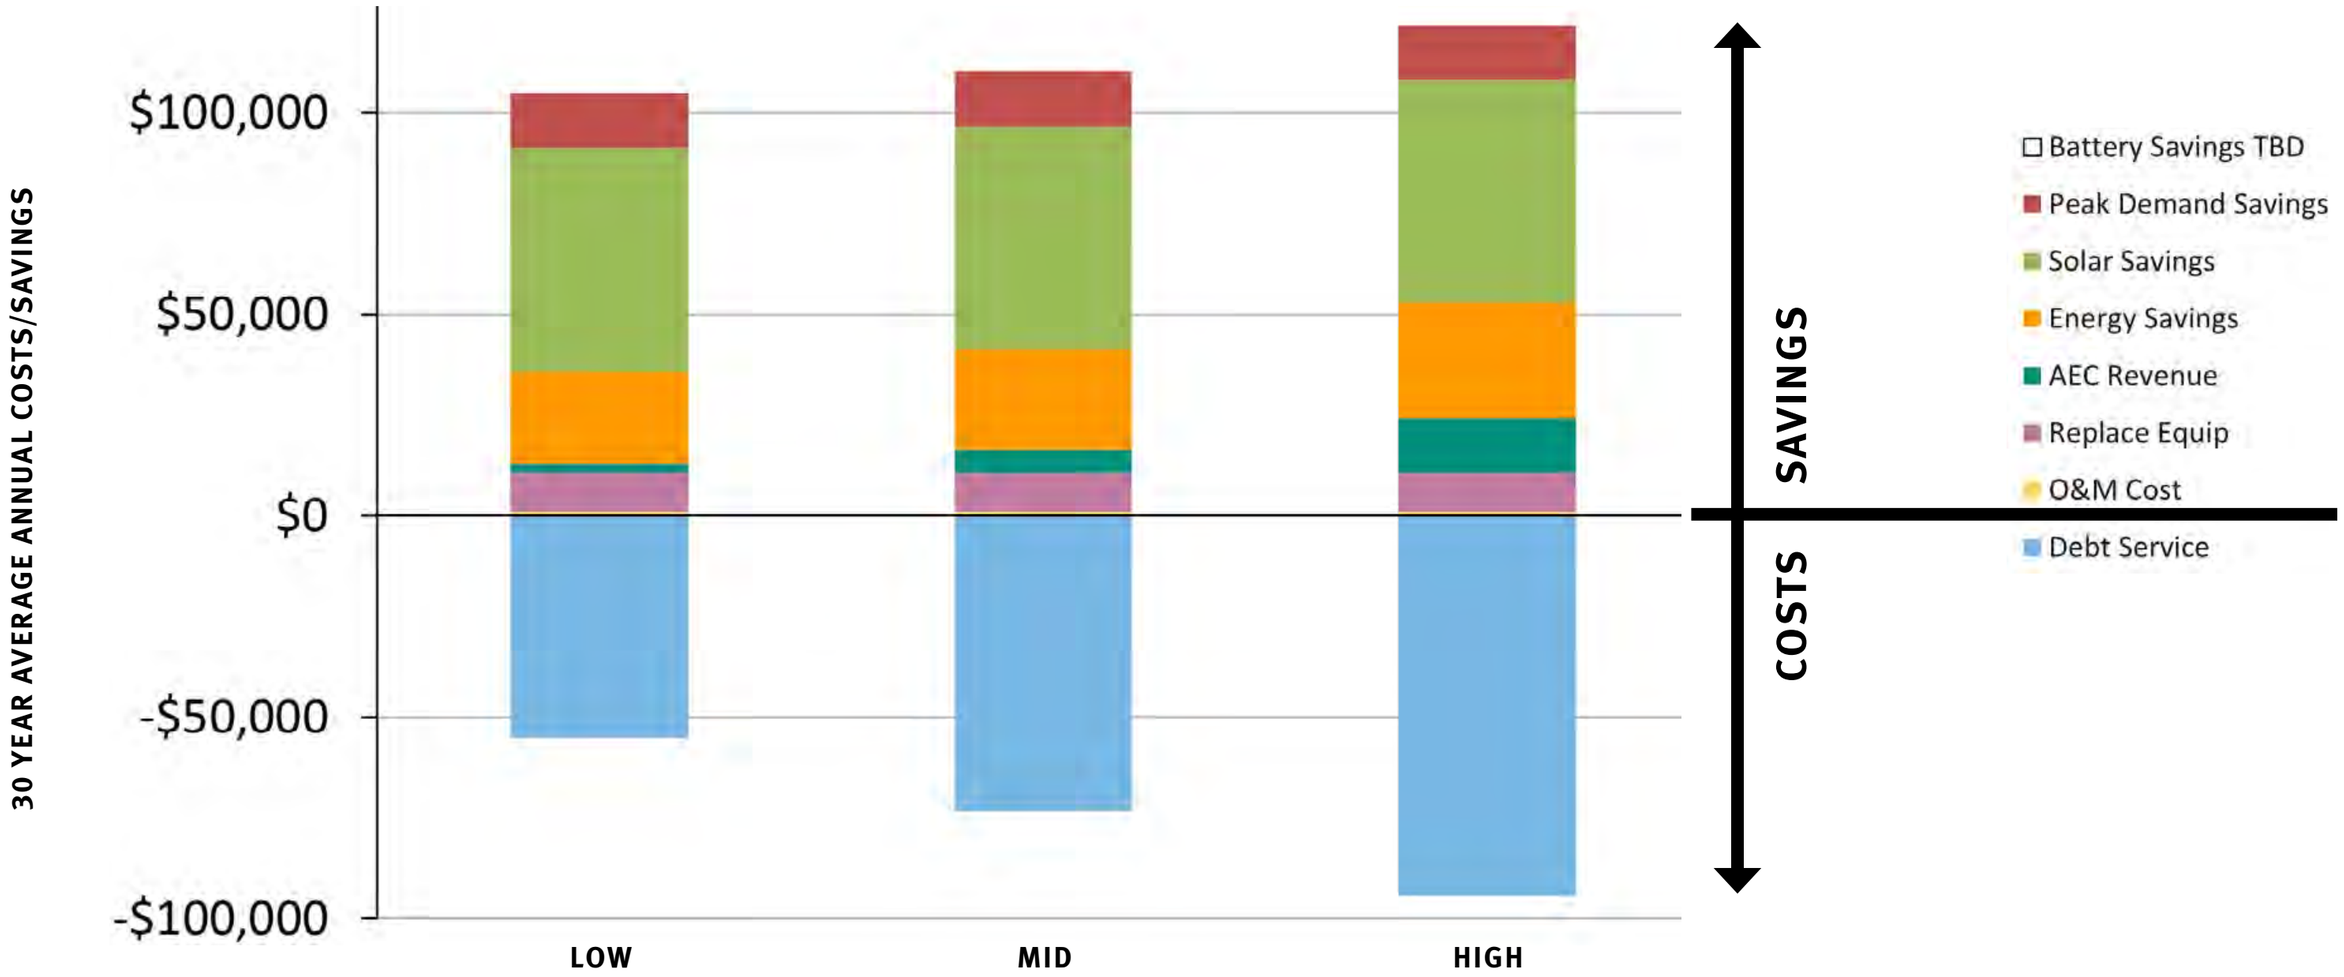

ANNUAL SAVINGS vs. DEBT SERVICE


#3 GROUND SOURCE HEAT PUMP vs. #1 GAS BOILER

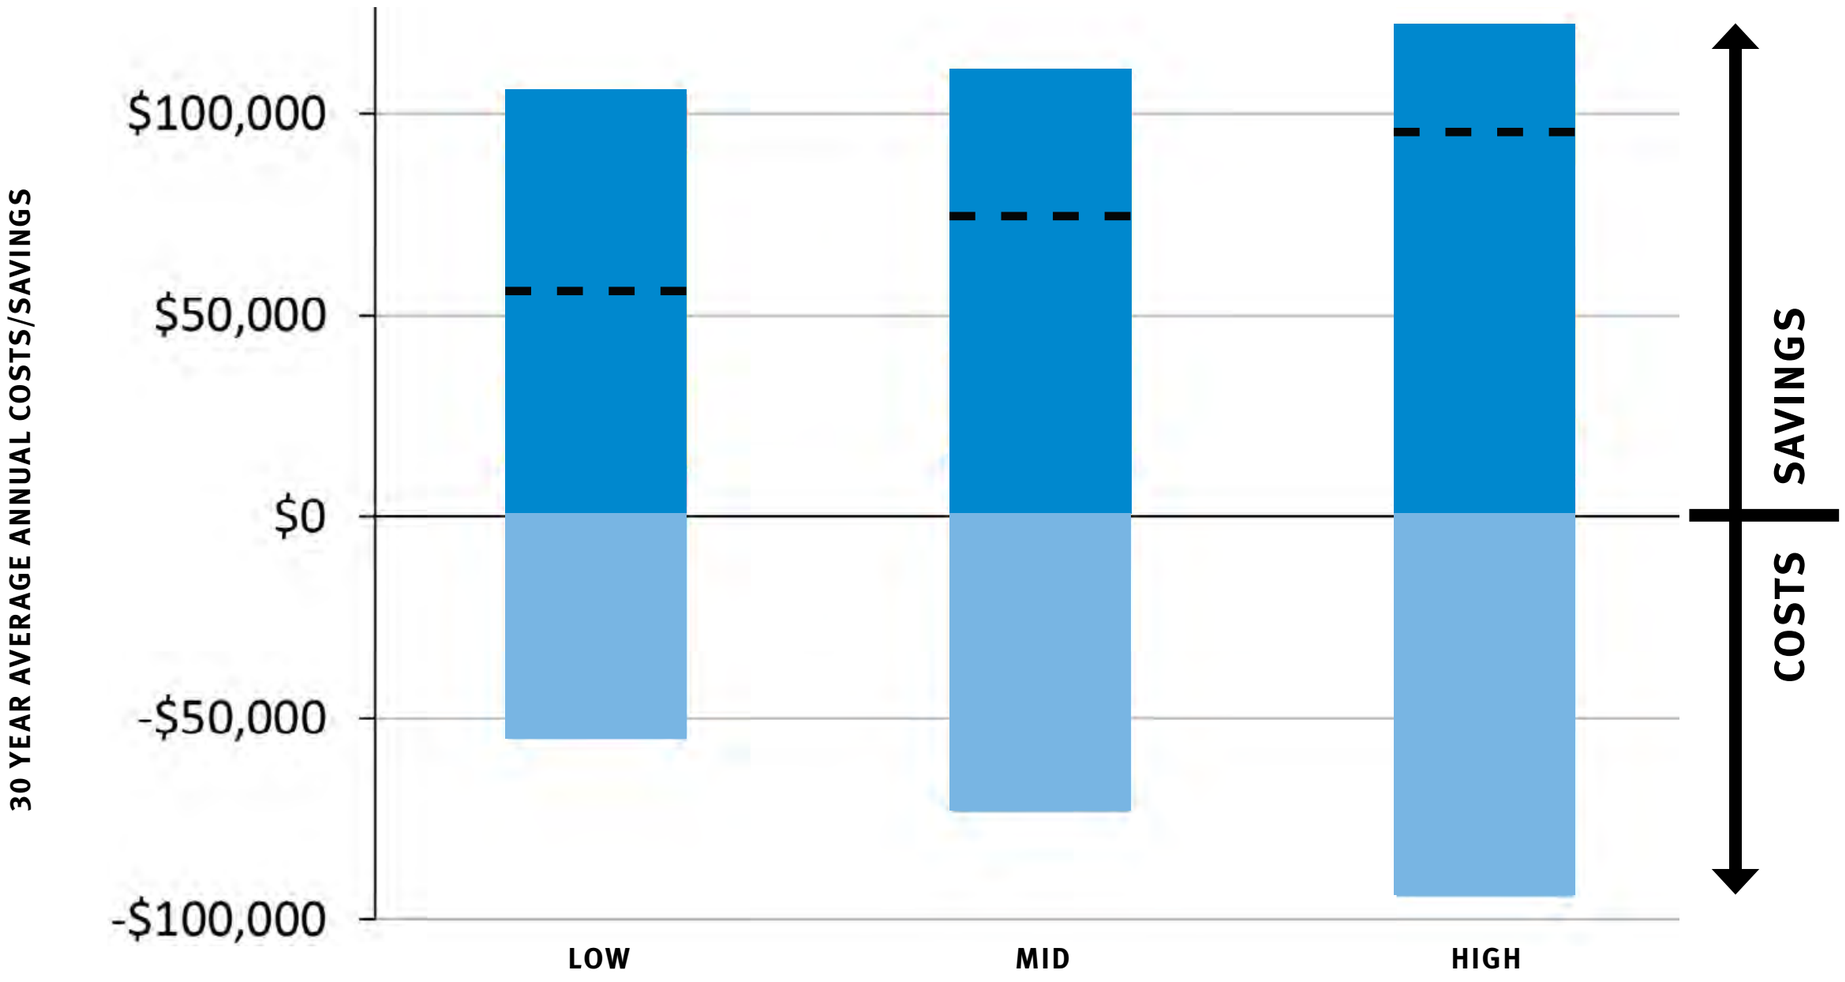

ANNUAL SAVINGS vs. DEBT SERVICE

#3 GROUND SOURCE HEAT PUMP vs. #1 GAS BOILER


$1,476,007	**$1,081,825**	**$792,732**	**30 YEAR TOTAL**
$49,200	$36,061	$26,424	ANNUAL NET BENEFIT

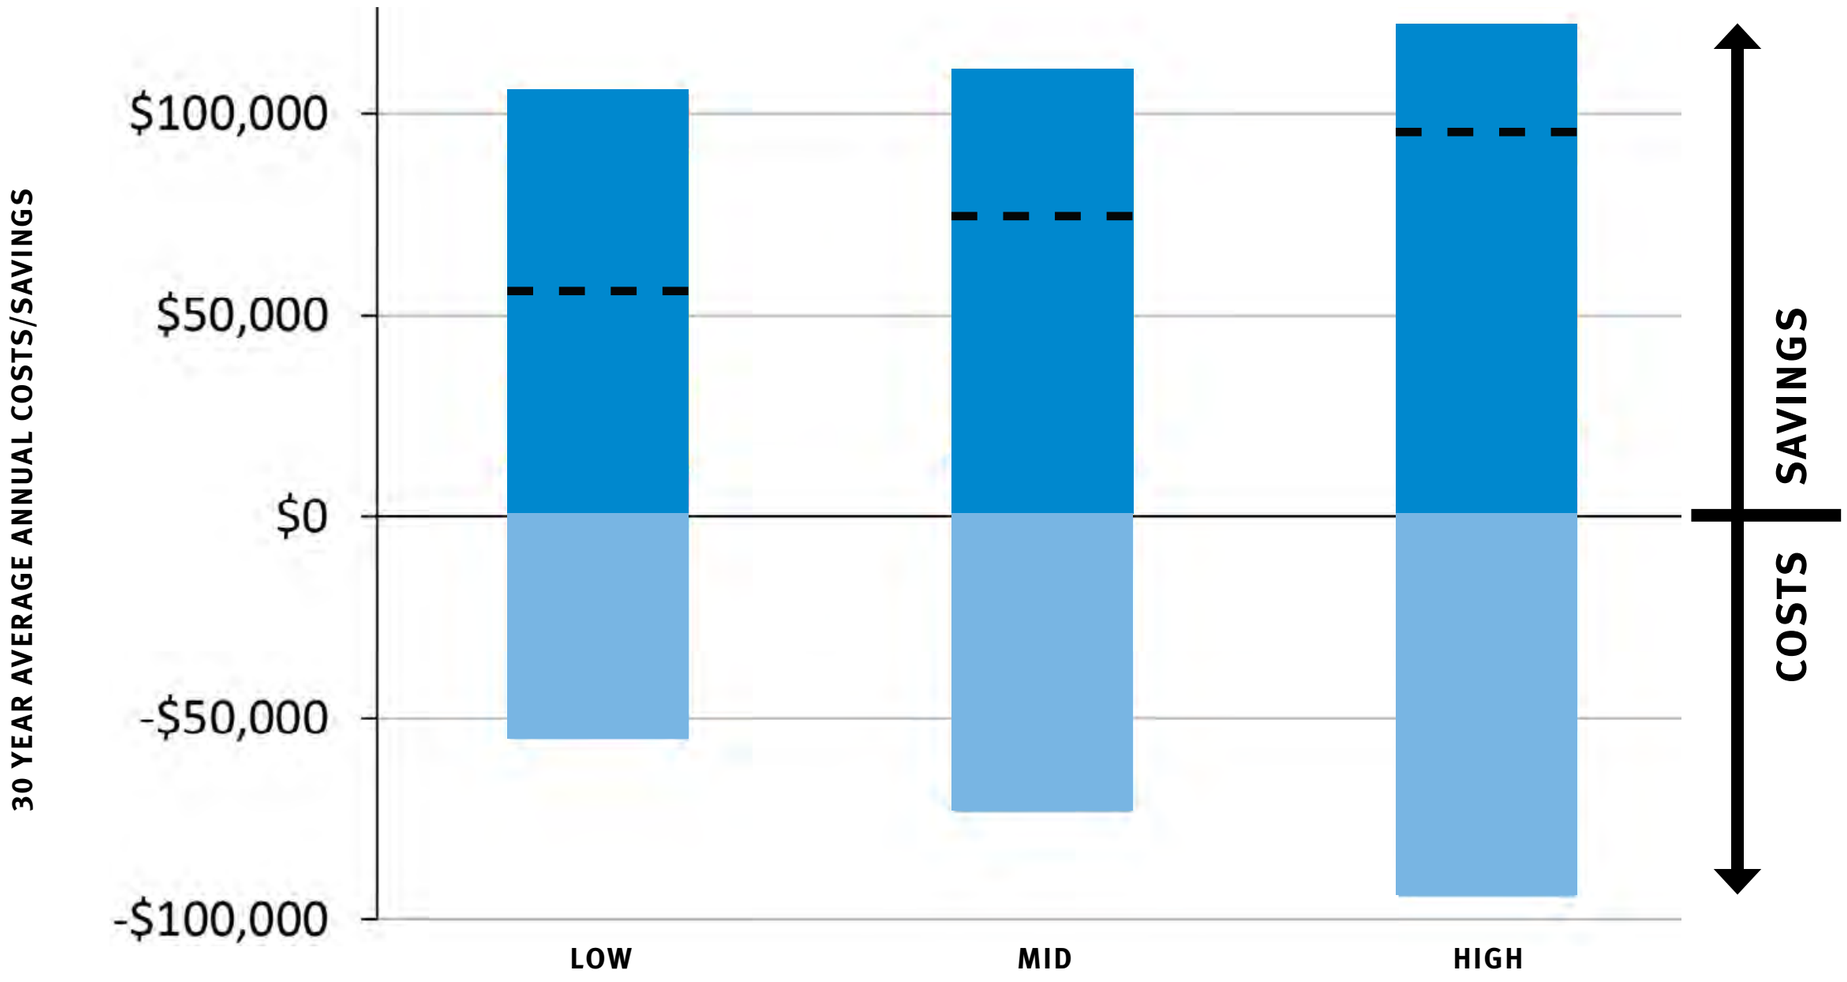

ANNUAL SAVINGS vs. DEBT SERVICE

#4 VRF vs. #1 GAS BOILER

$1,914,010	$1,200,778	$607,194	30 YEAR TOTAL
$63,800	$40,026	$20,240	ANNUAL NET BENEFIT

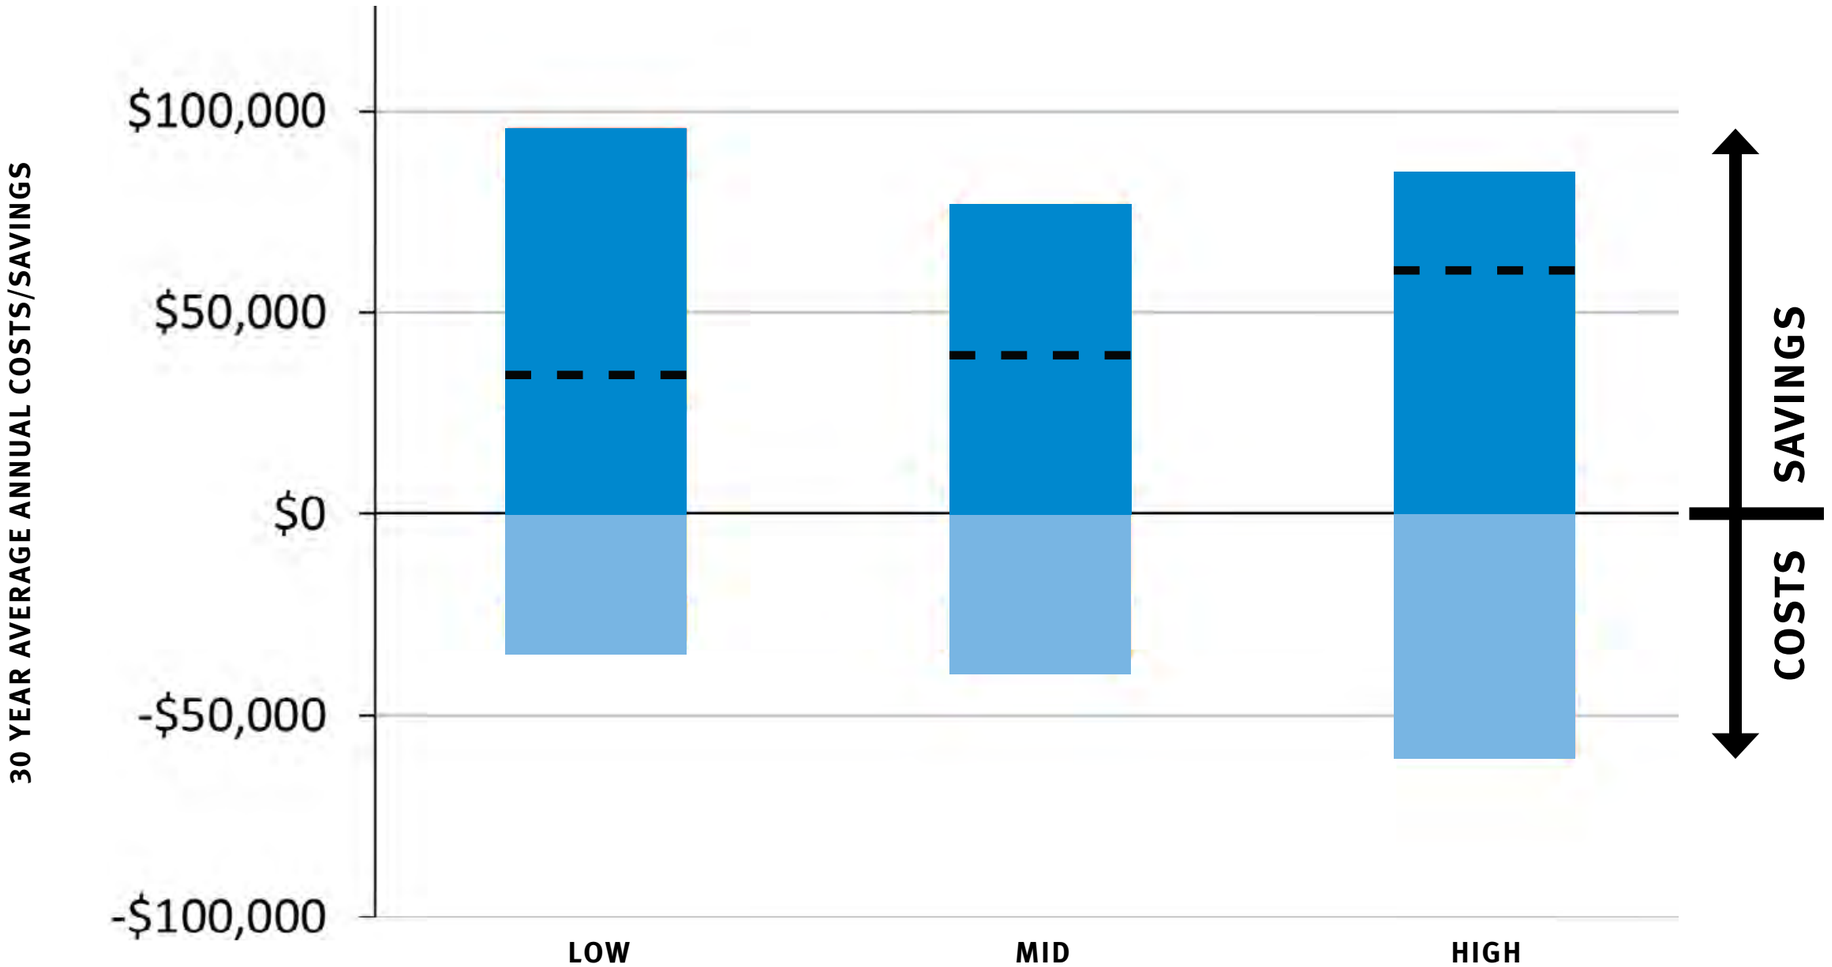

HVAC SYSTEM OPTIONS
COMPARISON

		Meets Eversource EUI	EUI	Carbon Emissions	Indoor Air Quality	Acoustics	PV Fits on Roof	Energy Cost	Maintenance Cost	Ease of Maintenance	Risk of Future Repair Cost
#3	Ground Source Heat Pump	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓
#4	VRF										


✓ = Performs better

HVAC SYSTEM OPTIONS
COMPARISON

		EUI	Carbon Emissions (mtons)	HVAC Capital Investment Cost			Annual Energy Cost			Annual Maintenance Cost			Combined Annual Cost Savings	Lifecycle Cost Savings	Discounted Payback (years)
					Delta	Total Construct Cost Delta		$/sf	Delta		$/sf	Delta			
#3	Ground Source Heat Pump	24	147	$7,219,665	11%	2.2%	$124,529	$1.27	-15%	$57,896	$0.59	-27%	$43,600	$767,218	19
#4	VRF	28.4	181	$6,507,218			$147,129	$1.50		$78,896	$0.80				


-Red values indicate there is additional cost, not savings, compared to Option 4
-Capital Cost does not include Eversource incentives
-Capital Cost includes additional electrical costs for option 4
-Energy Cost does not include peak demand charges

Fales Elementary School

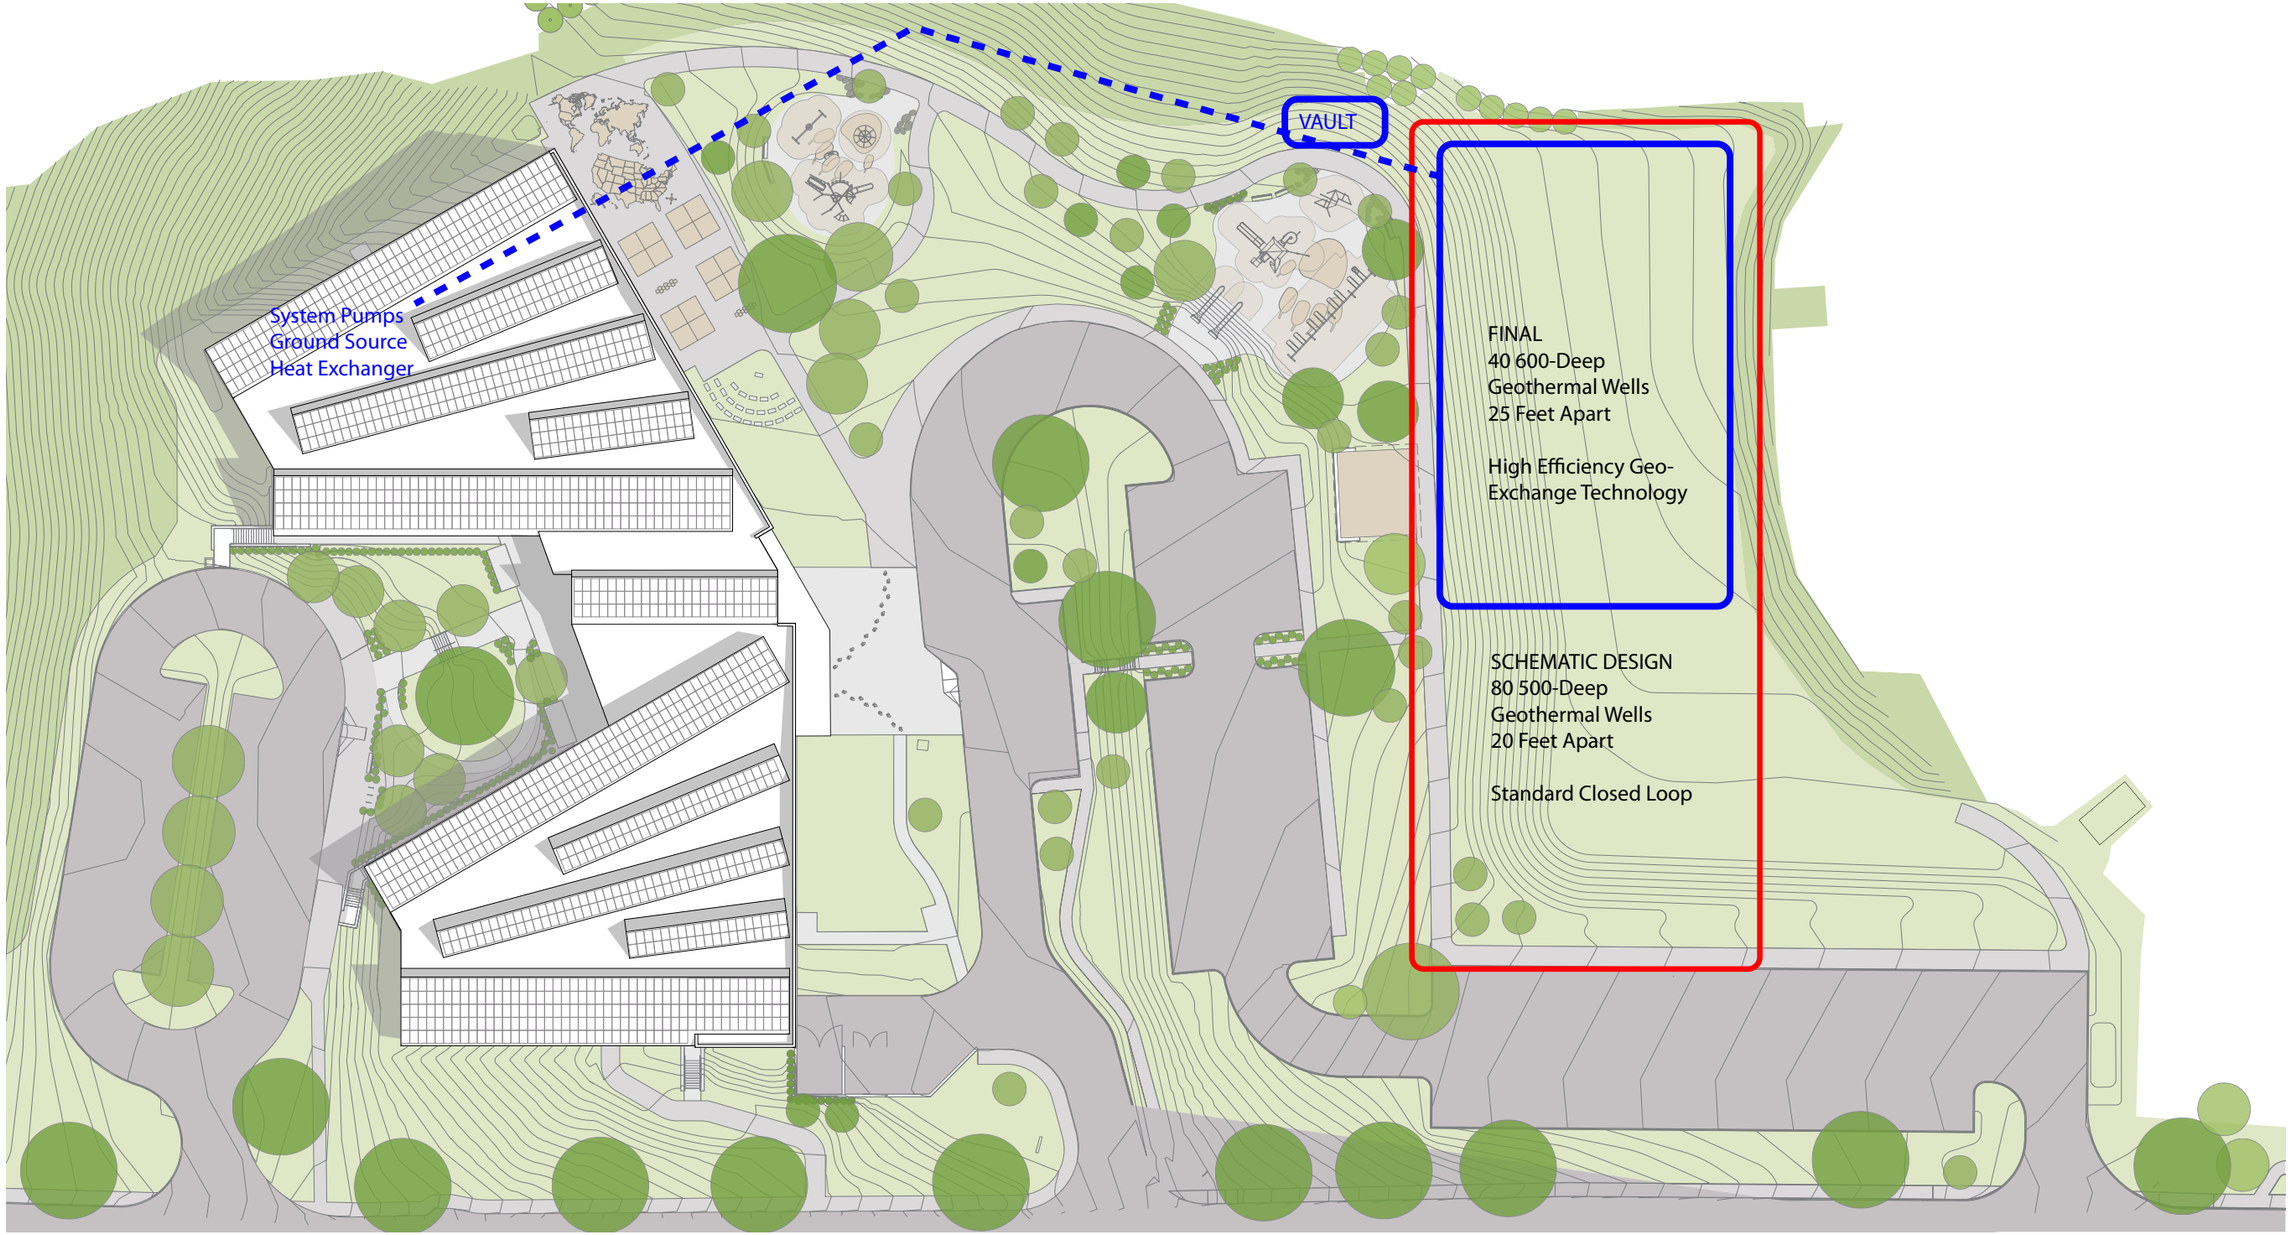

HM
FH

Annual Cost for Net Zero Energy —can be Net Zero Dollars

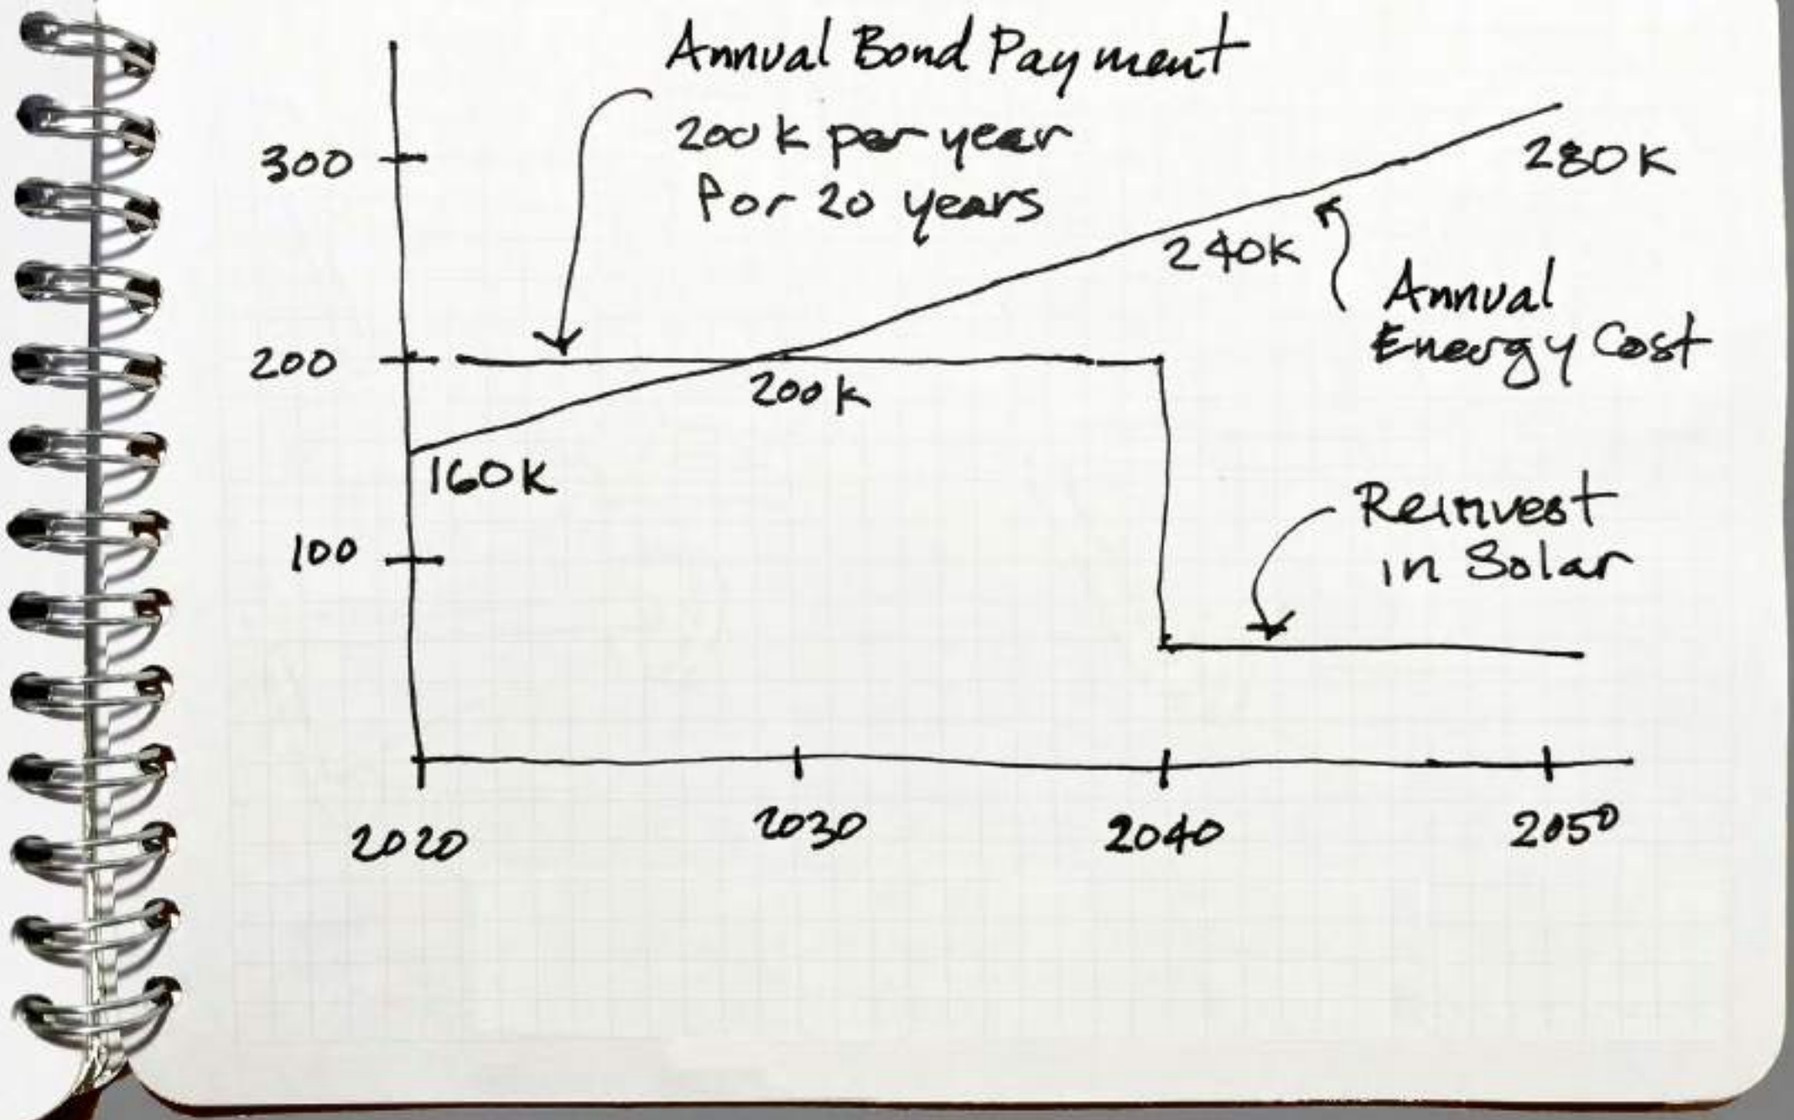


HM
FH

Cost Strategy

3 min.

COSTS

VIRGINIA SCHOOLS

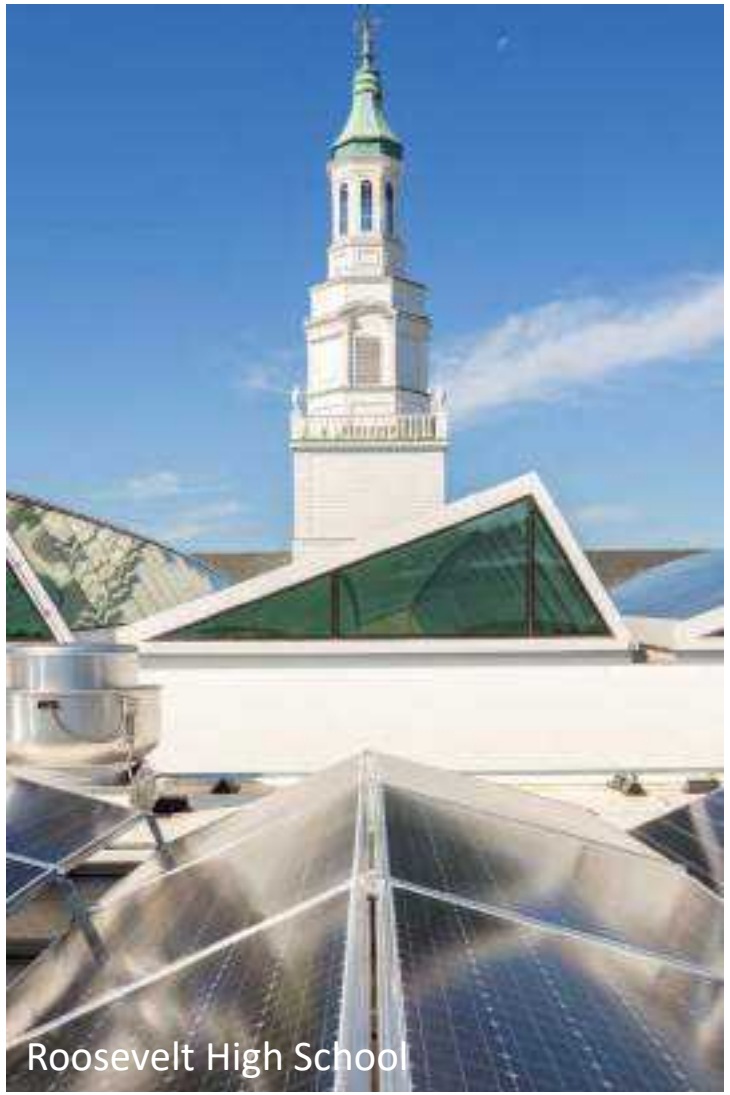

Roosevelt High School

FIRST COST CONSTRUCTION ESTIMATES				
SCHOOL	CONSTRUCTION TYPE	FCPS 2019 BOND PACKAGE	NET ZERO READY	NET ZERO ENERGY
ELEMENTARY SCHOOL	RENOVATION & ADDITION	**RVA-BOND** $24.94M TOTAL $246/SF	**RVA-NZR** $27.44M TOTAL $271/SF	**RVA-NZE** $28.11M TOTAL $277/SF
	NEW CONSTRUCTION	**NC-BOND** $29.64M TOTAL $292/SF	**NC-NZR** $31.02M TOTAL $306/SF	**NC-NZE** $31.65M TOTAL $312/SF

Annual Operations and Maintenance Costs Per SF	
System Type	**Cost per Square Foot**
Bond - Air-cooled VRF	$0.59
NZR - Geothermal WSHP	$0.24

LIFE CYCLE COST CASE STUDY

VIRGINIA ELEMENTARY SCHOOLS

LIFE CYCLE COST SUMMARY				
Facility:	Fairfax County, VA			
SYSTEM	FIRST COST	ANNUAL EST. ENERGY COST	ANNUAL EST. HVAC MAINTENANCE COST	30 YEAR LIFE CYCLE COST*
RVA-BOND	$24,940,470	$119,502	$60,050	$39,678,044
RVA-NZR	$27,444,599	$44,866	$24,427	$32,260,007
NC-BOND	$29,639,477	$117,946	$60,050	$44,303,019
NC-NZR	$31,016,286	$40,454	$24,427	$35,621,763

- 6% increase in construction cost
- 60% savings in annual operations and maintenance costs
- **10% overall savings**

MECHANICAL SYSTEM PAYBACK SUMMARY

System	Gross Capital Investment*	Annual Elec. Cons. (kWh)	Annual Gas Cons. (MBTU)	Annual Electric Cost	Annual Gas Cost	Combined Utility Cost	Annual Utility $/s.f.	Annual kBTU/s.f. (EUI)	Annual Maint. Cost	15 Year Exterior Equipment Replacement Cost	Annual CO2 Emissions (mTONS)****** *	Combined Annual Expense	Combined Expense Savings**	Total Life-Cycle Savings***	Discounted Payback (Years)****
1. Hot water coil heating/chilled water coil cooling VAV AHU system with energy recovery and terminal VAV boxes with hot water reheat coils 2. Code-efficient gas-fired non-condensing boiler plant 3. High-efficiency (code) water-cooled chiller plant with cooling tower	$10,643,800	2,020,046	2,865.0	$242,405	$36,051	$278,456	$1.57	55.1	$46,710	$175,000	960.0	$325,166	-	-	-

System	Gross Capital Investment*	Annual Elec. Cons. (kWh)	Annual Gas Cons. (MBTU)	Annual Electric Cost	Annual Gas Cost	Combined Utility Cost	Annual Utility $/s.f.	Annual kBTU/s.f. (EUI)	Annual Maint. Cost	15 Year Exterior Equipment Replacement Cost	Annual CO2 Emissions (mTONS)****** *	Combined Annual Expense	Combined Expense Savings**	Total Life-Cycle Savings***	Discounted Payback (Years)****
1. Displacement ventilation diffusers with passive chilled beam cooling/heating radiation 2. Hot water coil heating/chilled water cooling VAV ventilating units with energy recovery with terminal VAV boxes with CO2 controls 3. Geothermal wells with high-efficiency water-to-water source heat pump chillers	$12,838,650	1,409,139	0.0	$169,097	$0	$169,097	$0.96	27.2	$35,460	$0	563.7	$204,557	$120,609	$2,732,400	20
1. Displacement ventilation diffusers with passive chilled beam cooling/heating radiation 2. Gas-fired heating/dx cooling VAV ventilating units with energy recovery with terminal VAV boxes with CO2 controls 3. High efficiency gas-fired condensing boiler plant 4. High efficiency air-cooled chiller plant	$9,073,210	1,239,201	1,824.0	$148,704	$22,954	$171,658	$0.97	34.2	$37,460	$175,000	592.5	$209,118	$116,048	$4,635,005	Instant*****
1. Variable refrigerant flow (VRF) terminal evaporator units with air-cooled condensing units 2. Air-cooled dx heat pump heating/cooling 100% O.A. ventilating units with energy recovery with terminal VAV boxes with CO2 controls serving VRF units 3. Air-cooled dx heat pump heating/cooling VAV AHU systems with energy recovery with terminal VAV boxes with CO2 controls serving the cafetorium	$9,331,350	1,704,508	0.0	$204,541	$0	$204,541	$1.16	32.9	$75,960	$1,900,000	681.8	$280,501	$44,665	-$1,363,213	Instant******
1. Displacement ventilation diffusers with passive chilled beam cooling/heating radiation 2. Hot water coil heating/chilled water cooling VAV ventilating units with energy recovery with terminal VAV boxes with CO2 controls 3. Geothermal wells with high-efficiency water-to-water source heat pump chillers 4. Supplemental electric boiler plant	$12,238,150	1,426,031	0.0	$171,124	$0	$171,124	$0.97	27.5	$36,960	$0	570.4	$208,084	$117,082	$3,207,454	16



DCR Walden Pond Visitor's Center, Concord, MA (Direct Ownership)
105.84 kWdc (91.2 kWac)

POWER PURCHASE AGREEMENT (PPA)

Power Purchase Agreement (PPA)		Direct Ownership	
PROS	CONS	PROS	CONS
PPA is an alternative to affording solar equipment	Contract terms can range between 20-25 years	Purchase at fair market value (when you are ready to buy)	You are responsible for maintenance and repair which can be costly
Reduced electrical rate of 5-15% for energy produced	Roof area is part of PPA – Restricted Modifications	SMART Incentive Program Benefits – Reduce Paybacks	Initial capital cost
$0 upfront investment		Take advantage of electricity generated by your system and may pay nothing at all to power the facility, you may receive a credit.	
$0 maintenance cost			

Denise Rouleau, Lead Program Manager, National Grid
Kim Cullinane, Sr. Energy Efficiency Consultant, Eversource

mass save

ZNE/Deep Energy Savings Participation Pathway

06/08/2021

WE ARE MASS SAVE®:

BERKSHIRE GAS An AVANGRID Company | Cape Light Compact | EVERSOURCE | Liberty | nationalgrid | Unitil

mass save

Together, we make good happen for Massachusetts.

Your local electric and natural gas utilities and energy efficiency service providers taking strides in energy efficiency: Berkshire Gas, Cape Light Compact, Eversource, Liberty Utilities, National Grid and Unitil.

As one, we form Mass Save®, with the common goal of helping residents and businesses across Massachusetts save money and energy, leading our state to a clean and energy efficient future.



WE ARE MASS SAVE®:

BERKSHIRE GAS
An AVANGRID Company

Cape Light Compact

EVERSOURCE

Liberty

nationalgrid

Unitil

Path 1: Zero Net Energy/Deep Energy Savings

INTENT

Drive projects toward ZNE, low carbon and low EUI in operation - focus on outcomes

KEY PROGRAM DRIVER: 25 SITE EUI

Exceptions to 25 EUI can be negotiated | Early analysis and focus on EUI target

ZNE TECHNICAL SUPPORT


General ZNE/low EUI consulting | Load reduction analysis | HVAC system selection support | Life cycle cost analysis



ACTON-BOXBOROUGH DOUGLAS-GATES ELEMENTARY SCHOOL

Opening Fall 2022 | All electric | Triple net zero

ZNE or ZNE Ready School Projects in MA

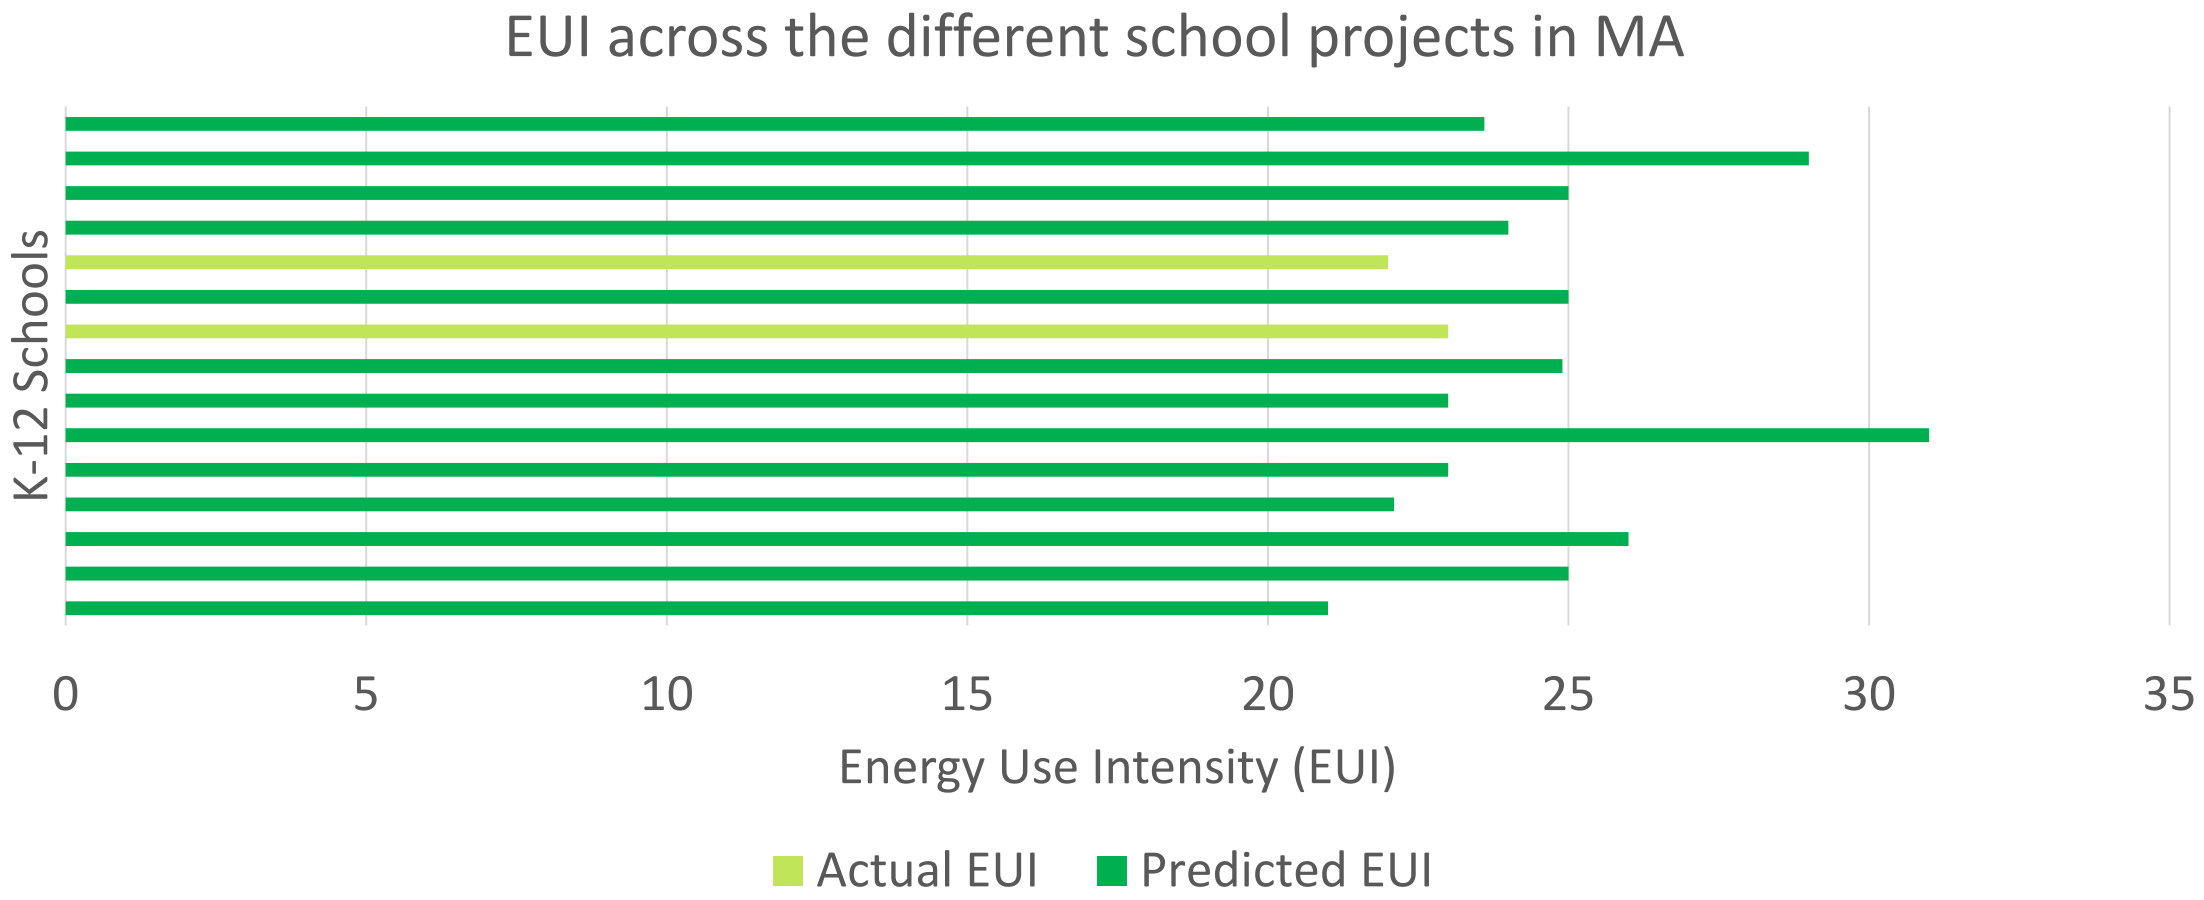

Incentives ($) Offered

Customer Incentives		
Construction Incentive	Paid if project design achieves 25 EUI or negotiated EUI target	$1.25/sf
Post Occupancy Incentive	Available after 1-year post-occupancy period if project achieves target EUI	$1.00/sf
ZNE or PH Certification Incentive	Paid for project ZNE or PH certification	$3,000
Verification Incentive	Optional scope to conduct data review to identify and correct issues	50% of fee up to $10,000
Design Team Incentives		
Calculated at $0.20/sf and capped at $15,000, but not less than $8,000 per project		

Verification Incentive

(Optional)

Mass Save offers 50% cost share up to $10,000

WE ARE MASS SAVE®:

BERKSHIRE GAS
An AVANGRID Company

Cape Light Compact


EVERSOURCE

Liberty

nationalgrid

Unitil

Scope to include:

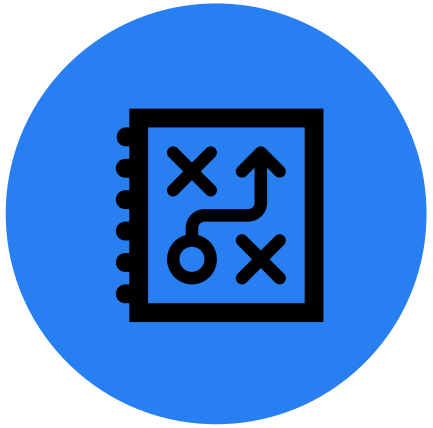

Review control strategies at end of design



Multiple trend data reviews at post occupancy



Multiple EUI data pulls at post occupancy


Path 1: Project Incentive Example

Building Sf	**200,000**	
Incentive	Sf Incentive	Total Incentive
Construction	$ 1.25	$ 250,000
Post Occupancy	$ 1.00	$ 200,000
ZNE or Passive House Certification		$ 3,000
Optional Verification Incentive *		$ 10,000
ZNE Consultant Constribution *		$ 10,000
		$ 473,000
* 50% of the fee up to $10,000		

Value of Setting Early EUI Target

- Centers team on a clear goal
- Serves as a touchstone for decision making throughout design
- Encourages thought about building operations considerations
- Prevents value engineering of energy saving equipment and systems
- Allows school district to check performance against the target over time (and relative to other schools)

When Should You be Reaching Out?

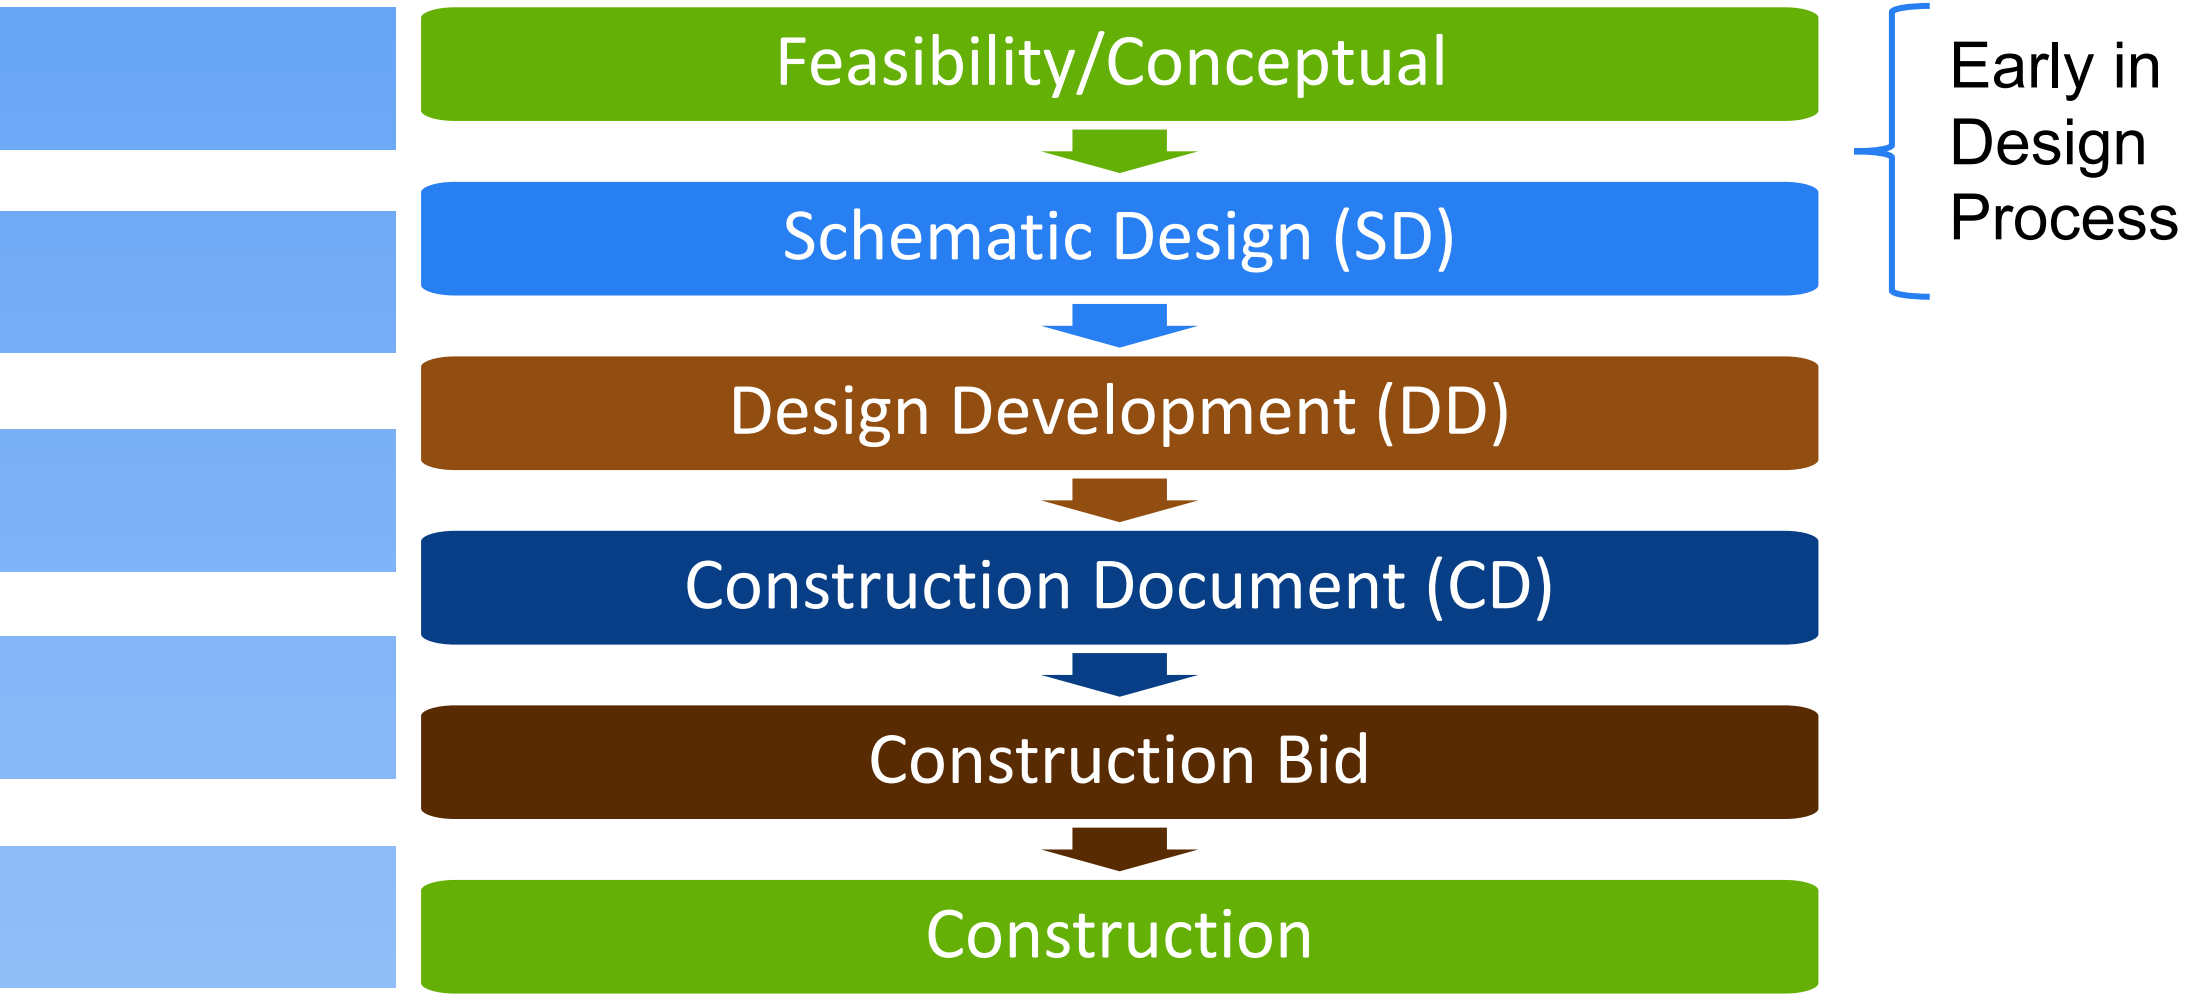

New Program Resources

MassSave.com

Program summary and individual pathway overviews | Program Memorandums of Understanding (MOUs)



Kim Cullinane
Eversource
kim.cullinane@eversource.com
(508) 353-5806

Margaret Song
Cape Light Compact
msong@capelightcompact.org
(508) 375-6843

Denise Rouleau
National Grid

Jodi Beebe
(on behalf of National Grid)
jordana.c.beebe@leidos.com
(617) 631-6039

Brad Hunter
Unitil
hunterb@unitil.com
(603) 294-5231

mass save

Thanks for listening.

WE ARE MASS SAVE®:

BERKSHIRE GAS
An AVANGRID Company

Cape Light Compact

EVERSOURCE

Liberty

nationalgrid

Unitil

Value Engineering

4 min.

TOBIN MONTESSORI VASSAL LANE SCHOOL



PERKINS EASTMAN

BOSTON ARTS ACADEMY (BAA)

Location: Boston, MA
Use: High School – Arts
Number of Students: 500
Square Footage: 153,000 sf
Floors: 5




PERKINS EASTMAN

EXTERIOR ENVELOPE AND MECHANICAL DESIGN

BOSTON ARTS ACADEMY



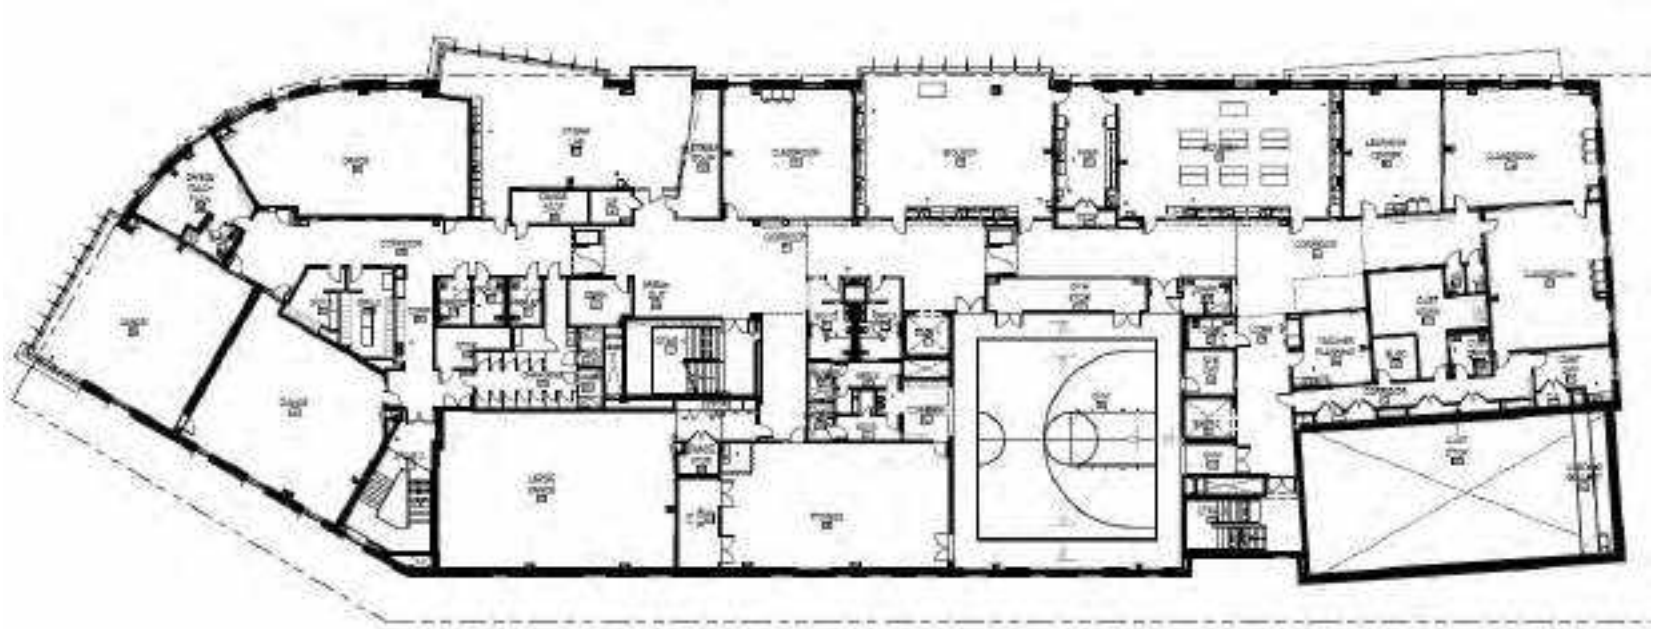

- Engineer proposed perimeter heat
- Architect proposed triple-glazed windows
  - More annual hours of comfort
  - Reduces # of Air-Source Heat Pumps
- What is the cost?

EXTERIOR ENVELOPE AND MECHANICAL COST

BOSTON ARTS ACADEMY

Cost of Systems and Envelope

- Double Glazing $1,586,391
- Triple Glazing $1,078,105

Triple Gazed design = $508,242 first cost savings


With Double Glazing	
Boiler Size	1300
Boiler Cost	$84,000
Boiler Misc	$12,000
Pump Size (GPM)	87
Pump Cost	$31,000
Piping Cost	$791,826
Piping Insulation Cost	$330,000
Level 1 FTR Length	228
Level 1 FTR Cost	$19,380
Level 2 FTR Length	316
Level 2 FTR Cost	$26,860
Level 3 FTR Length	368
Level 3 FTR Cost	$31,280
Level 4 FTR Length	377
Level 4 FTR Cost	$32,045
Level 5 FTR Length	342
Level 5 FTR Cost	$29,070
Control zones perim heat	100
Controls cost	$ 150,000
FTR Cost with Double Glazing	$138,635
Boiler and Piping Cost	$1,248,826
Total Cost of FTR and Boilers	$1,537,461
Architectural Treatment of Perimeter Heat	$ 48,930
TOTAL COST	$1,586,391

With Triple Glazing	
Boiler Size	600
Boiler Cost (Estimate)	$71,400
Boiler Misc (Estimate)	$10,200
Pump Size (GPM)	40
Pump Cost (Estimate)	$26,350
Piping Cost (Estimate)	$593,870
Piping Insulation Cost (Estimate)	$231,000
Level 1 FTR Length	41
Level 1 FTR Cost	$3,485
Level 2 FTR Length	92
Level 2 FTR Cost	$7,820
Level 3 FTR Length	240
Level 3 FTR Cost	$20,400
Level 4 FTR Length	189
Level 4 FTR Cost	$16,065
Level 5 FTR Length	180
Level 5 FTR Cost	$15,300
Control zones perim heat	40
Controls cost	$ 60,000
FTR Cost with Triple Glazing	$63,070
Boiler and Piping Cost	$932,820
Total with Triple Glazing FTR	$1,055,890
Architectural Treatment of Perimeter Heat	$ 22,260
TOTAL COST	$1,078,150


Savings with Triple Glazing Versus Double Glazing **$508,242**

VALUE ENGINEERING CONSTRAINTS

- Savings in HVAC balances cost in exterior envelope
- Reduced HVAC Equipment = Reduced Maintenance
- Passive Survivability
- **You cannot take the cost savings for one system without increasing the cost of another**

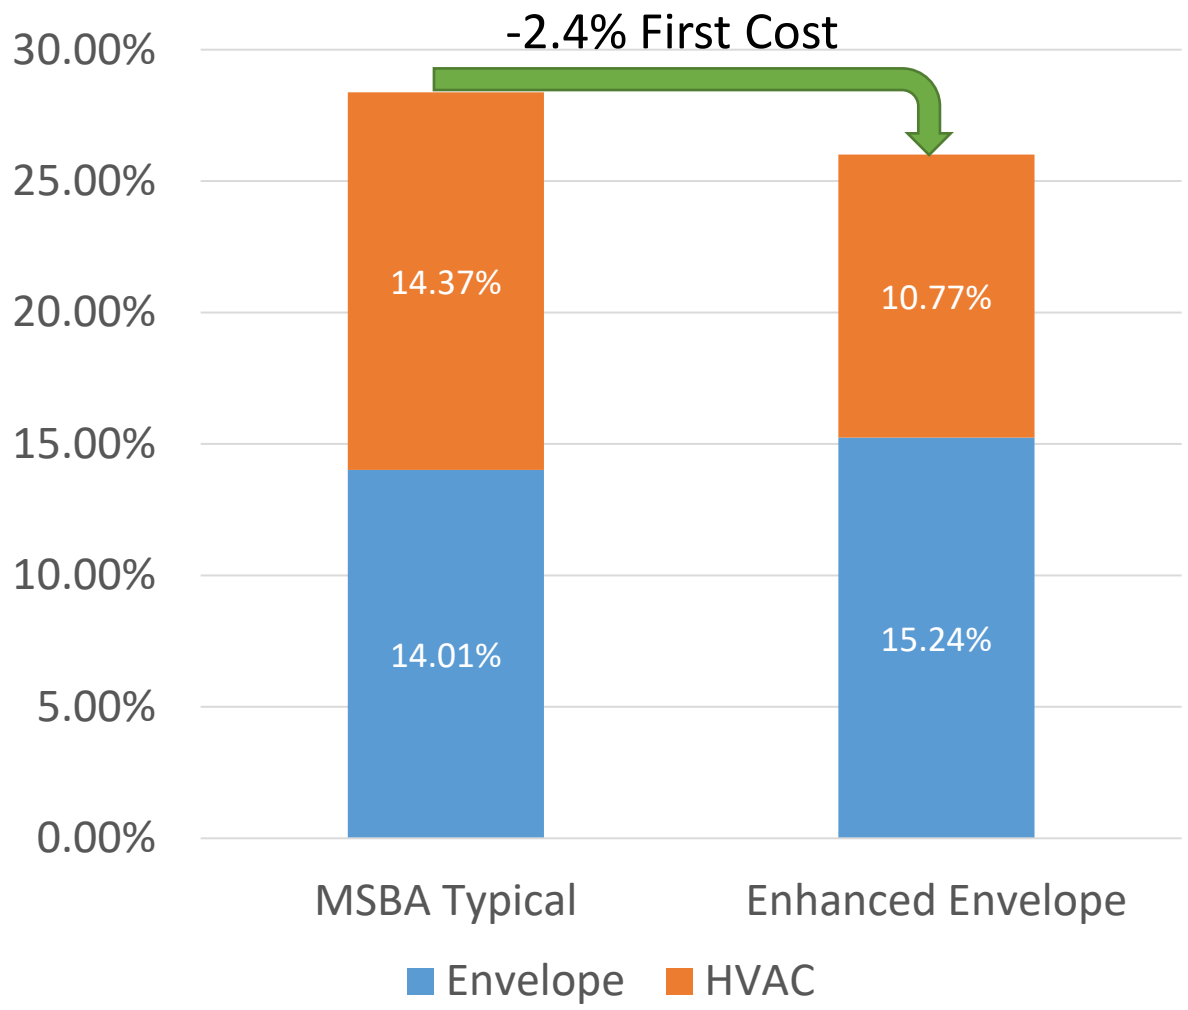


ENGAGEMENT OF STUDENTS & COMMUNITY

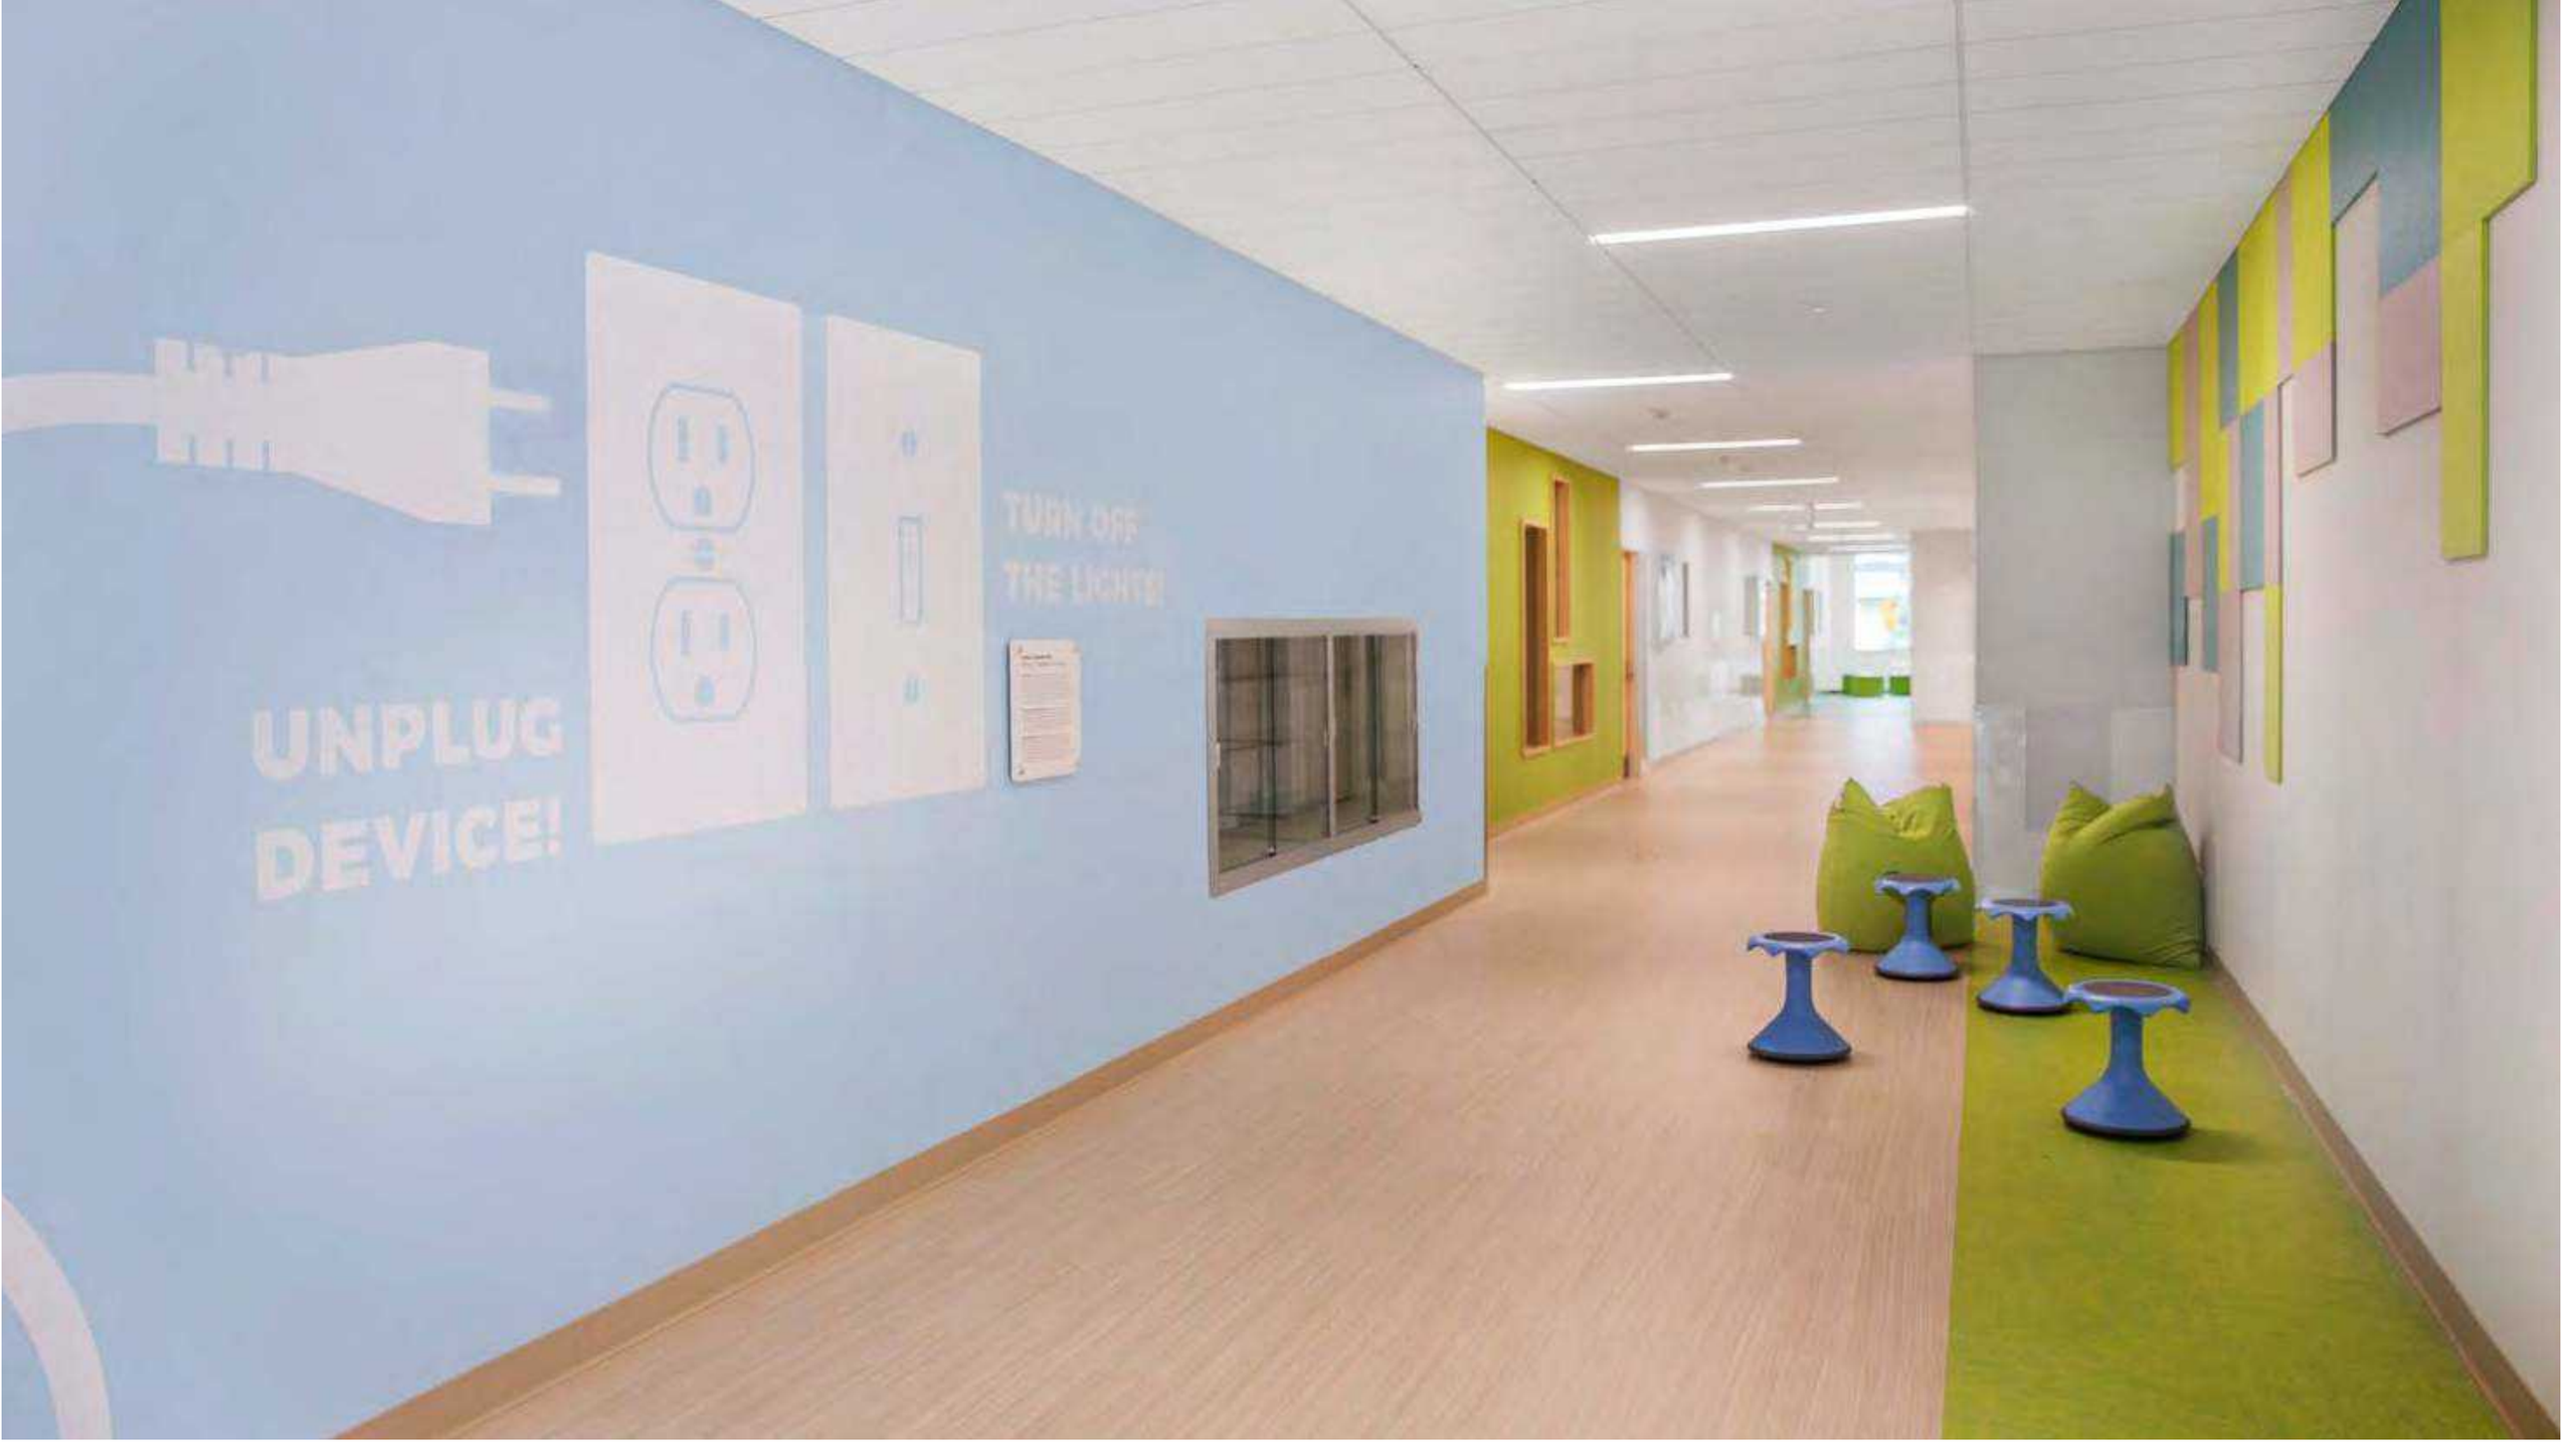
UNPLUG
DEVICE!
TURN OFF
THE LIGHTS!



ENJOY
THE QUIET.
LOCKERS!
VOICES!
MUSIC!
FOOTSTEPS.


LET THE SUN
SHINE IN!


USE THE
EARTH!
HOT
COLD
COLD
HOT
WINTER
SUMMER

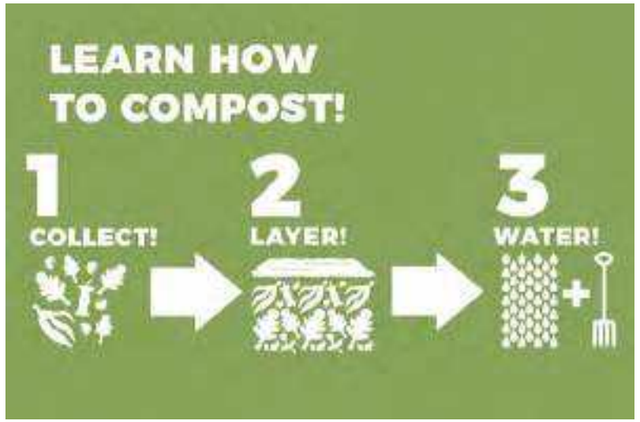
LEARN HOW
TO COMPOST!
1
COLLECT!
2
LAYER!
3
WATER!


CONSERVE
WATER!

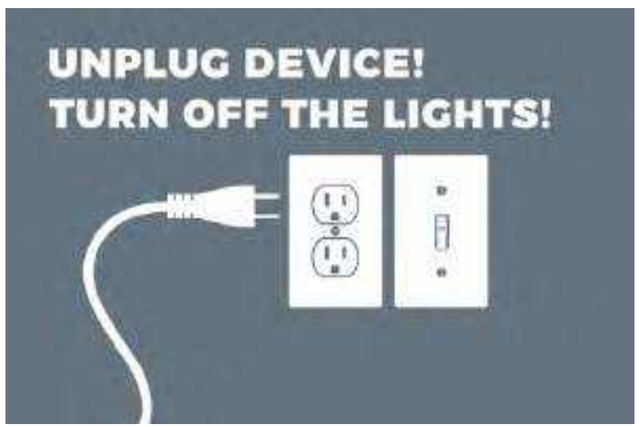
UNPLUG DEVICE!
TURN OFF THE LIGHTS!


RUN ON THE SUN!


LEARN HOW
TO COMPOST!
1
COLLECT!
2
LAYER!
3
WATER!


LEARN HOW
TO COMPOST!
2
LAYER!
3
WATE



Energy Generation – Photovoltaics

This building is a Net Zero Emissions Building, which means that it does not burn fossil fuels and it generates an amount of renewable energy in a year equal to the amount of energy the building needs to operate. PV panels, located on the roof and façade, generate the renewable energy.


Daily Solar Generation - East/West / Today



East Building Solar Production, King Open/CSUS & Communit... 0 kWh

West Building Solar Production, King Open/CSUS & Communit... 440 kWh


Weekly Solar Generation - East/West / Last 7 days



East Building Solar Production, King Open/CSUS & Communit... 0 kWh

West Building Solar Production, King Open/CSUS & Communit... 3,746 kWh

Monthly Solar Generation - East/West / Last 30 days



East Building Solar Production, King Open/CSUS & Communit... 42,162 kWh

West Building Solar Production, King Open/CSUS & Communit... 14,601 kWh


Annual Solar Generation - East/West / Last 12 months



East Building Solar Production, King Open/CSUS & Communit... 326,906 kWh

West Building Solar Production, King Open/CSUS & Communit... 156,856 kWh


Total Daily Electricity Generation v. Consumption / Today



Total 440 kWh

Total, Total Electricity Use 2,204 kWh


Total Weekly Electricity Generation v. Consumption / Last 7 days



Total 3,746 kWh

Total, Total Electricity Use 18,551 kWh


Total Monthly Electricity Generation v. Consumption / Last 30 days



Total 56,763 kWh

Total, Total Electricity Use 93,815 kWh

Total Annual Electricity Generation v. Consumption / Last 12 months



Total 483,733 kWh

Total, Total Electricity Use 1.29m kWh

buildingOS_


SB - Solar gen



Energy Generation – Photovoltaics

This building is a Net Zero Emissions Building, which means that it does not burn fossil fuels and it generates an amount of renewable energy in a year equal to the amount of energy the building needs to operate. PV panels, located on the roof and façade, generate the renewable energy.

Daily Solar Generation - East/West / Today

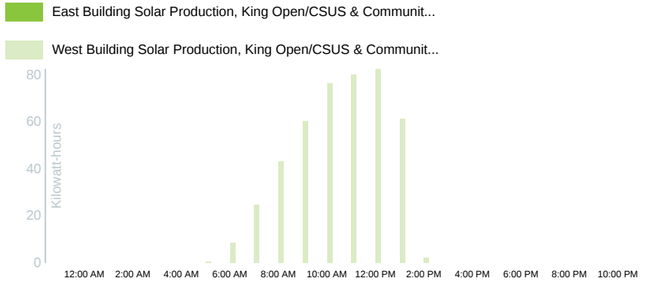


East Building Solar Production, King Open/CSUS & Communit... 0 kWh

West Building Solar Production, King Open/CSUS & Communit... 440 kWh

Weekly Solar Generation - East/West / Last 7 days




Total Daily Electricity Generation v. Consumption / Today

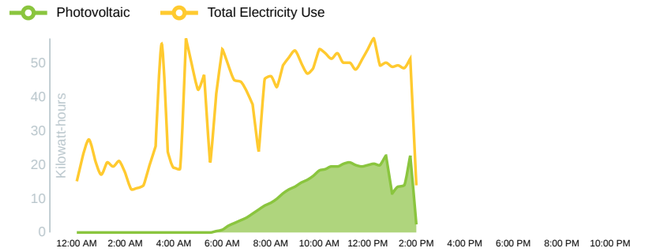

Total 440 kWh

Total, Total Electricity Use 2,204 kWh

Total Weekly Electricity Generation v. Consumption / Last 7 days

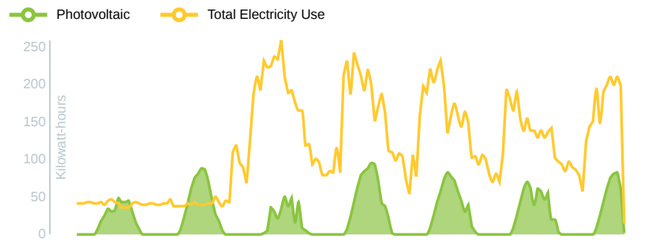


ARROWSTREET


INTELLIGENCE PLUS CHARACTER—
THAT IS THE GOAL OF TRUE EDUCATION. REV. DR. MARTIN LUTHER KING, JR.


NOBODY CAN MAKE YOU SEEK OUT YOUR EDUCATION
YOU HAVE TO DO THAT FOR YOURSELF. ROBERT PARRIS MOSES

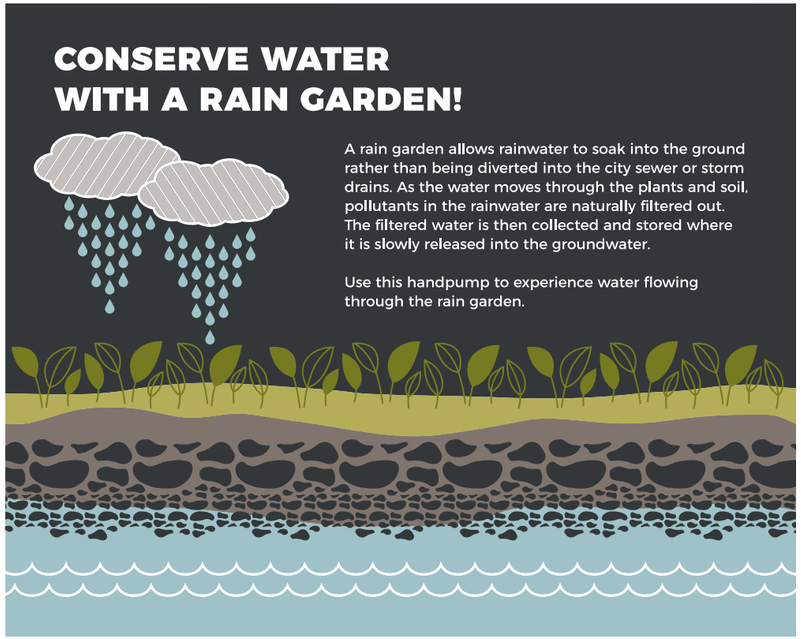


CONSERVE WATER
WITH A RAIN GARDEN!
A rain garden allows rainwater to soak into the ground rather than being diverted into the city sewer or storm drains. As the water moves through the plants and soil, pollutants in the rainwater are naturally filtered out. The filtered water is then collected and stored where it is slowly released into the groundwater.
Use this handpump to experience water flowing through the rain garden.


CONSERVE WATER
WITH A RAIN GARDEN!

EAT LOCAL!

LOCAL FOOD PRODUCTION

WHAT IS IT:
When food is grown locally, either in your town, state, or region, it is more sustainable. Food grown far away creates pollution from the trucks that drive it to your area and the refrigeration needed to keep it fresh on the journey takes a lot of energy. In addition, local food tastes great and is often the freshest.

WHAT DOES THE BUILDING DO:
This garden grows fruits and vegetables that you can eat! It is an example of the types of things that you can grow in your own home or yard in Cambridge. It is important to understand how plants grow and no better way to understand than to grow them yourself.

WHAT CAN YOU DO:
Shop at neighborhood grocers, farm stands, or farmer's markets. Wherever you buy produce, select items that are grown in your state or region.



Hosmer

Interior Rendering



View of main stair in Hosmer

Instructional guides for classroom occupants

12 STEPS TO NET-ZERO

Ai3's CLASSROOM USER GUIDE

The purpose of the following User Guide is to explain the features of the school that contribute to its energy savings and efficiency. Implementing these strategies will ensure the maintainance of a Net-Zero Energy Building.


WHAT IS A NET-ZERO SCHOOL?

The Department of Energy reports that K-12 schools expend $6 Billion on energy consumption each year; more than the costs of textbooks and computers combined, and second only to the cost of teacher salaries. A **Net-Zero school** is designed and constructed to produce as much energy on site as it consumes from the electric grid. The Net-Zero school also reinforces teaching and learning as an extended classroom. The incorporation of efficient building materials and cutting-edge renewable energy technology makes the building a three-dimensional learning space. Students learn through practical, hands-on experiences and observations of the building's components, systems, and operation.


1st law of thermodynamics

But what is energy?

Energy cannot be created or destroyed; it can be transformed



Rudolf Clausius, 1850

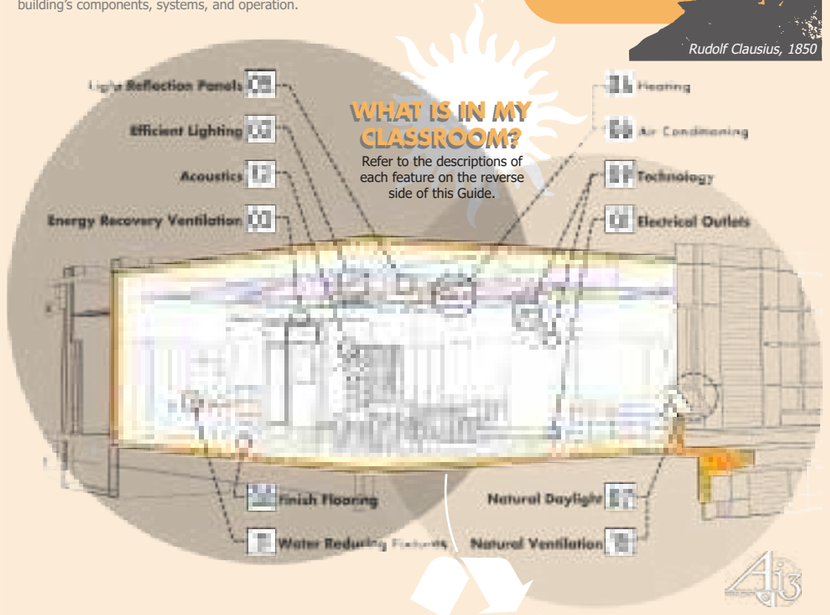

WHAT IS IN MY CLASSROOM?
Refer to the descriptions of each feature on the reverse side of this Guide.

WHAT IS MY ROLE AS A USER?

Net-Zero Energy Buildings are the pinnacle of what sustainable design and construction are trying to accomplish. We have incorporated numerous energy-efficient technologies and building strategies to allow this new school to achieve Net-Zero status. However, **occupant behavior** accounts for approximately 50% of the building's energy usage, and your activities as an occupant will be critical in achieving Watertown's goal of Net-Zero Energy. This means always engaging in **energy conscious practices**; such as unplugging electronics not in use, closing windows when the heating or air-conditioning systems are used, turning lights off when leaving the room, and using the appropriate flush settings.

WHAT ELSE CAN I DO?

Being conscious of energy usage to ensure that your building produces as much energy, if not more, than is used helps the environment because it **reduces emissions**. Outside of energy conservation sustainability should also be practiced. To be **sustainable** is to avoid depleting natural resources so that an ecological balance is maintained. **Recycling** is a sustainable practice because it converts waste into recycled material, which can then be reused rather than using new resources. **Composting** natural waste is another sustainable practice becuase it reduces the amount of waste that would ultimately end up in a landfill. Landfills emit compounds that, over time, are harmful to the ozone layer.

12 STEPS TO NET-ZERO

Ai3's CLASSROOM USER GUIDE

01 Electrical Outlets

One of the biggest challenges in lowering energy consumption is eliminating inefficient appliances and equipment plugged into electrical outlets. These items become particularly concerning if they utilize electricity outside typical occupancy hours. For this reason, most of the outlets in your classroom automatically shut off at the end of the school day. If you absolutely must have items which utilize electricity when the building is not occupied, these can be plugged into specially designated 24/7 outlets, but please use these sparingly as they have a huge impact on building energy use.

02 Efficient Lighting

Lighting throughout the building is designed to dim automatically when there is enough natural lighting entering the building through exterior windows. This dimming of electrical lighting is particularly important in the classroom, because classrooms are one of the largest areas of energy consumption. There are provisions for overriding the daylight dimming functions in your classroom; however, we discourage overriding the dimming systems unless it is necessary to achieve appropriate lighting for the current activity in the classroom.

03 Energy Recovery Ventilation

A heat recovery ventilation system removes old air from the classroom and supplies new fresh air. This is called "Energy Recovery" because the system can extract energy from the cold or hot air (depending on the season) removed from one classroom and use it to cool or heat the new fresh air supplied to another classroom. The fresh air system for your classroom should be left on "auto" but you can press the boost button during occupancy if something within your classroom requires additional ventilation. Note that when the boost button is used, much more electricity is too, so use it sparingly.

04 Heating

The heating of your room is provided by the two square ceiling cassettes located in the ceiling. These units are tied to your room thermostat and work independently of all other systems in the building to heat your classroom to the desired temperature. You may sometimes notice a short delay in the startup of these cassettes. This is because they receive their heating/cooling freon from a common source shared by other cassettes in the building and it is most efficient to supply this freon when multiple spaces are calling for its production and use.

05 Light Reflection Panels

Light reflection panels in your classroom are designed to amplify the daylight coming into the classroom and reduce the amount of artificial lighting (electricity) required. Please do not cover or block them.

06 Air Conditioning

The cooling of your room is provided by two ceiling cassettes. These units are tied to your room thermostat and work independently of all other systems in the building to cool your classroom to the desired temperature. You may sometimes notice a short delay in the startup of these cassettes. This is because they receive their heating/cooling refrigerant from a common source shared by other cassettes in the building and it is most efficient to supply this freon when multiple spaces are calling for its production and use. The system may be pausing until another classroom also needs refrigerant.

07 Natural Daylight

The windows in your classroom form a major role in reducing the amount of artificial light required in the classroom. They include exterior sunshades to block solar gain during the appropriate seasons and allow it when beneficial in colder months. We request that you do not block your windows or utilize the interior shades unless it is necessary, and that you return the interior shades to an open position as soon as possible. If you keep your interior shades in a closed position or cover your windows, it defeats many natural lighting and heating attributes of the building's exterior envelope.

08 Finish Flooring

Your classroom floor finishes are made from linoleum. Linoleum is a sustainable, natural, and durable product that played a role in making sure the school achieved LEED Gold status. Although linoleum is quite durable, it requires some care. If you do have a spill, simple soap and water should be utilized to clean the floor finish. Additionally, you may notice that light colors have been selected for floor, wall, and ceiling products. We recognize that this may require more cleaning but has significant benefits in light reflectance and reducing the overall artificial lighting required in the classroom.

09 Technology

Technology equipment within your classroom is plugged into specially designated outlets that turn off automatically based on the schedule of occupancy. However, we highly encourage you to turn off equipment manually if it is not in use. We also request that you do not plug technology equipment into the outlets which are powered 24/7, as this defeats our goal of reducing energy use.

10 Natural Ventilation

Your classroom contains operable windows to allow for natural fresh air when the weather is appropriate. Note that your classroom is always receiving fresh air even when the windows are closed. The energy recovery ventilation provides 15 ft³ of fresh air per minute. This is more than an open window provides and this system can detect the number of occupants in your classroom to adjust the amount of fresh air accordingly. If the windows are open, turn off the thermostat. The ceiling cassettes should never be operating with windows open, as this results in a significant waste of energy.

11 Water Reducing Fixtures


Toilets and faucets inside and throughout the building are water-reducing fixtures that are intended to minimize overall building water usage. The toilets have two flush options and we encourage the minimum amount of water usage (Flush Option 1) unless it is necessary to utilize the maximum water use flush (Option 2).

12 Acoustics


Although your classroom is designed with a sound reinforcement system to provide voice amplification when necessary, the classroom acoustics are designed to minimize the need for this system. We encourage you to utilize the sound reinforcement system, but ask that you evaluate the natural acoustics in your classroom and only use voice amplification when required.

ENGAGEMENT OF OCCUPANTS & STAFF

Typical School Energy by End Use

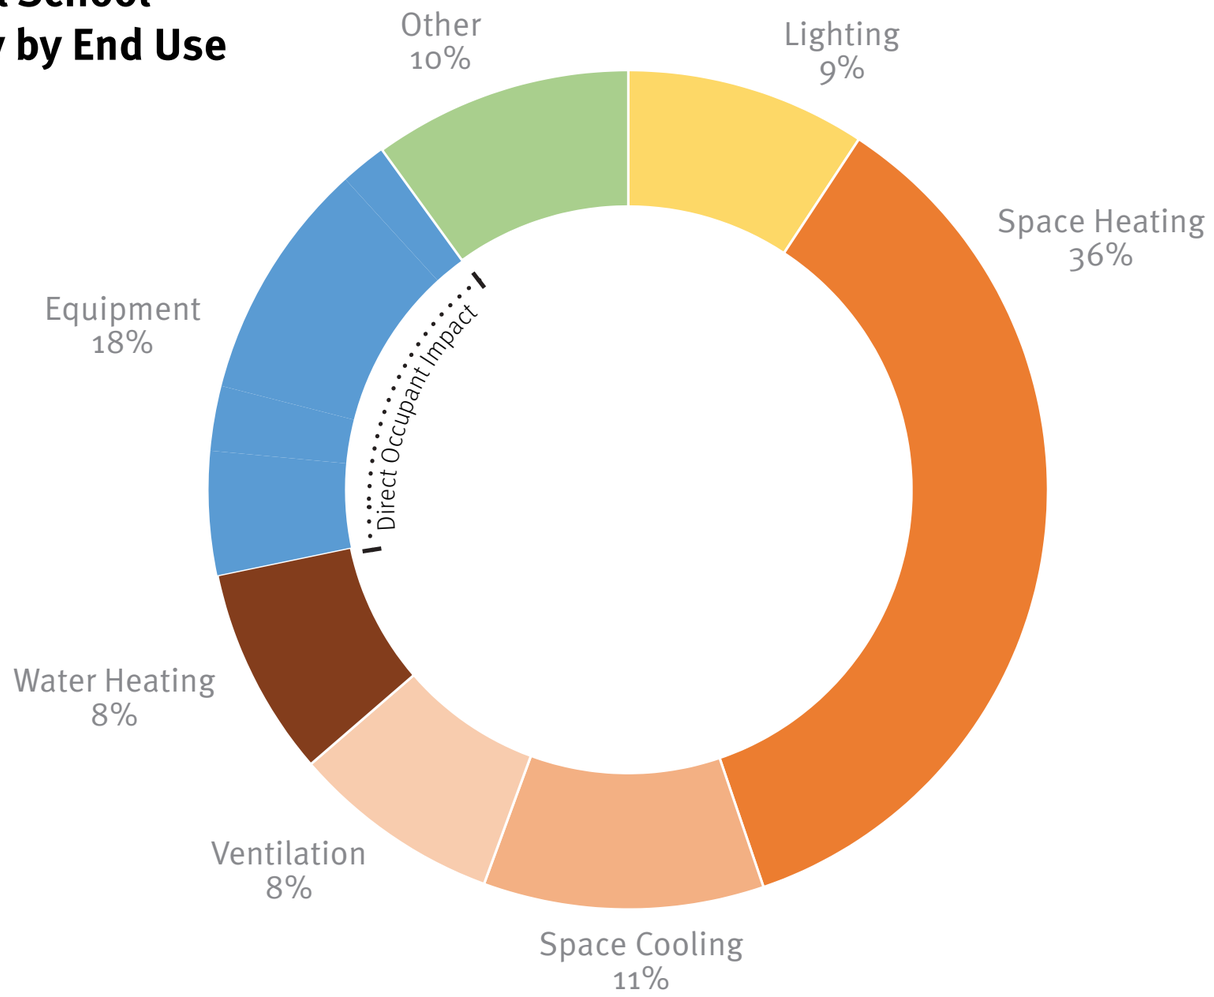

King Open/ Cambridge Street Upper Schools Energy by End Use

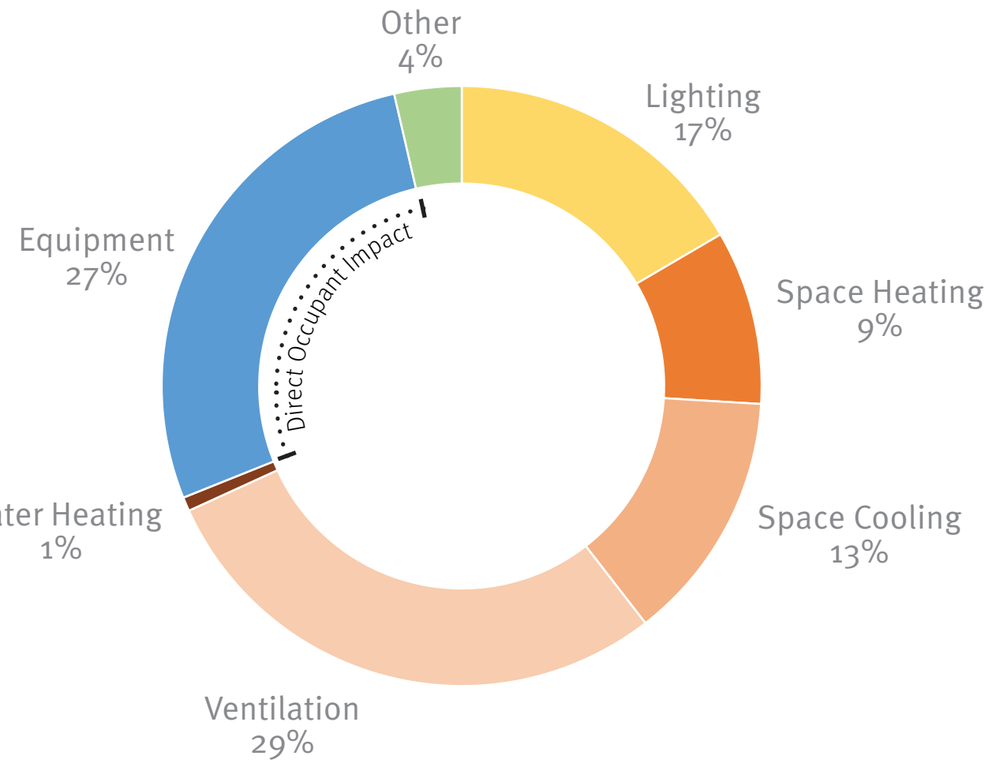

ENGAGEMENT PROCESS



ENGAGEMENT PROCESS
KING OPEN

Feasibility Phase

-Define goals
-User meetings with all groups
-Collect usage data (schedules, equipment, etc)

Schematic Design

-Build consensus on goals
-Establish NZE Champions Group
-NZE Champions Workshop

Design Development & CDs

-Meet with NZE Champions group in each phase to discuss design as it develops

Construction

-Workshop with all staff and students start to get used to what to expect
-Training before move-in

Post Occupancy

-Operations Manual: user cards, phone app
-Curriculum incorporation
-Yearly training


Designing for Efficient Systems



Ductwork and refrigerant lines were coordinated tight to steel



1 of 2 VRF ceiling cassettes installed in every typical classroom

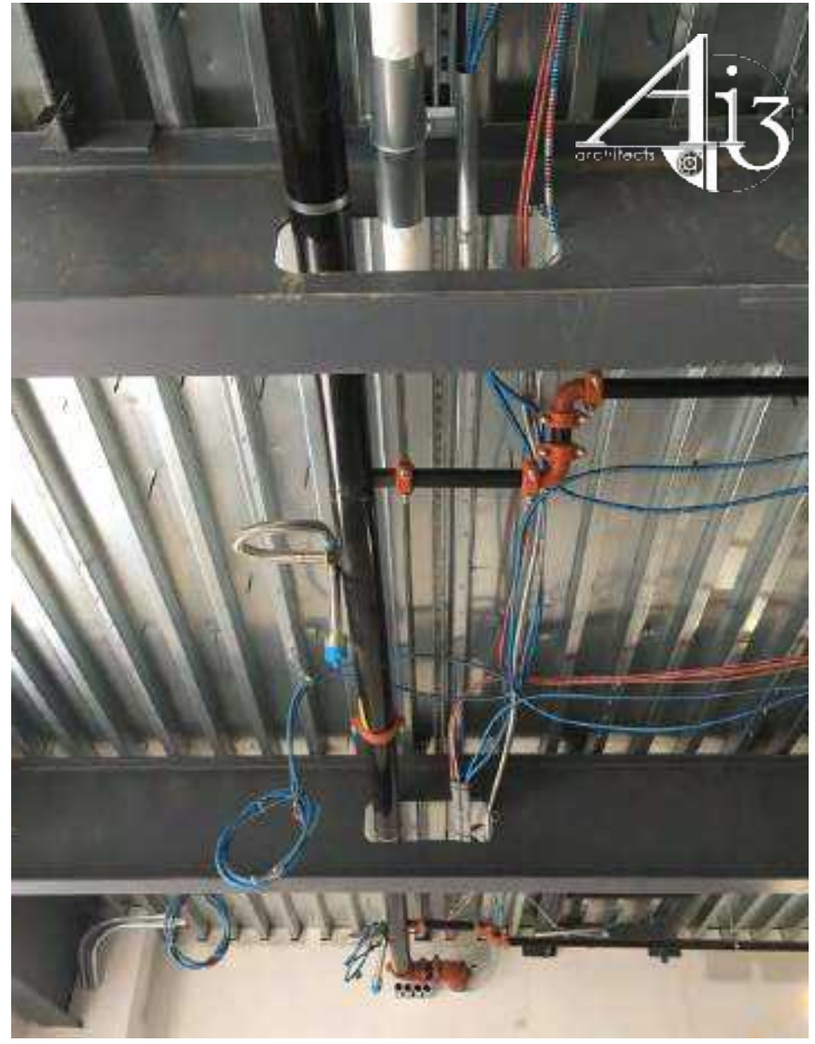

Coordinated beam penetrations to maintain ceilings heights

COMMUNITIES ARE UNIQUE

Educational Benefits:

- Create living laboratories that adapt students to a knowledge-based technologically advanced society
- Occupant engagement can serve as a teaching tool for students, STEM programs, and the larger community
- Give students the confidence to take leadership roles in their schools as advocates for environmental sustainability and their own learning needs

Health Benefits:

- Better indoor air quality, acoustics, and daylight
- Improved occupant performance
- Lower absenteeism
- Attract and retain students and faculty

Cost Benefits:

- Lower operating costs for maintenance
- Lower energy bills
- Reduced exposure to the volatility of shifting energy prices

Views to Nature

Operable Windows

Daylight & Views

Dimmable Indirect Lighting

Natural Look Materials

Displacement Ventilation

Acoustically controlled learning environment

Red List Free Materials

Ergonomic Furniture





KING OPEN/CAMBRIDGE STREET UPPER SCHOOL AND COMMUNITY COMPLEX


with Arrowstreet

2015



THE TARGET:

Net zero annual emissions from buildings citywide.

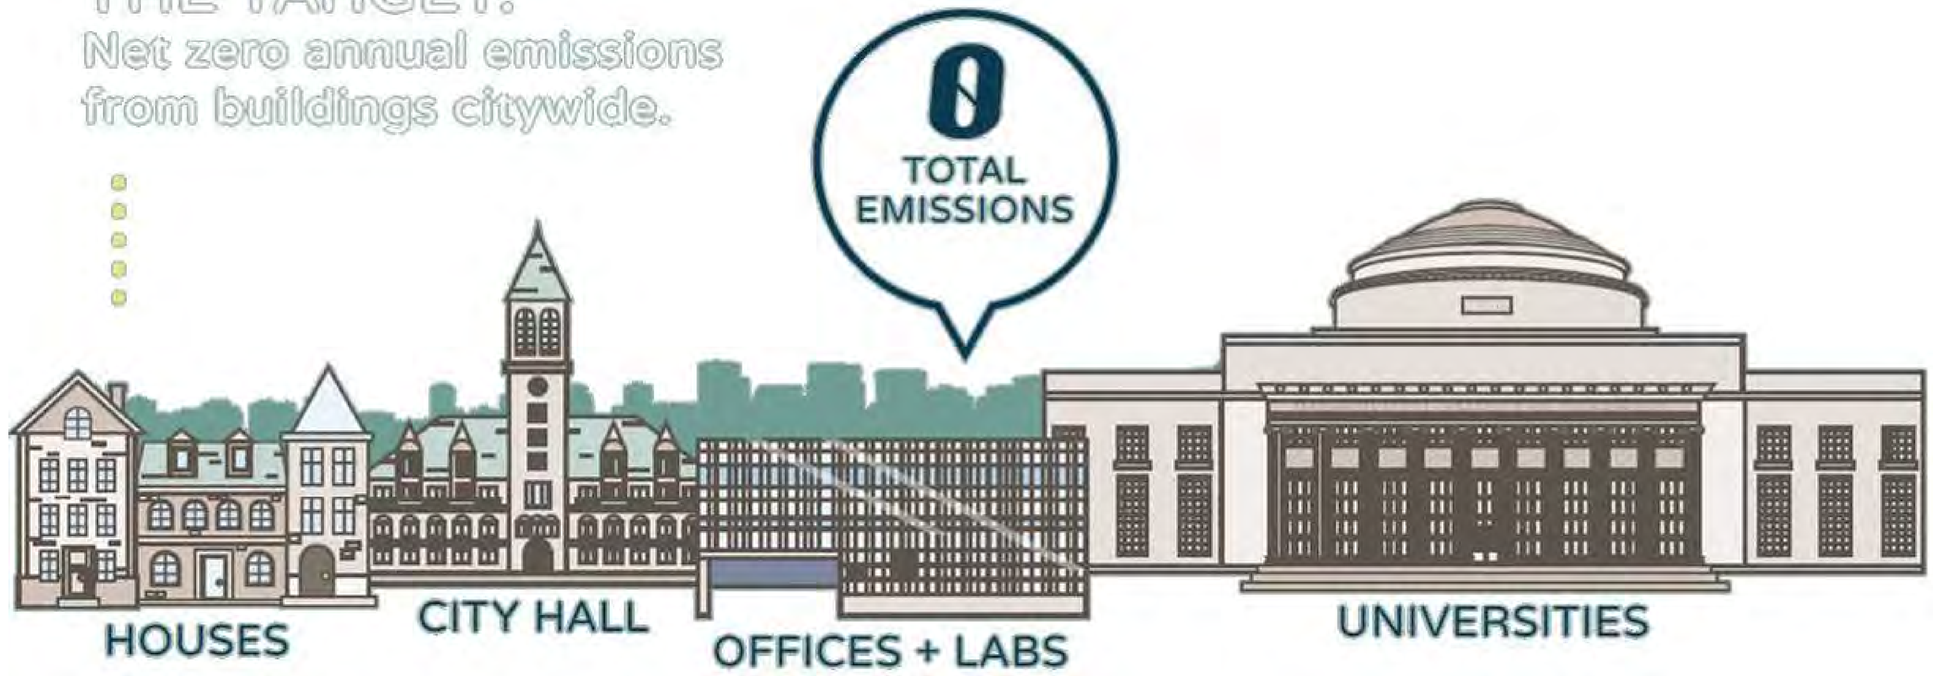

CITY OF CAMBRIDGE

5 ACTION PLAN



Energy Efficiency in Existing Buildings

Reduce energy use in buildings through retrofits and improved operations.

Net Zero New Construction

Require low carbon new construction.

Local Carbon Fund

Option to invest in a net zero community.

Renewable Energy Supply

Replace fossil fuels with low carbon energy.

Engagement and Capacity Building

Industry training and community involvement.

NET ZERO CHALLENGES


Multiple Programs with Extended Hours


After School Programs

Community Classrooms


Weeknight & Weekend Gymnasium Use

Public Branch Library

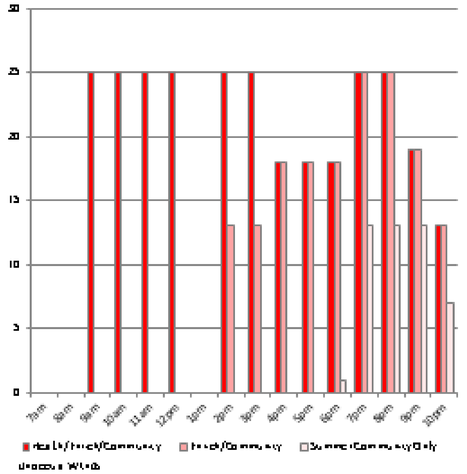


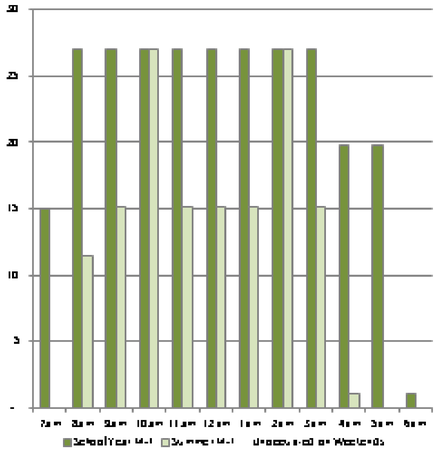

Community Classroom

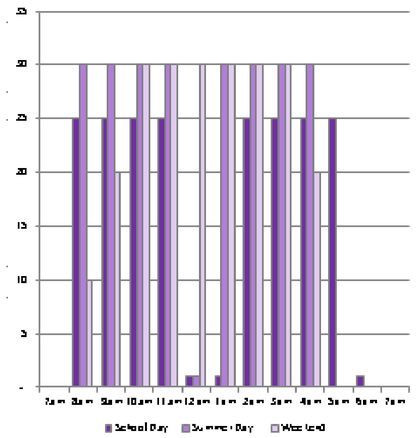

Learning Commons

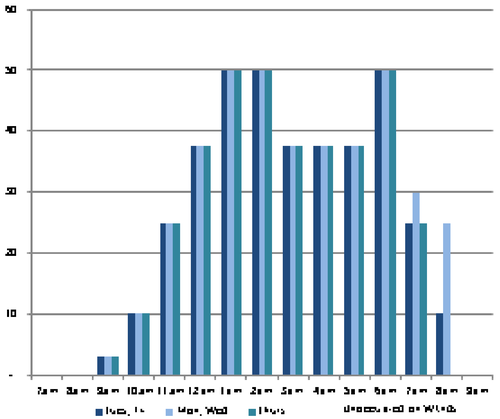

PATHWAY TO NET ZERO EMISSIONS

Eliminate On-site Combustion of Fossil Fuels



Reduce Demand



Maximize On-site Production of Electricity



Step 1: Eliminate On-Site Fossil Fuel Combustion



ELIMINATE ON-SITE FOSSIL FUEL COMBUSTION

Strategy 1: Geothermal Wells & Heat Exchange


190 Geothermal Wells
- **Tight Site**
- **Article 97 Limitations**
- **Soil capacity**




REDACTED

ELIMINATE ON-SITE FOSSIL FUEL COMBUSTION

The Payoff

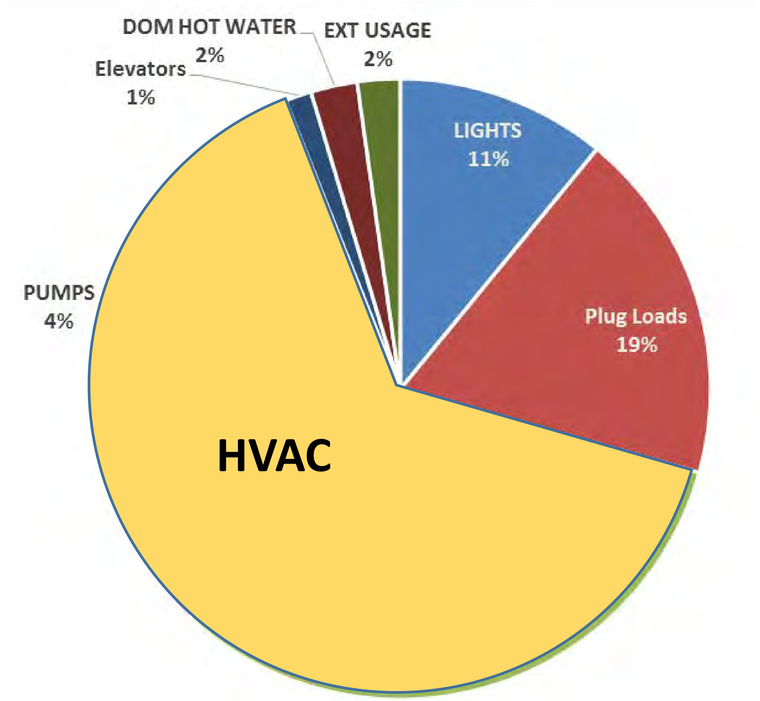

Without Geothermal

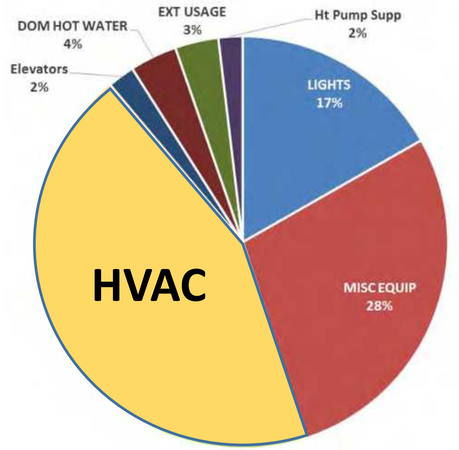

With Geothermal


Geothermal System Reduces Energy Demand by 54%

REDUCE DEMAND

Strategy 2: High Efficiency Envelope

ROOF: R-40

Window to Wall Ratio: 40%

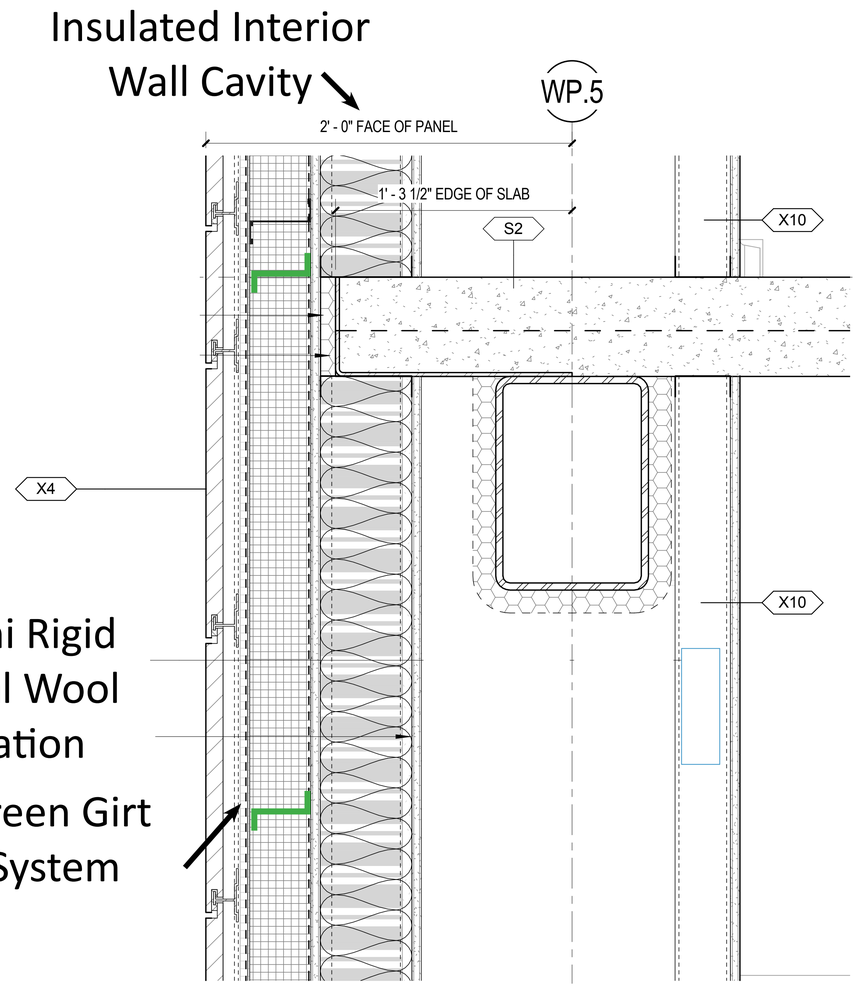

WALL: R-28



REDUCE DEMAND

Strategy 3: Reduce Fan Energy

Displacement Ventilation

Demand Control Ventilation

Using CO_2 Sensors

Forced Air for Ventilation Needs

Trim Heating or Cooling by Radiant Panels/ Chilled Beams

Occupancy Sensors for Standby Mode

Throttle VAVs and AHUs


REDUCE DEMAND

Strategy 4: Solar Hot Water

Panels with Peak Capacity of 1,000,000 BTU/hr

Hot Water Generated Will Serve the Cafeteria Kitchen
(and Pool Locker Rooms in Summer)


Any Hot Water not Needed by Kitchen will Serve Radiant Loop
(or Be Used to Temper Pool in Summer)

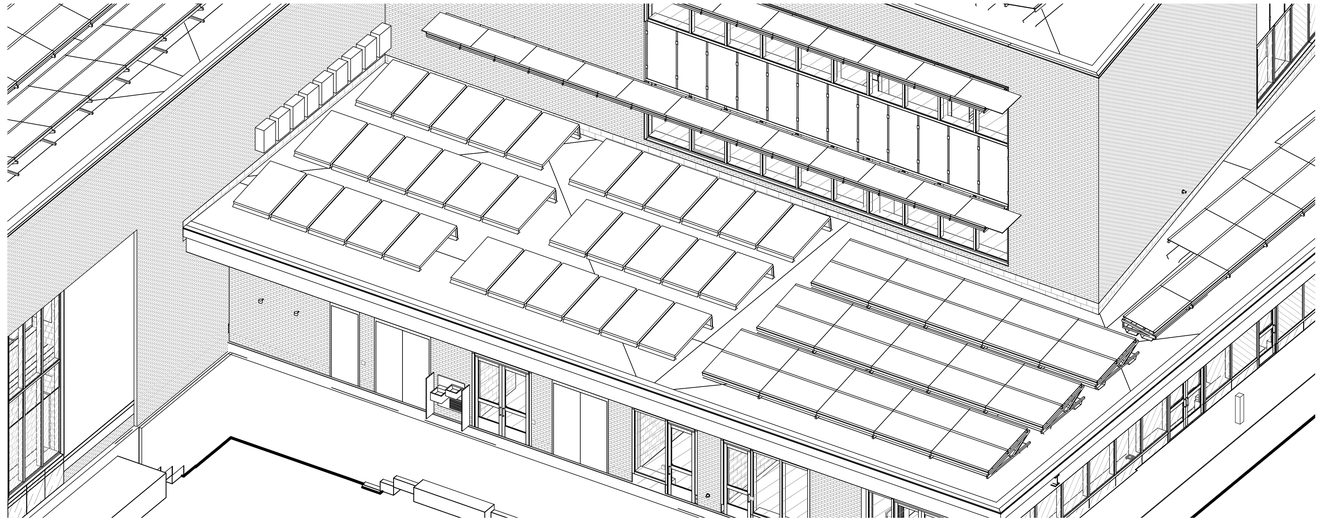




REDUCE DEMAND

Strategy 5: Engage Users

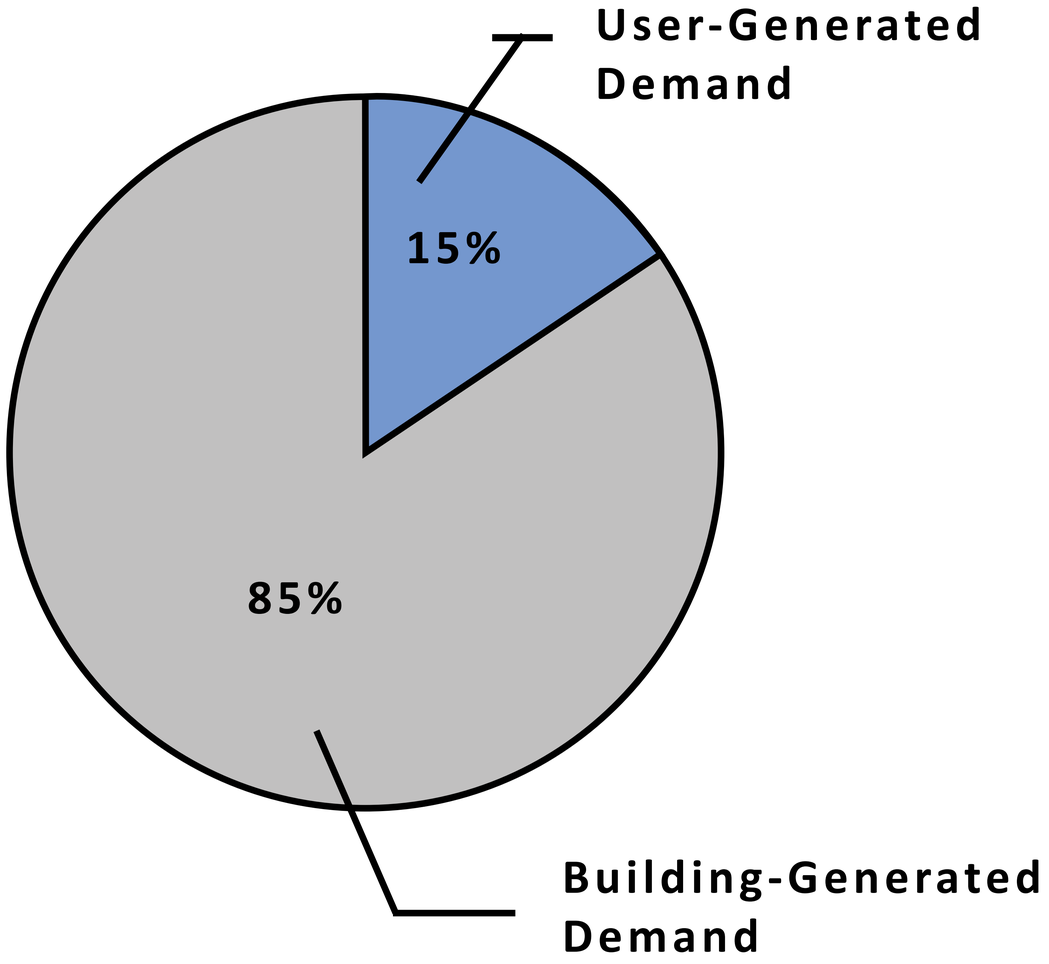

Baseline EUI

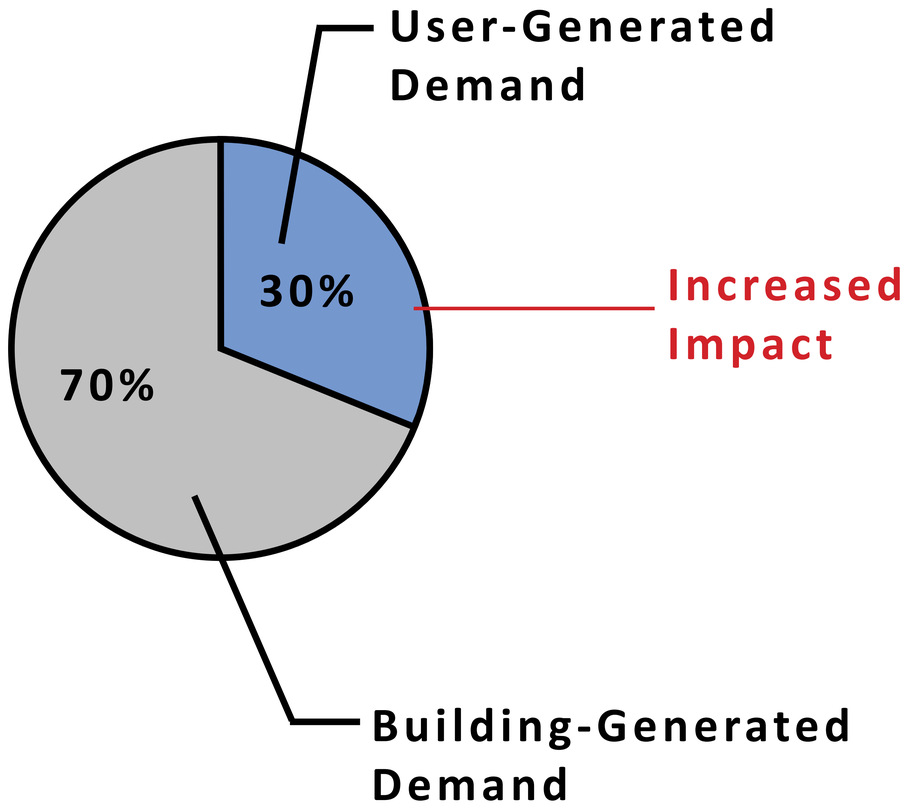

Improved EUI

REDUCE DEMAND

Strategy 1: BUILDING ORGANIZATION








RESULTS

How Did We Do?

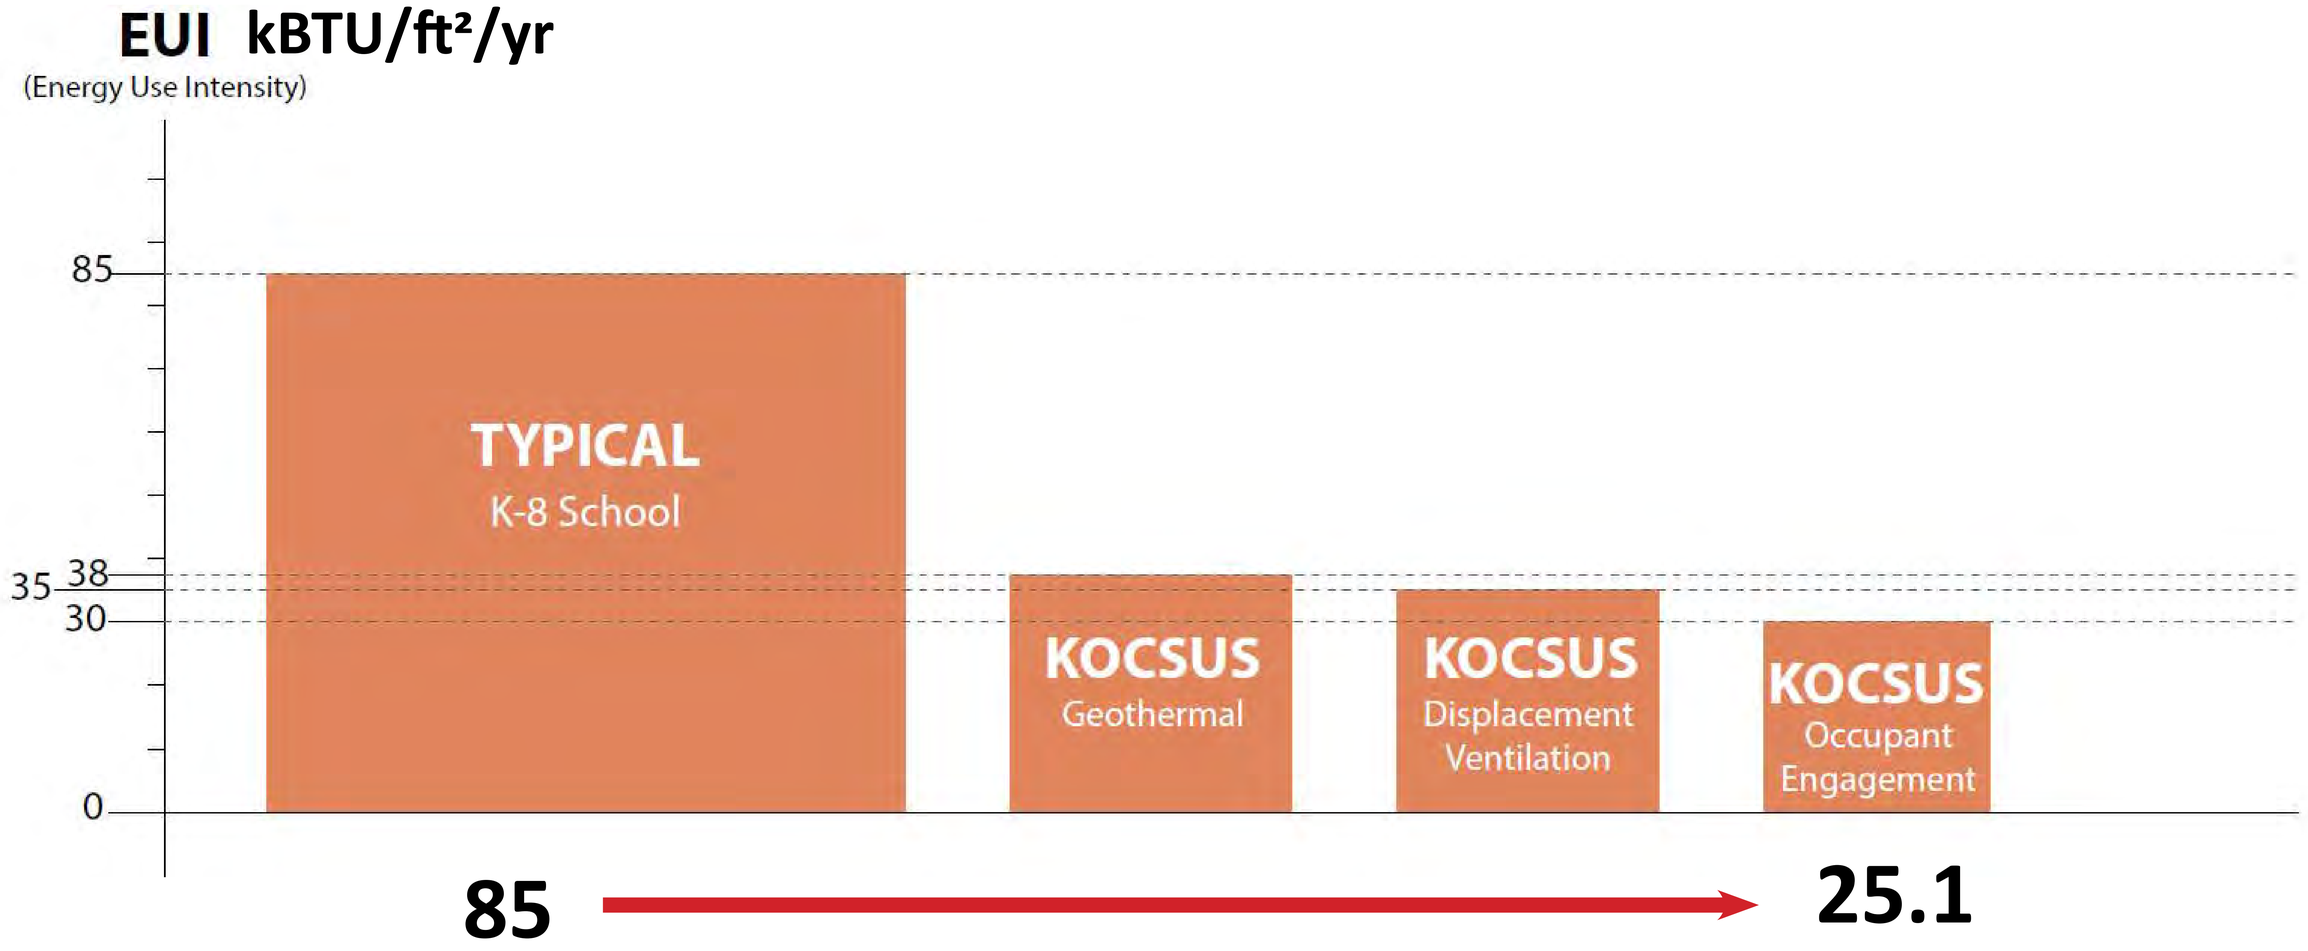

ON-SITE ENERGY GENERATION

PHOTOVOLTAIC PANELS



ON-SITE ENERGY GENERATION


PHOTOVOLTAIC PANELS



NET ZERO CHALLENGES

The Efficiency of PV is Relatively Low Today


1ft² of PV Supplies Energy to 2ft² of Building

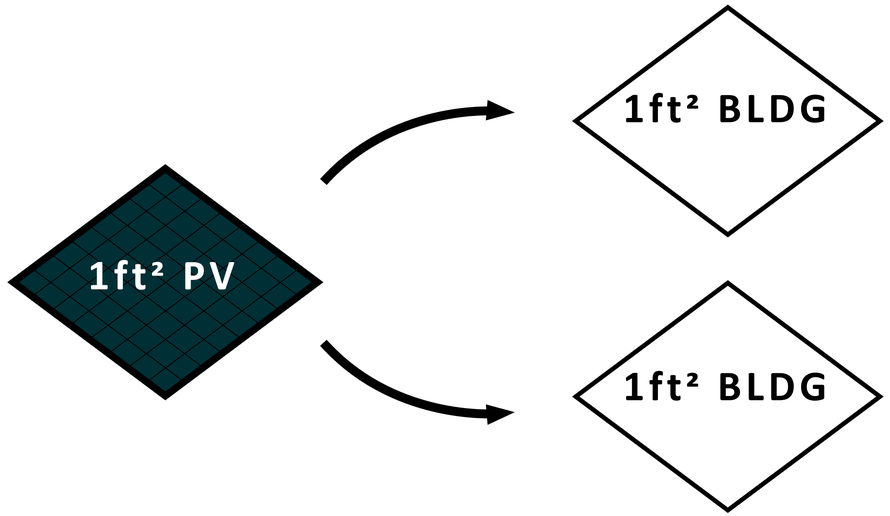



Anything Over 2 Stories Becomes A Challenge


ON-SITE ENERGY GENERATION

PHOTOVOLTAIC PANELS

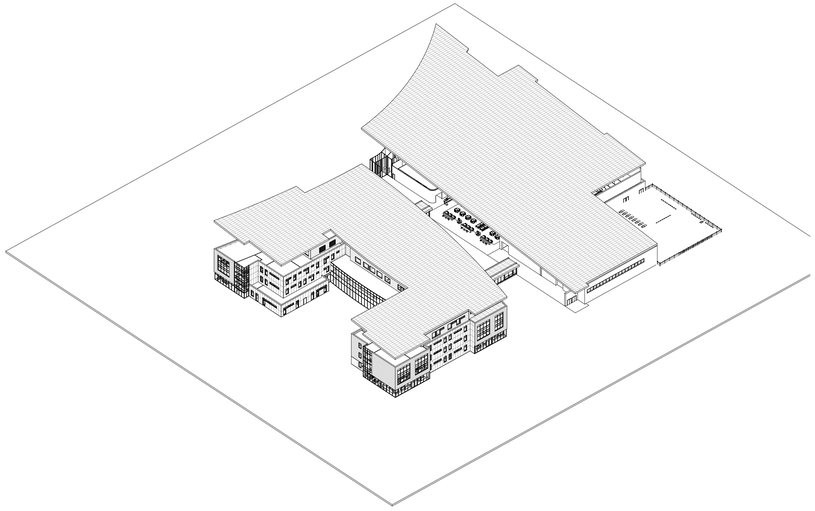


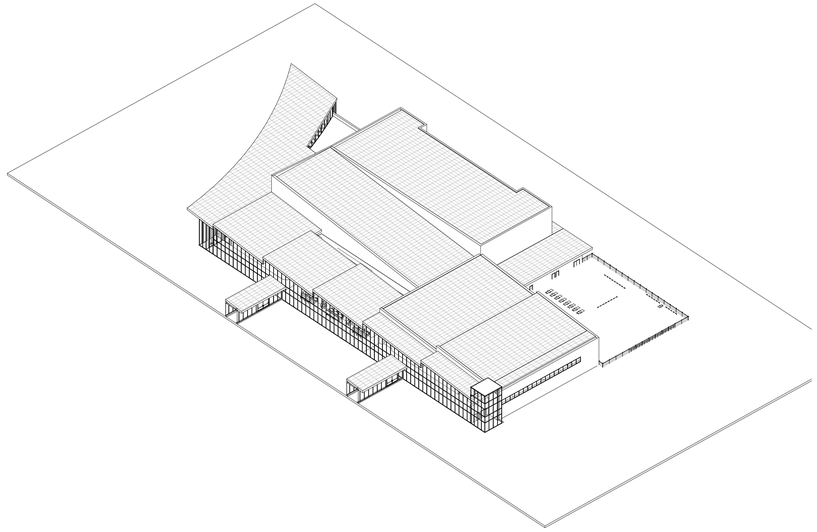

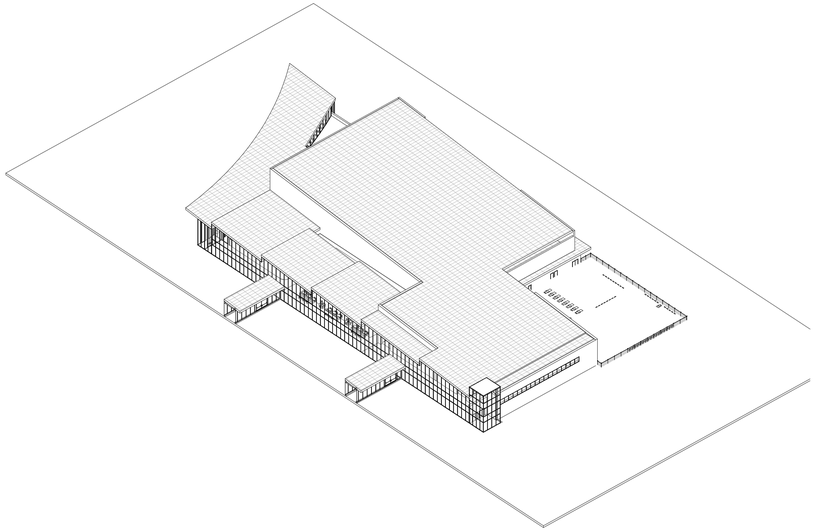


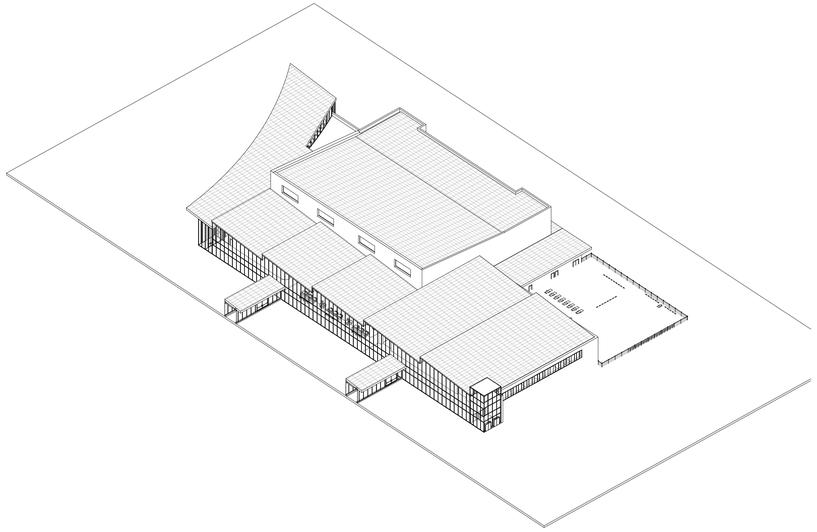

The Site is Approximately 45º Off the N/S Grid

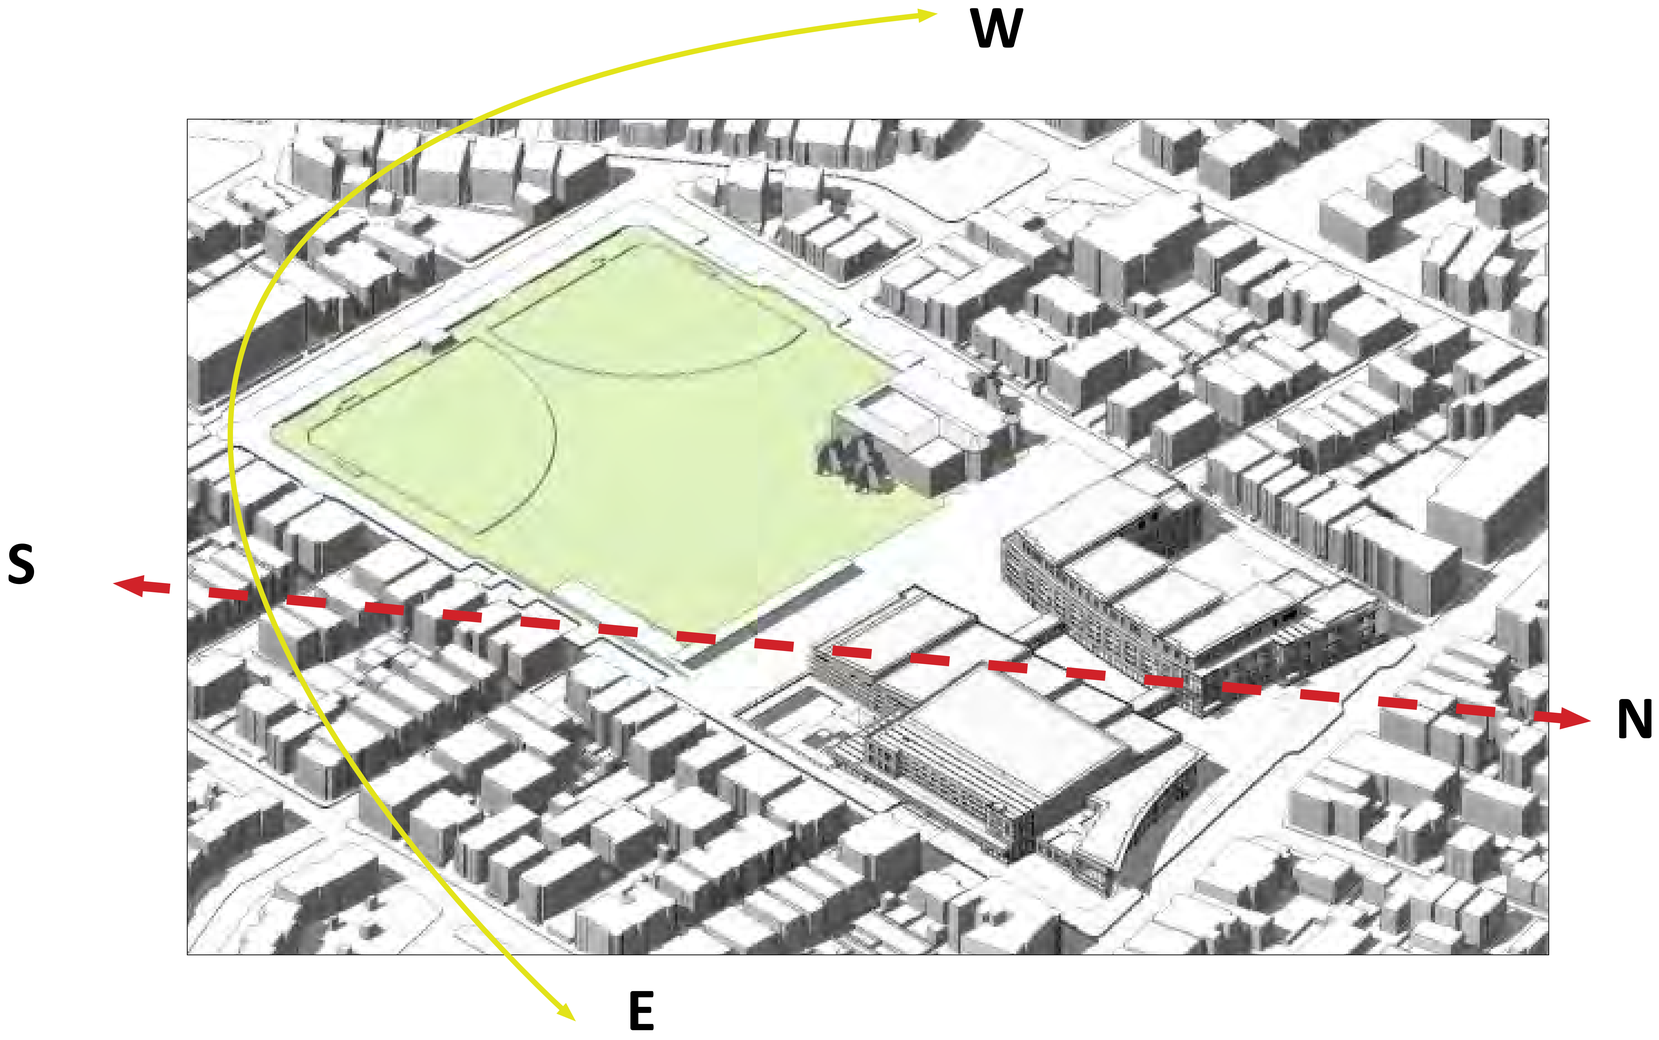

This Leads to the Fundamental Question:
How Do We Orient the PV Panels?

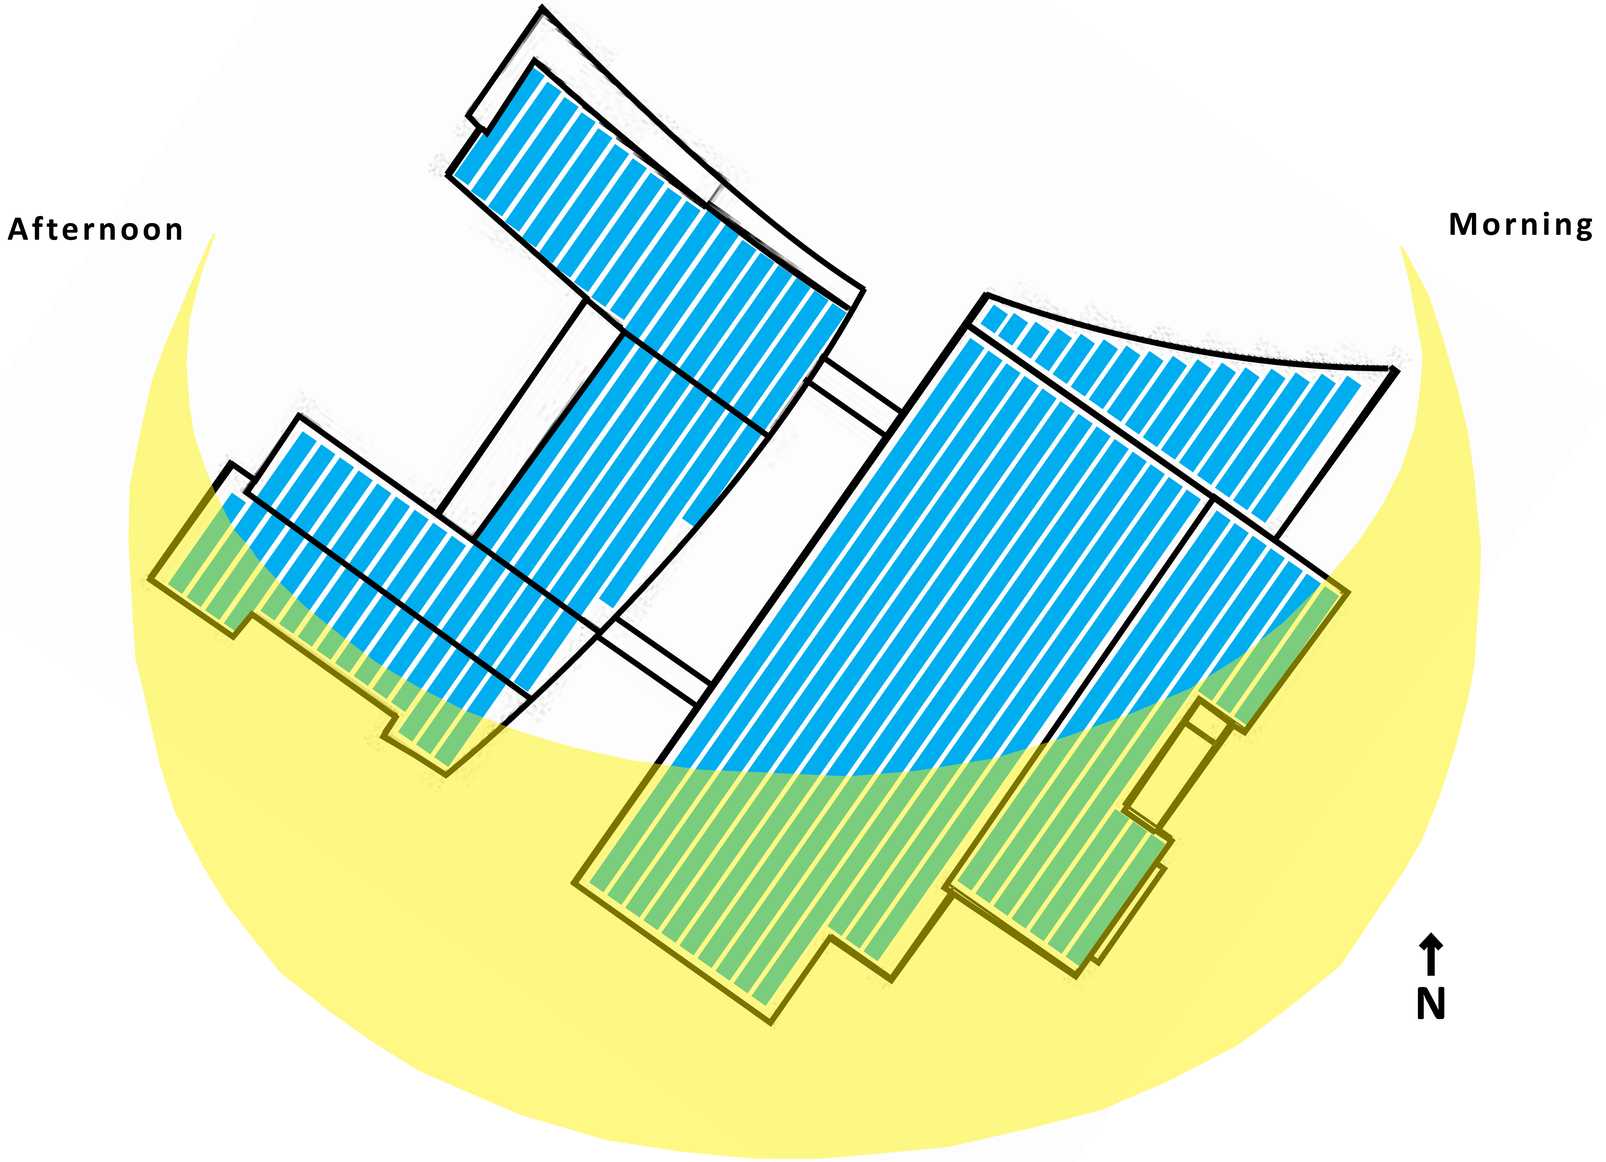

Option 3 - E/W Orientation, Building Layout: More Efficient PV Spacing. Captures Sun All Day.







Photovoltaics Integrated Into Light Shelves

NET ZERO EMISSION - RESULTS


How Did We Do?

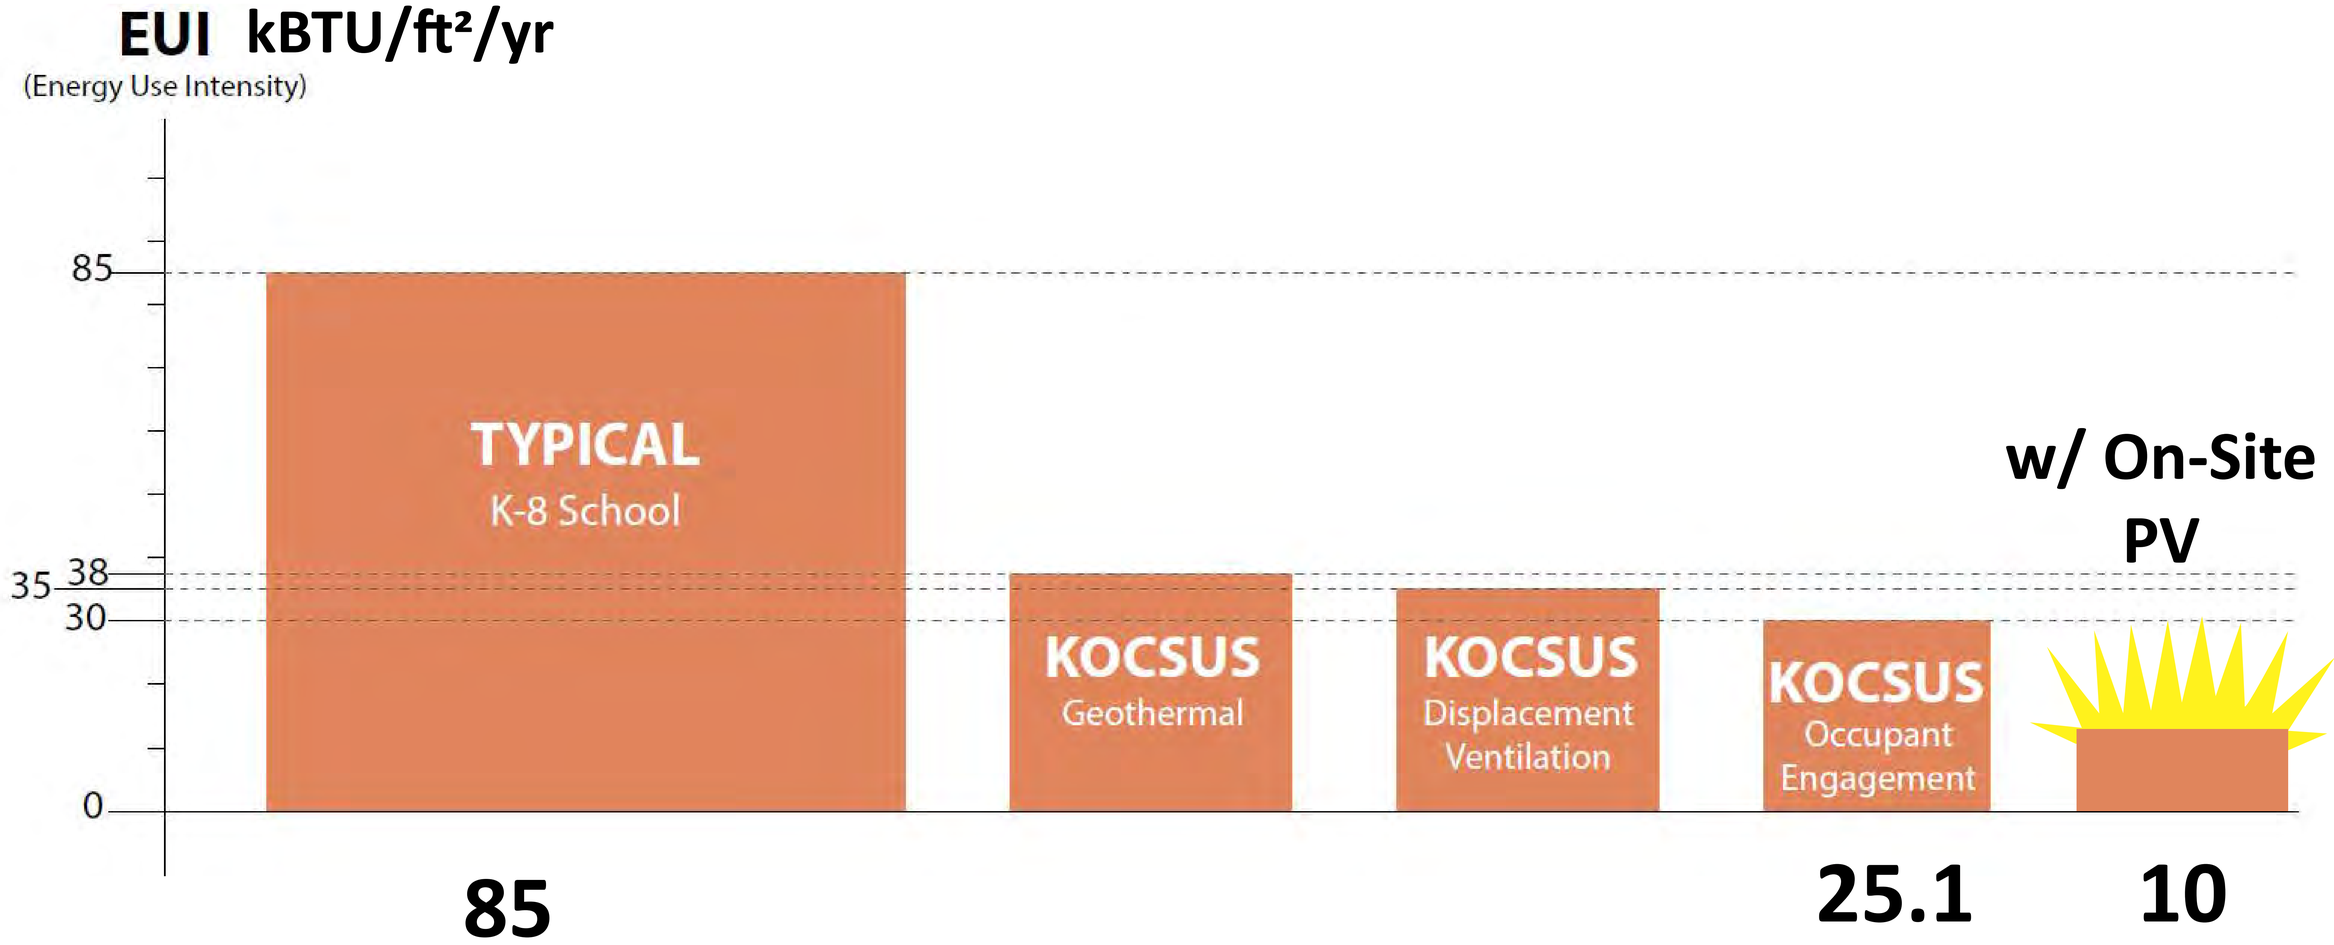

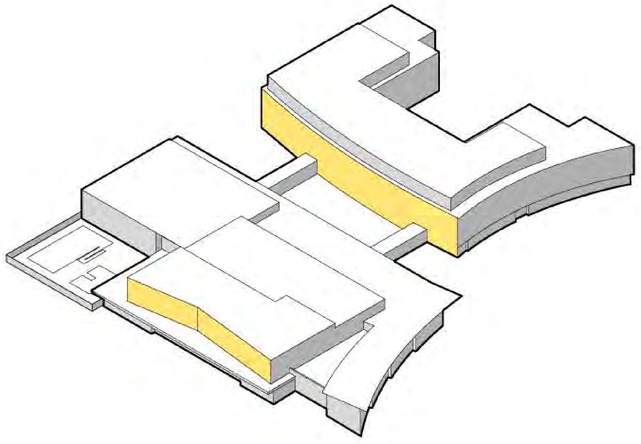


FACADE MOUNTED PV

72% energy reduction over Architecture 2030 baseline

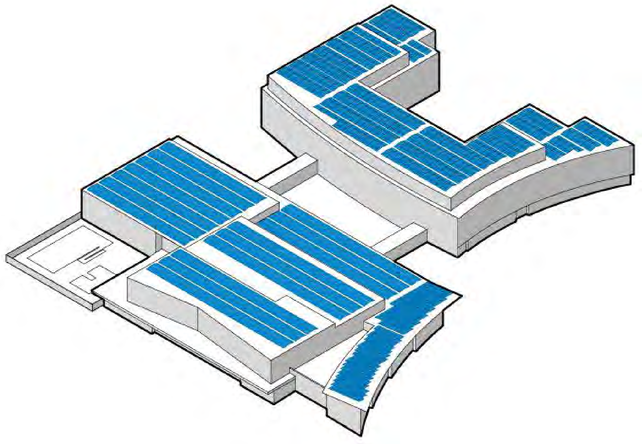


ROOF MOUNTED PV

1,300 MWh PV

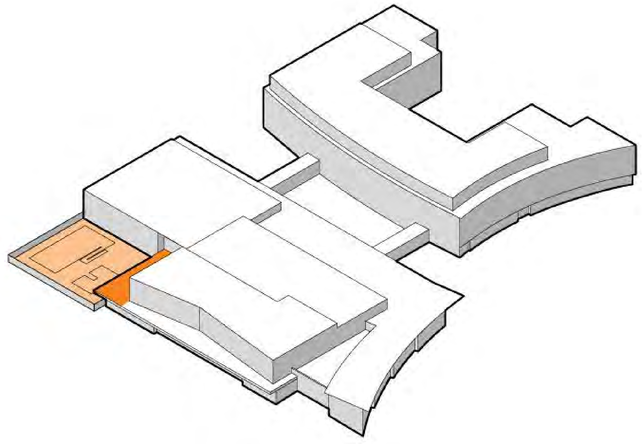


SOLAR THERMAL

25 pEUI

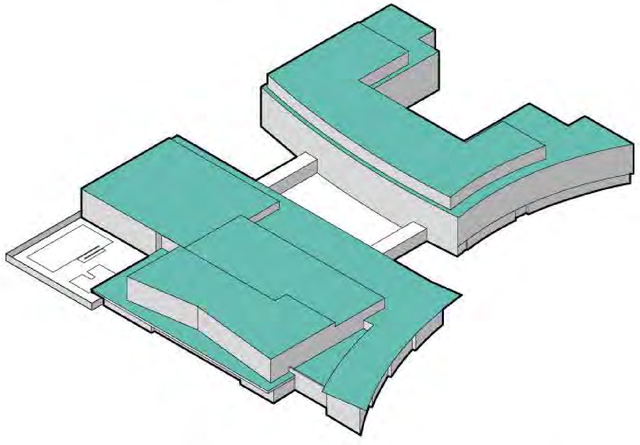


RAINWATER HARVESTING

100% water retention

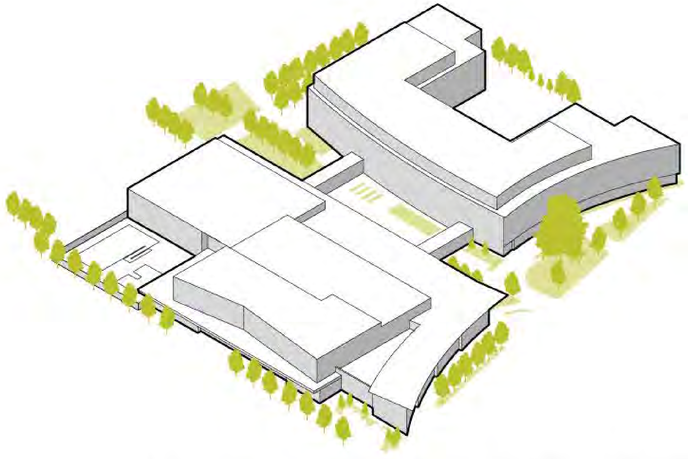

INCREASED VEGETATION & NATIVE PLANTS

1 additional acre of green Space

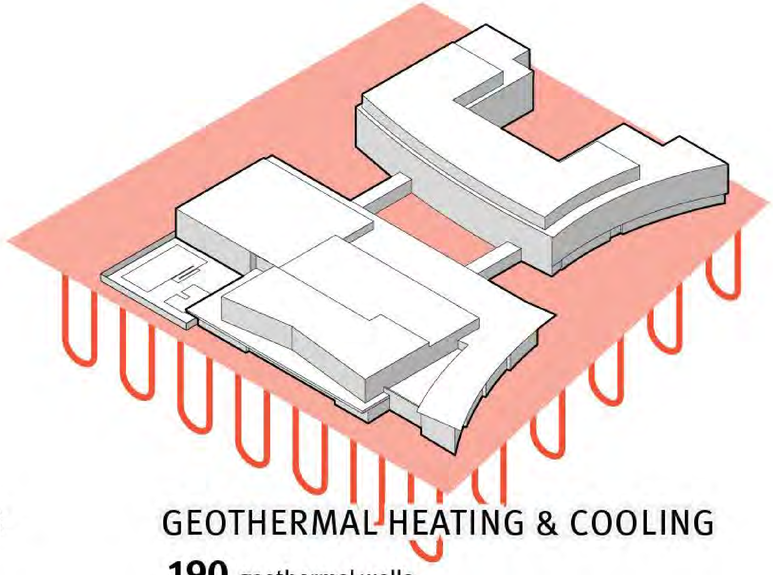

GEOTHERMAL HEATING & COOLING

190 geothermal wells












TOW ZONE
NO STOPPING
TOW ZONE
NO PARKING SCHOOL BUS ONLY 7AM-4PM
SCHOOL BUS
COMMUNITY COMPLEX


Cambridge
Willow
NO
TURN
ON RED

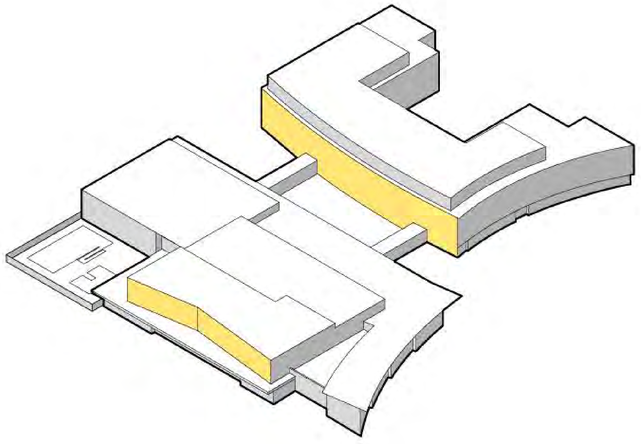


FACADE MOUNTED PV

72% energy reduction over Architecture 2030 baseline

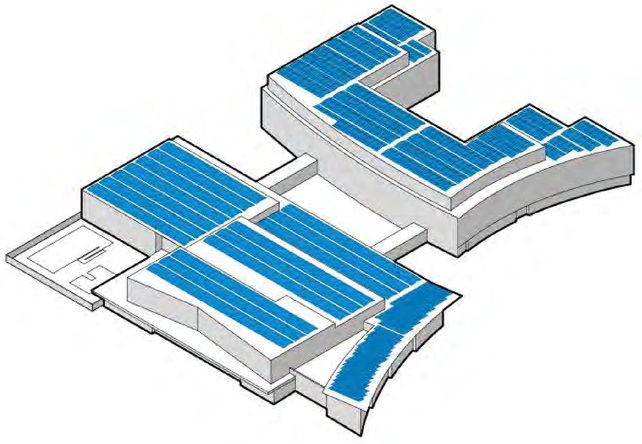


ROOF MOUNTED PV

1,300 MWh PV

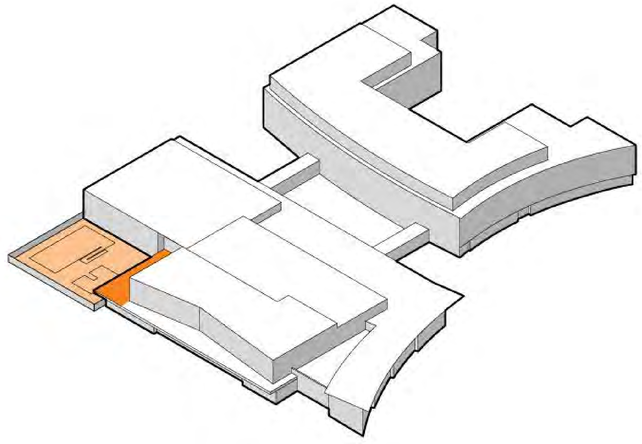


SOLAR THERMAL

25 pEUI

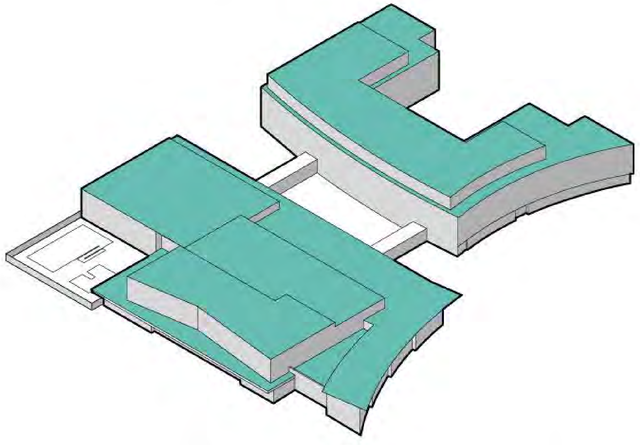


RAINWATER HARVESTING

100% water retention

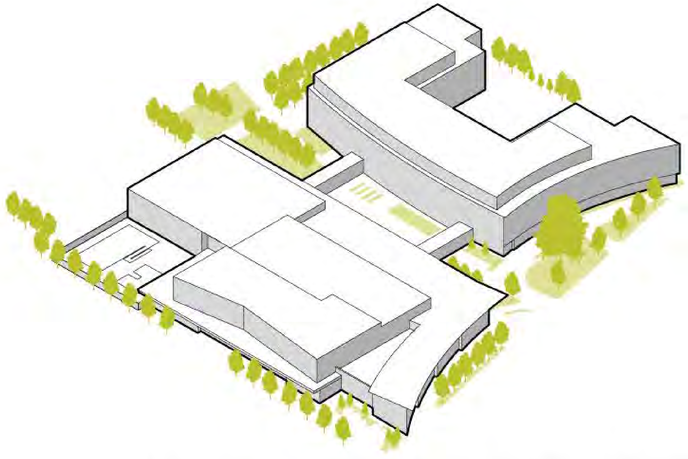

INCREASED VEGETATION & NATIVE PLANTS

1 additional acre of green Space

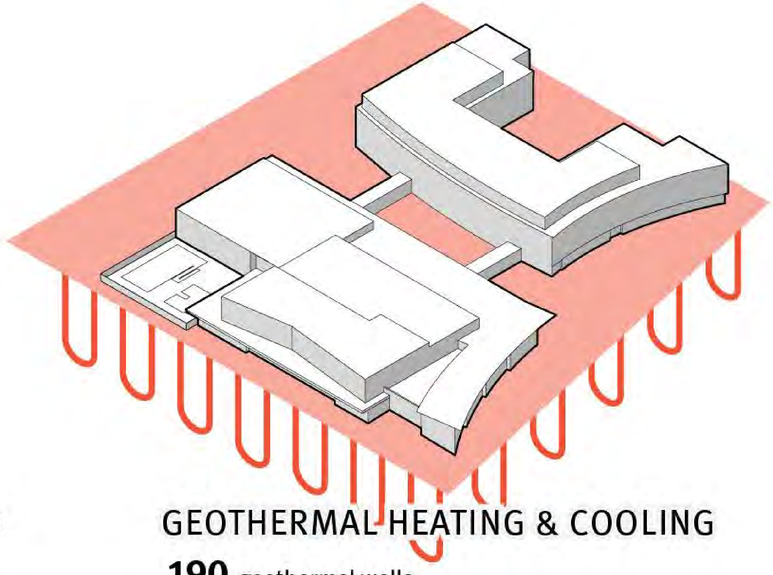

GEOTHERMAL HEATING & COOLING

190 geothermal wells